# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/27/2018 Expiration Date: 8/27/2019

Property Owner: Perry Bielert c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating, Inc License No. 135

__xx__ New Installation ___ Existing System

___ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 95' pressure dosed laterals in 3' wide trenches for house and shop toilet.

*Parcel Description*:

Legal: S14 T37 R27

Address or Location: Pine Creek Estates 2 Lot 8

Geo/Assessors code: 0000053074

*Approved Design Criteria*:

# Bedrooms 4 Septic Tank Size: 1000/500 gallons Drainfield Size: 380 Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

*I,* Buck Schermerhorn *have inspected this system and found it to be in compliance with the conditions of the permit and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* [signature] *Date:* 10-5-18


*Title:* President

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

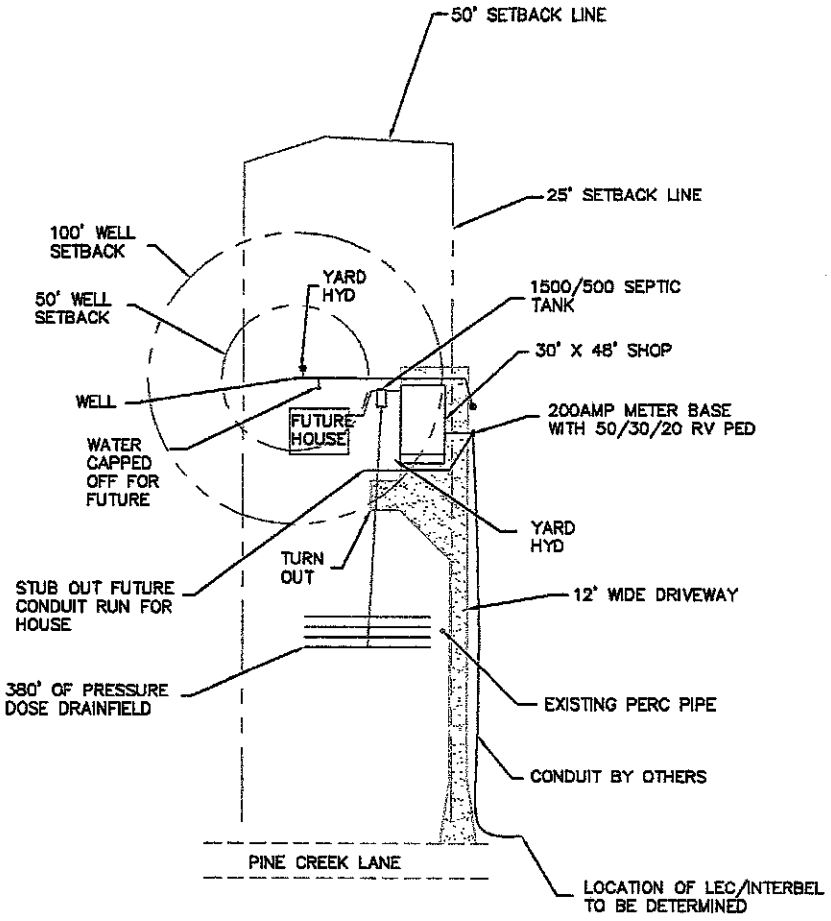


# BIELERT SITE LAYOUT