County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/23/2019 Expiration Date: 4/23/2020

Property Owner: Judy Boothman c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

___ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Two 3' drywell rings and tank replacement.

Parcel Description:

Legal: S4 T30 R31

Address or Location: Shady Rest Block 2 Lot 10

Geo/Assessors code: 0000009718

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 2 drywell

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 5-1-19

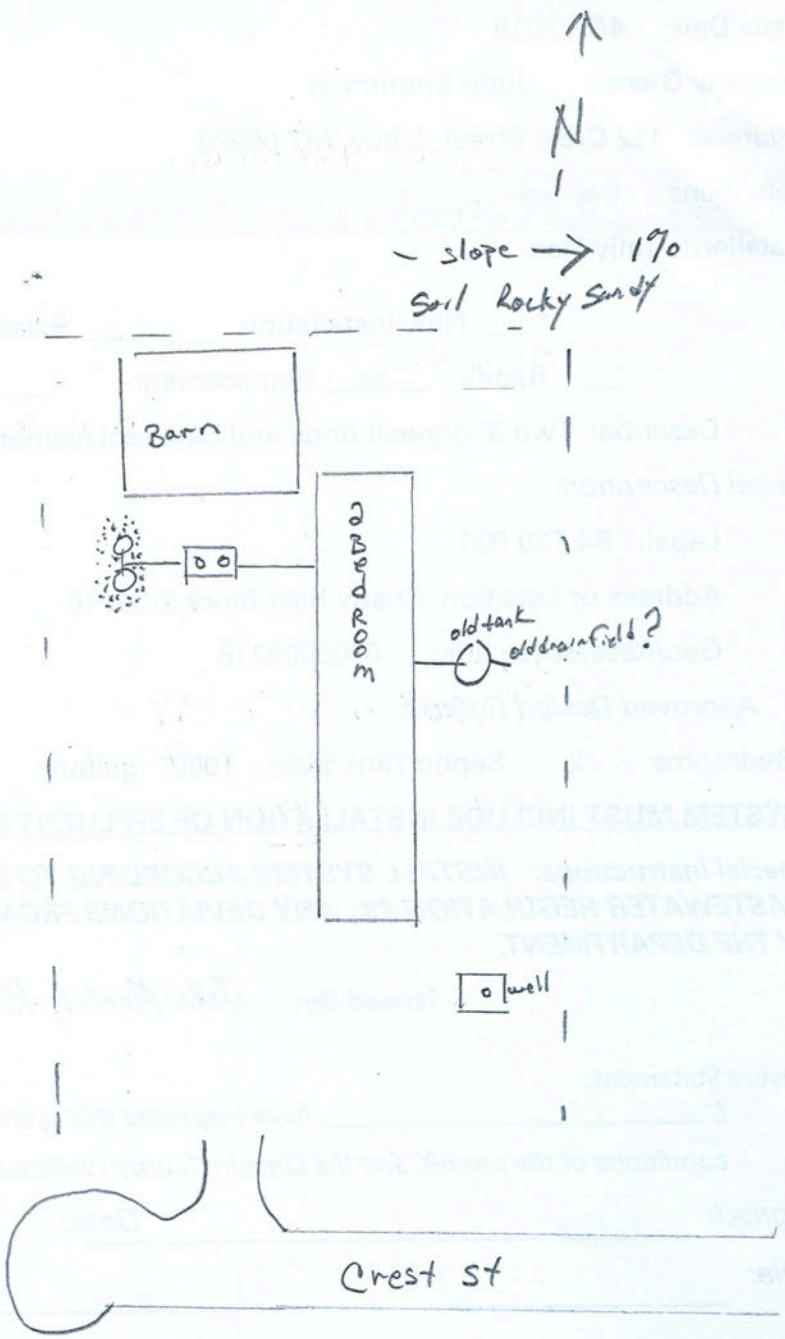
Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
slope → 1%
Soil Rocky Sandy
Barn
Manufactured
old tank
old drainfield?
well
Crest St