LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/11/2018 Expiration Date: 6/11/2019

Property Owner: Jason Brannick c/o: Koocanusa Plumbing

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing and electric License No. 169

__xx__ New Installation ____ Existing System

____ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 84' laterals using gravelless chambers. Size reduced per 0.4 app rate.

Parcel Description:

Legal: S26 T36 R28

Address or Location: Cato Subdivision Lot 3

Geo/Assessors code: 0000054843

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 336 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, David [illegible], *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: David [illegible] *Date:* 8-15-2018

Title: Owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Reviewed by the Local Reviewing Authority
Under Interlocal Agreement
Department of Environmental Quality/ PCD

Accepted under contract
Barbara Kingery 12/18/12
DEQ Representative Date


EQ # 13-1448

RECEIVED
DEC 17 2012
MT DEQ PUBLIC WATER
& SUBDIVISION BUREAU

CATO SUBDIVISION

"REMAINDER" PARCEL, JENNINGS SUBDIVISION, PLAT NO. 6705
"REMAINDER" PARCEL, & LOT 3, WARLAND SUBDIVISION, PLAT NO. 7014
S1/2 S1/2 NW1/4, SECTION 26, TOWNSHIP 36N, RANGE 28W, P.M. MT.

NOTE-
1.Nearby well or septic systems within 100 ft. shown
2.Homeowners Association responsible for the maintenance of Stormwater Control Device (SCD-retention pond).
3.Homeowners Association to maintain conveyance swales, culverts & roadside swales in road right-of-ways
4. Individual Lot owners are responsible for the maintenance of conveyance swales within their respective property boundaries.

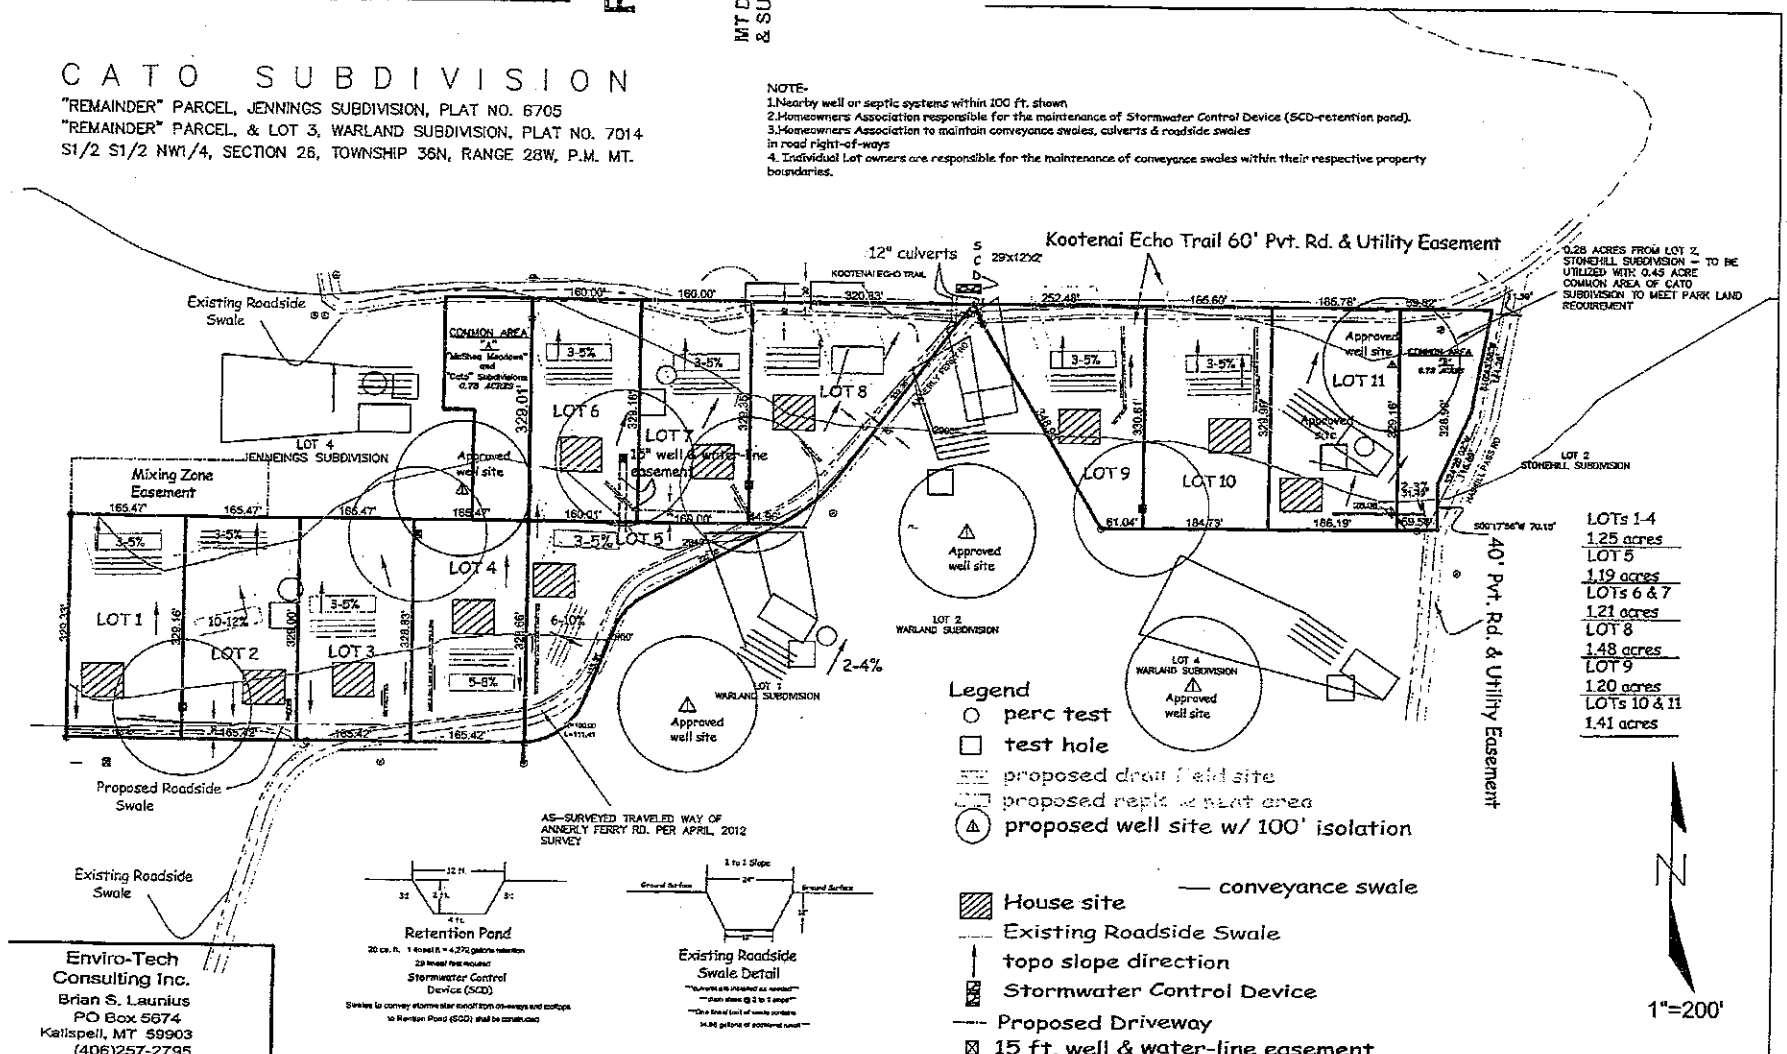

Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795