LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/16/2025 (Renewal) 08/16/2024 Expiration Date: 08/15/2026 Permit# 25-51032A

Property Owner: Brewer Family Trust

Mailing Address: [redacted]

Installer: Kootenai Sand and Gravel Inc. License #: 109

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of pressure dosed system for 3 Bedroom House to replace and abandon unknown system.

Legal: S16, T34 N, R25 W, COS 4446, PARCEL 3, ACRES 10.29

Property Address: 737 Metzner Dr. Trego, MT 59934 Assessment Code: 51032

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of pressure dosed system for 3 Bedroom House to replace and abandon unknown system with 4 Laterals @ 42'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 4 Length of Laterals: 42' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

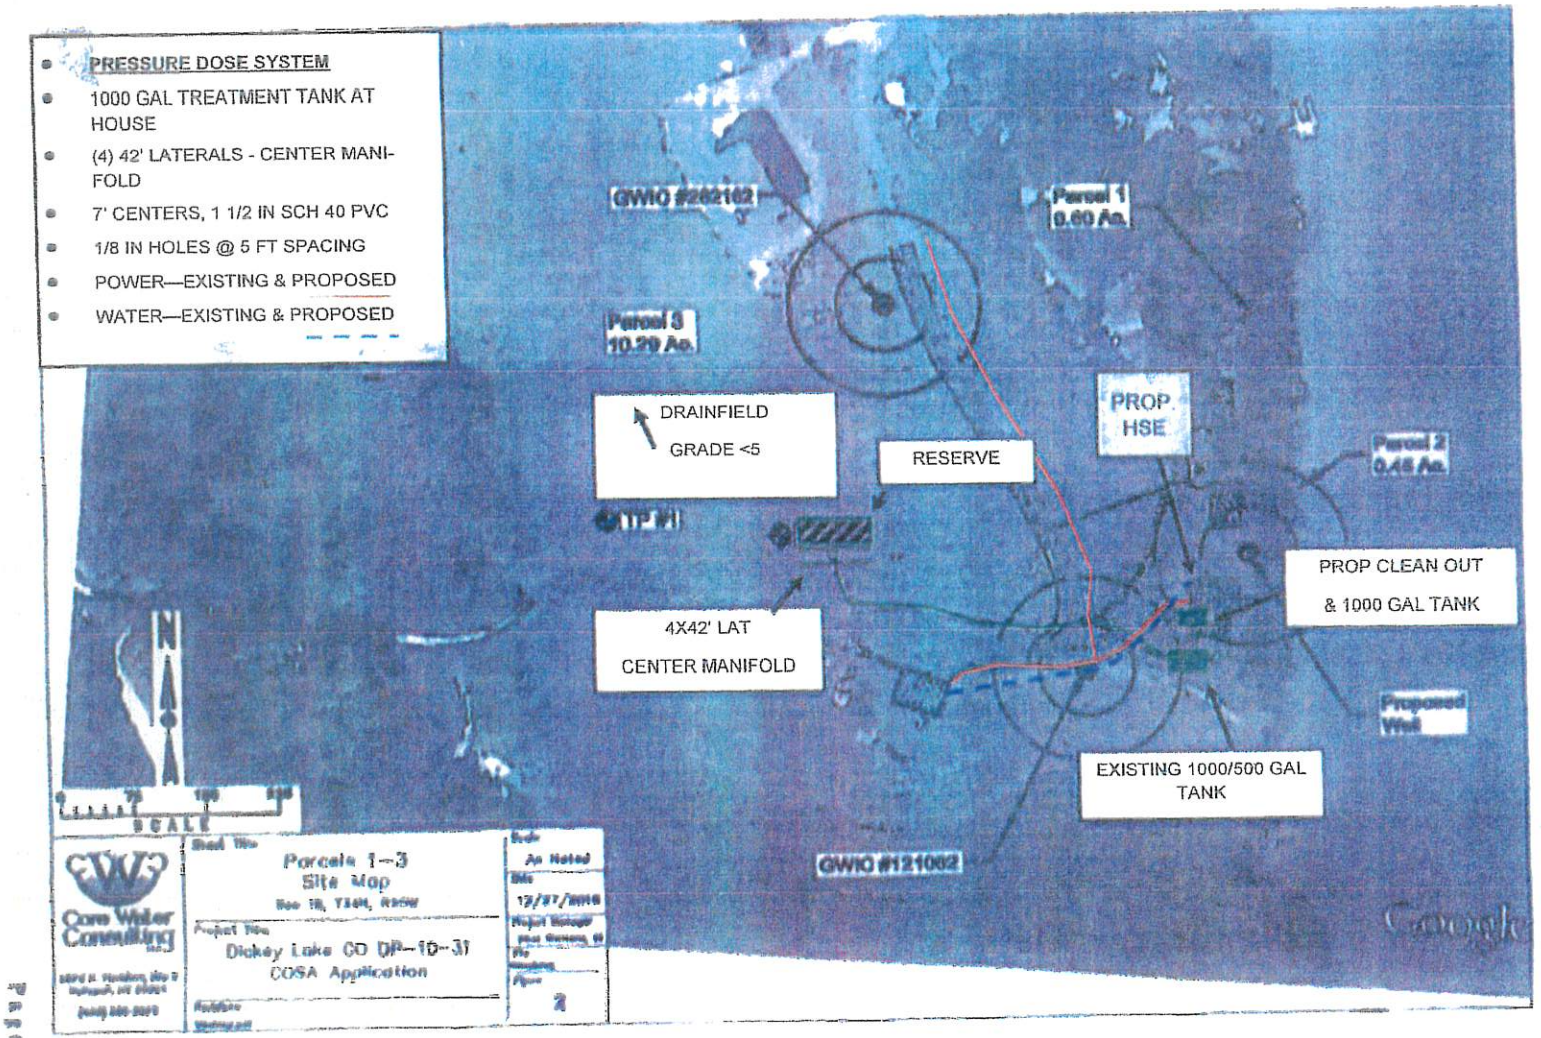
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/15/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


PRESSURE DOSE SYSTEM
1000 GAL TREATMENT TANK AT HOUSE
(4) 42' LATERALS - CENTER MANI-FOLD
7' CENTERS, 1 1/2 IN SCH 40 PVC
1/8 IN HOLES @ 5 FT SPACING
POWER—EXISTING & PROPOSED
WATER—EXISTING & PROPOSED
GWIO #262162
Parcel 1
9.60 Ac.
Parcel 3
10.29 Ac.
DRAINFIELD
GRADE <5
RESERVE
PROP. HSE
Parcel 2
0.45 Ac.
PROP CLEAN OUT & 1000 GAL TANK
4X42' LAT
CENTER MANIFOLD
Proposed Well
EXISTING 1000/500 GAL TANK
GWIO #121002
Parcels 1–3
Site Map
Dickey Lake CO DR–16–31
COSA Application
As Noted
12/27/2016
2