LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/21/2018 Expiration Date: 9/21/2019

Property Owner: Steve Bristow c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Rupert Schreiner License No. 19

__xx__ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: ~~Three 88' laterals using gravelless chambers. Size reduced per 0.6 app rate.~~ USED DRAIN ROCK

Parcel Description:

Legal: S22 T36 R27

Address or Location: Lot 5 Johnson 3 subdivision

Geo/Assessors code: 0000053242

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 260 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner *have inspected this system and found it to be in compliance with the conditions of the permit and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Rupert Schreiner *Date:* 9-28-18

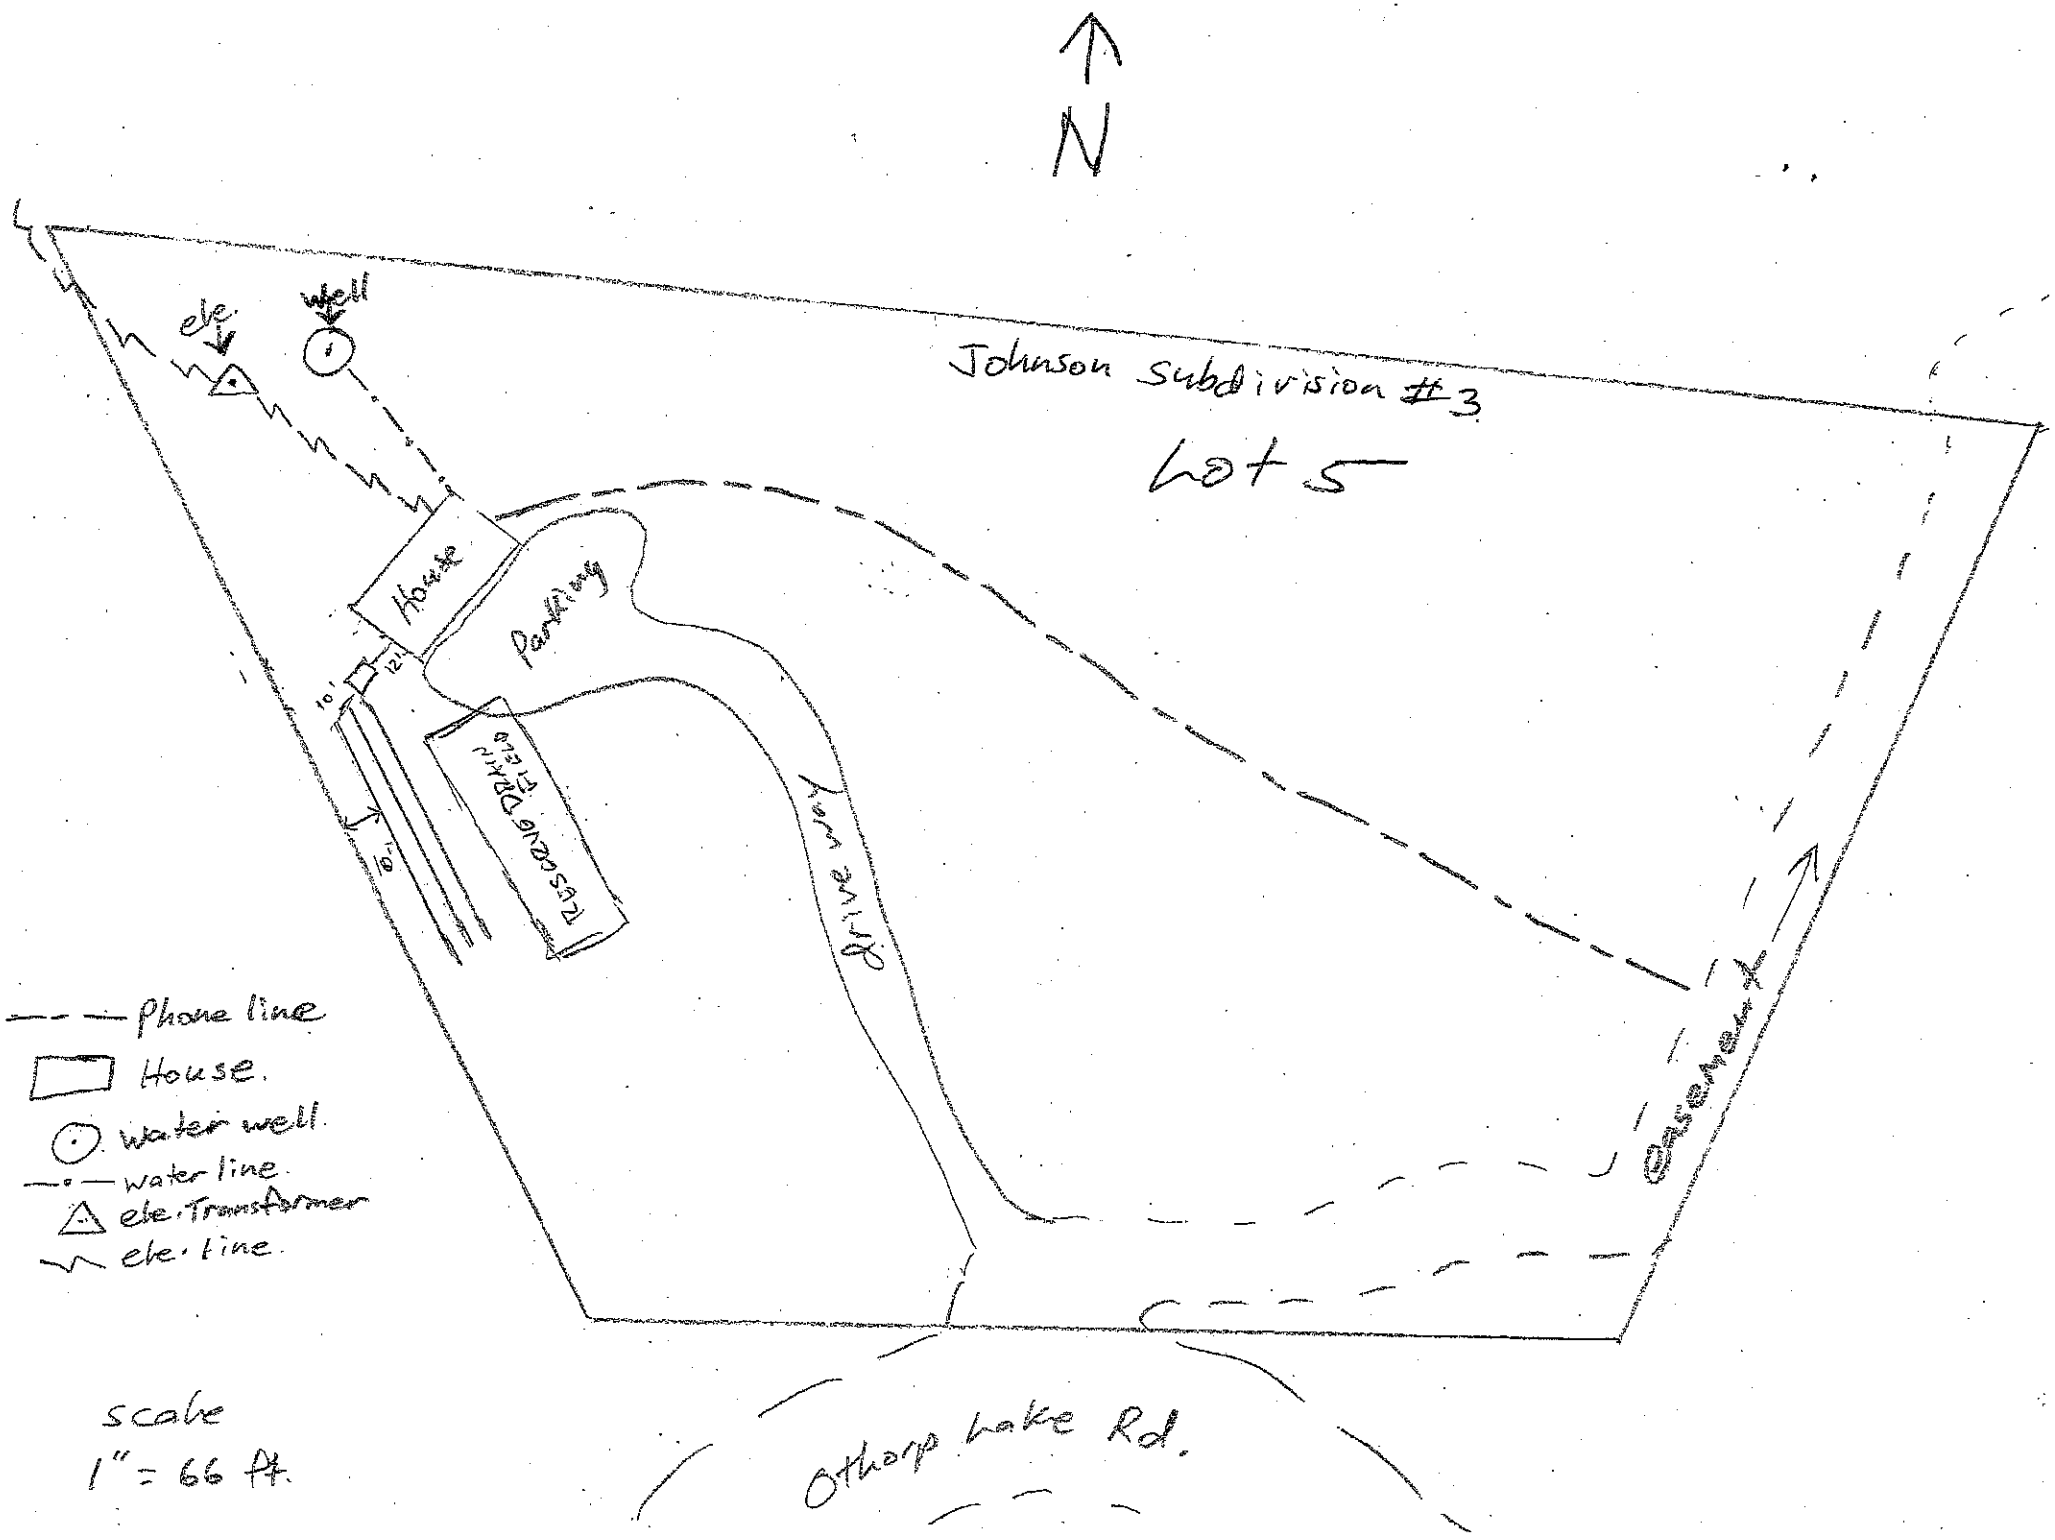
Title: Lic # 19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
ele.
well
Johnson Subdivision #3
Lot 5
House
Parking
12'
10'
10'
Leach Field
Drive way
Easement
Othorp Lake Rd.
Phone line
House.
water well.
water line.
ele. Transformer
ele. line.
scale
1" = 66 ft.