LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2018 Expiration Date: 8/21/2019

Property Owner: Marc Clark c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: B & M Excavating License No. 121

__xx__ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 63' laterals in 3' wide pressure dosed sand-lined trenches.

Parcel Description:

Legal: S29 T31 R21

Address or Location: Lot 2B Kootenai Rio Vida

Geo/Assessors code: 0000050059

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1500 gallons Drainfield Size: 140 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REVISED

LOT LAYOUT
AMENDED LOT 2, KOOTENAI RIO VIDA

NE$\frac{1}{4}$ SECTION 32, T31N., R31W., P.M.MT.
LINCOLN COUNTY, MT
DATE: 7-23-18
EQ# 06-1492

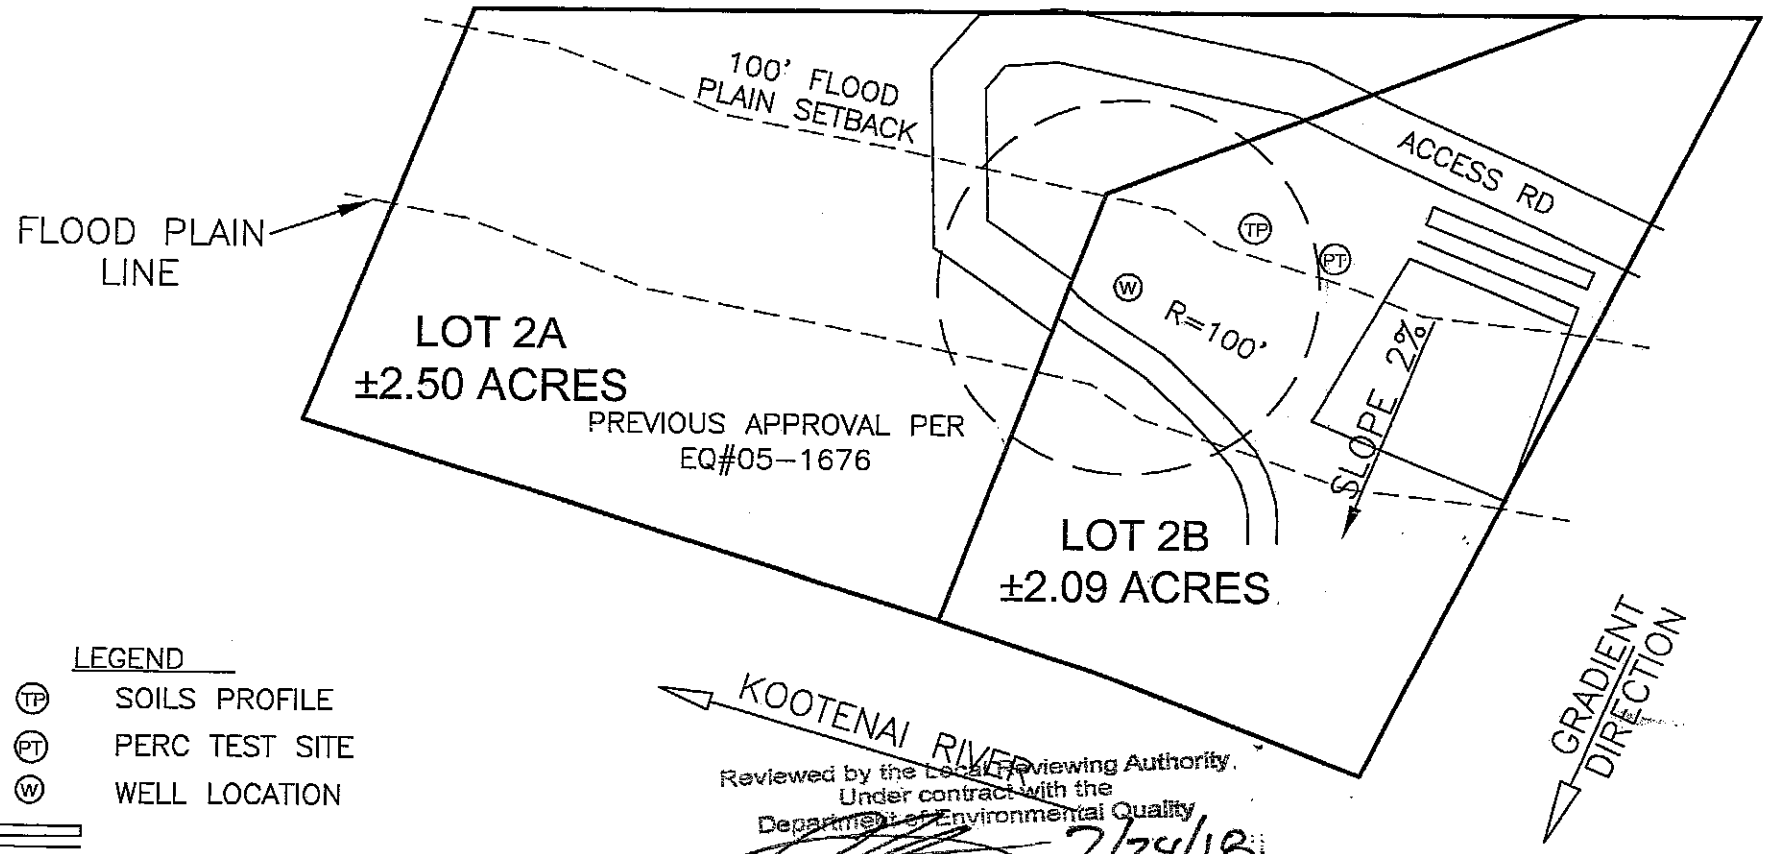

LEGEND

- TP — SOILS PROFILE
- PT — PERC TEST SITE
- W — WELL LOCATION
- DRAINFIELD, REPLACEMENT AREA, AND MIXING ZONE

Reviewed by the Local Reviewing Authority.
Under contract with the
Department of Environmental Quality

Local Reviewer — Date 7/24/18

Accepted under contract

DEQ Representative — Date

1" = 100'