LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/11/2018 Expiration Date: 10/11/2019

Property Owner: Andy Clary c/o: Charles Follensbee

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Charles Follensbee License No. 96

__xx__ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' pressure dosed laterals using gravelless chambers in 3' wide trenches.

Parcel Description:

Legal: S27 & 28 T36 R26

Address or Location: Glen Lake Hills Lot 29

Geo/Assessors code: 0000054741

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 252 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

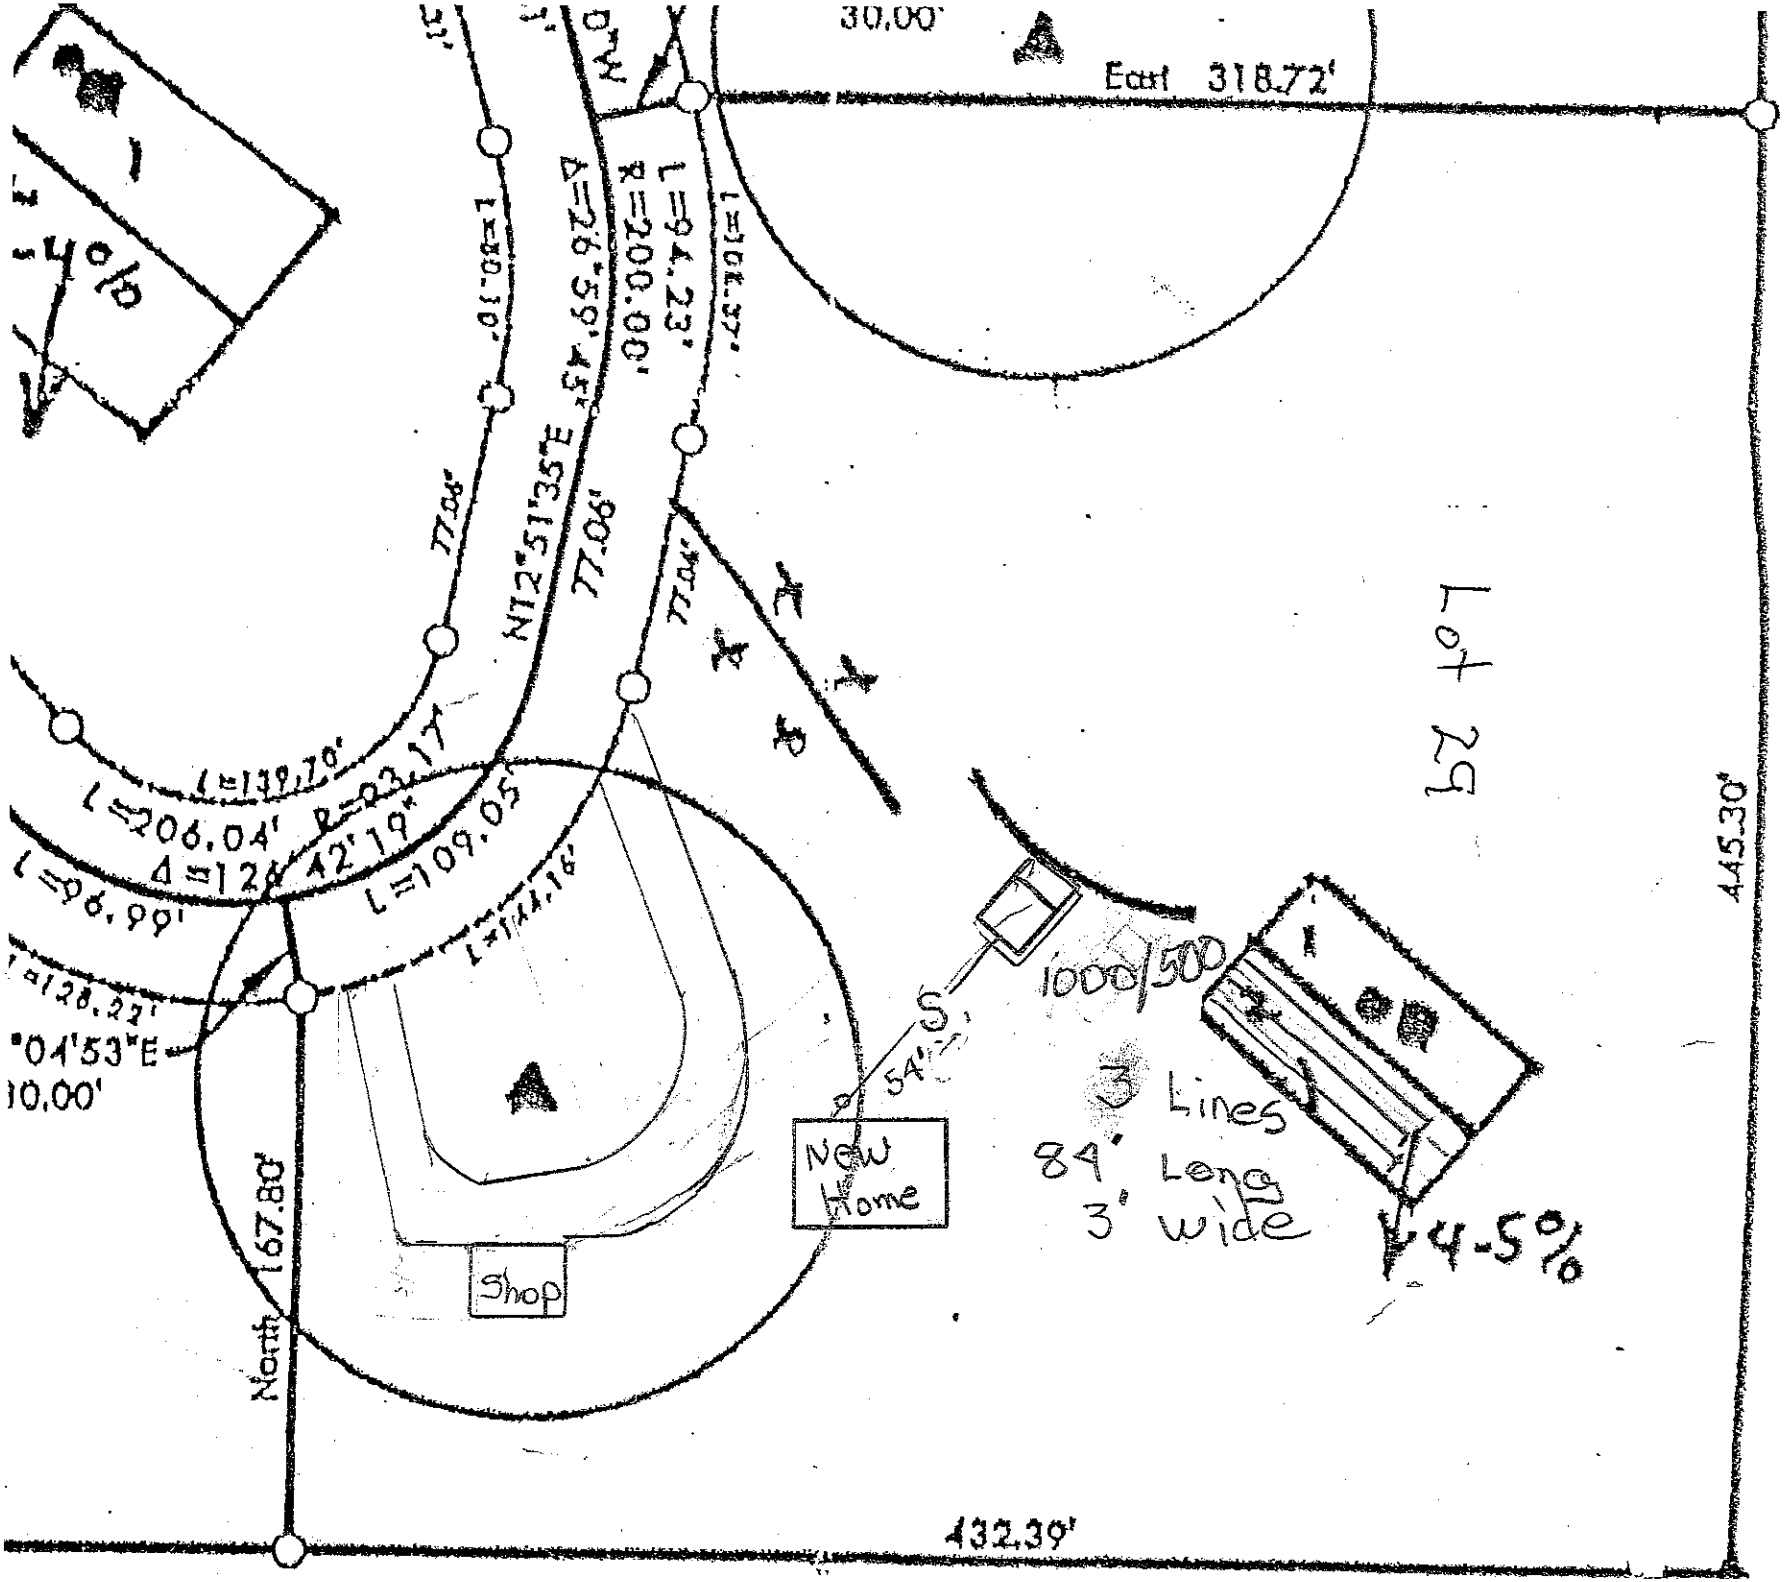
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


30.00'
East 318.72'
Lot 29
445.30'
77.08'
N12°51'35"E
L=94.23'
R=200.00'
Δ=26°59'45"
L=109.05'
L=144.16'
L=139.70'
L=206.04'
R=93.17'
Δ=126°42'19"
L=96.99'
L=128.22'
"01'53"E
10.00'
167.80'
North
432.39'
Shop
NEW Home
1000/500
S 54°
3 Lines
84' Long
3' wide
4-5%
40%