LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 1/10/2019 Nikki Ramirez Expiration Date: 1/10/2020

Property Owner: Jeanette Cummings c/o: Enviro-Tech

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: License No.

___ New Installation __xx__ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Six 84' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S08 T33 R33

Address or Location: COS 863 Parcel E or Tract 2E

Geo/Assessors code: 0000009942

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500 gallons Drainfield Size: 500 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Dustin Welch, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 5-12-20

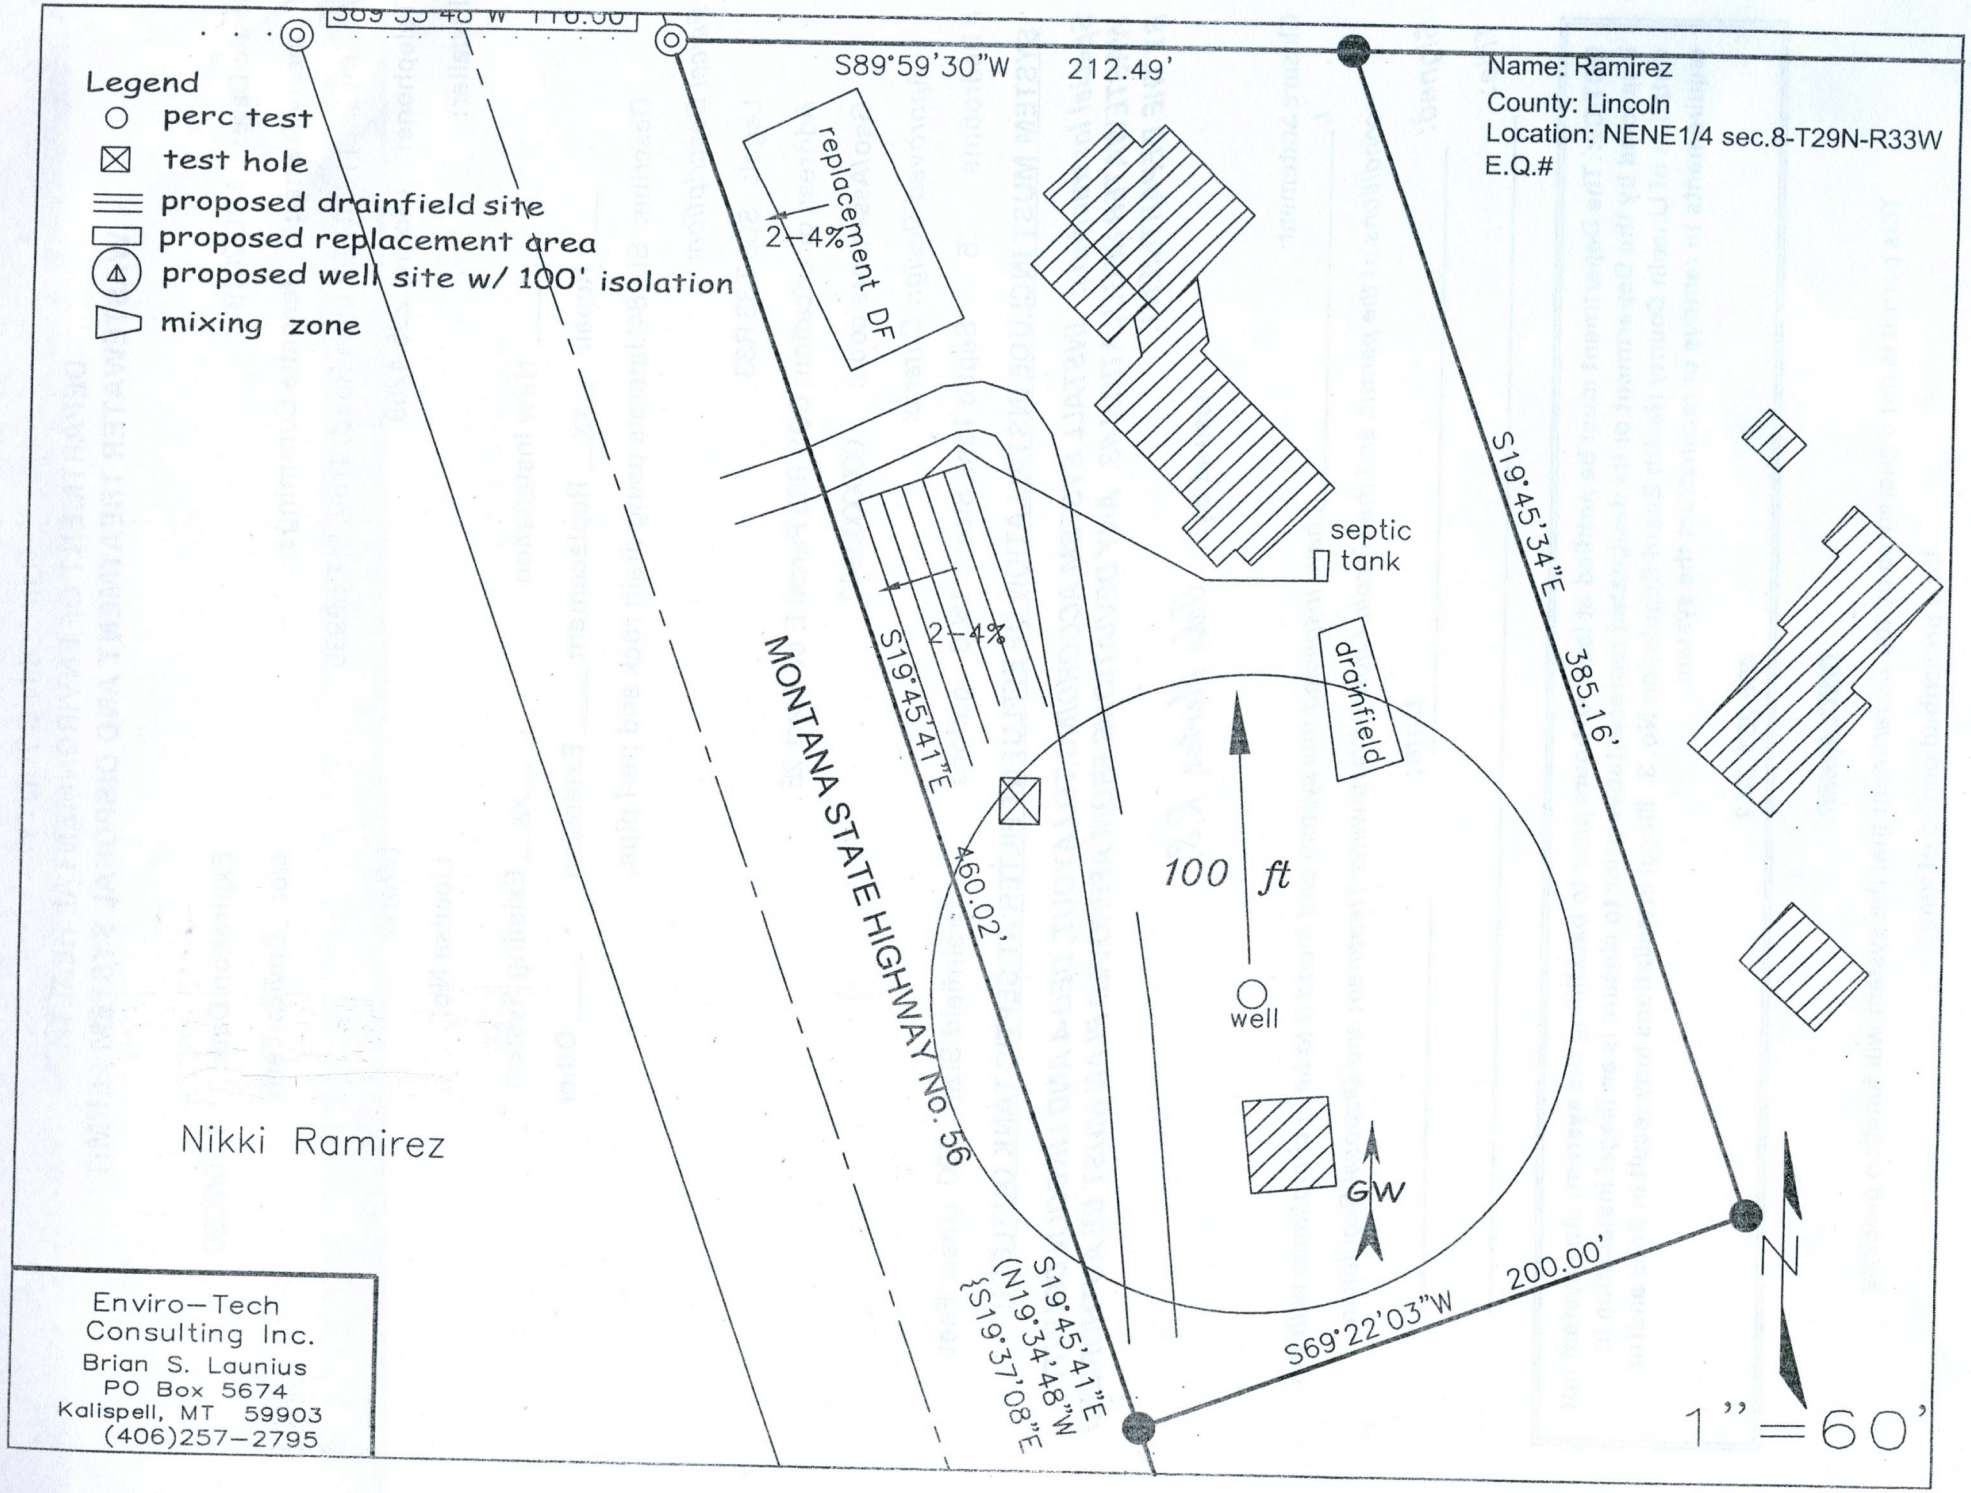
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function


Legend
perc test
test hole
proposed drainfield site
proposed replacement area
proposed well site w/ 100' isolation
mixing zone
S89°59'30"W 212.49'
Name: Ramirez
County: Lincoln
Location: NENE1/4 sec.8-T29N-R33W
E.Q.#
replacement DF
2-4%
septic tank
drainfield
S19°45'34"E 385.16'
S19°45'41"E 460.02'
MONTANA STATE HIGHWAY No. 56
100 ft
well
GW
S19°45'41"E
(N19°34'48"W
{S19°37'08"E
S69°22'03"W 200.00'
N
1" = 60'
Nikki Ramirez
Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795