LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/14/2019 Expiration Date: 5/14/2020

Property Owner: Roger Day c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating, LLC License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 85' pressure dosed laterals in 3' wide trenches.

Parcel Description:

Legal: S10 T35 R26

Address or Location: COS B289 P848

Geo/Assessors code: 0000014251

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 250 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Buck Schermerhorn have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Buck Schermerhorn Date: 6/18/19


Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

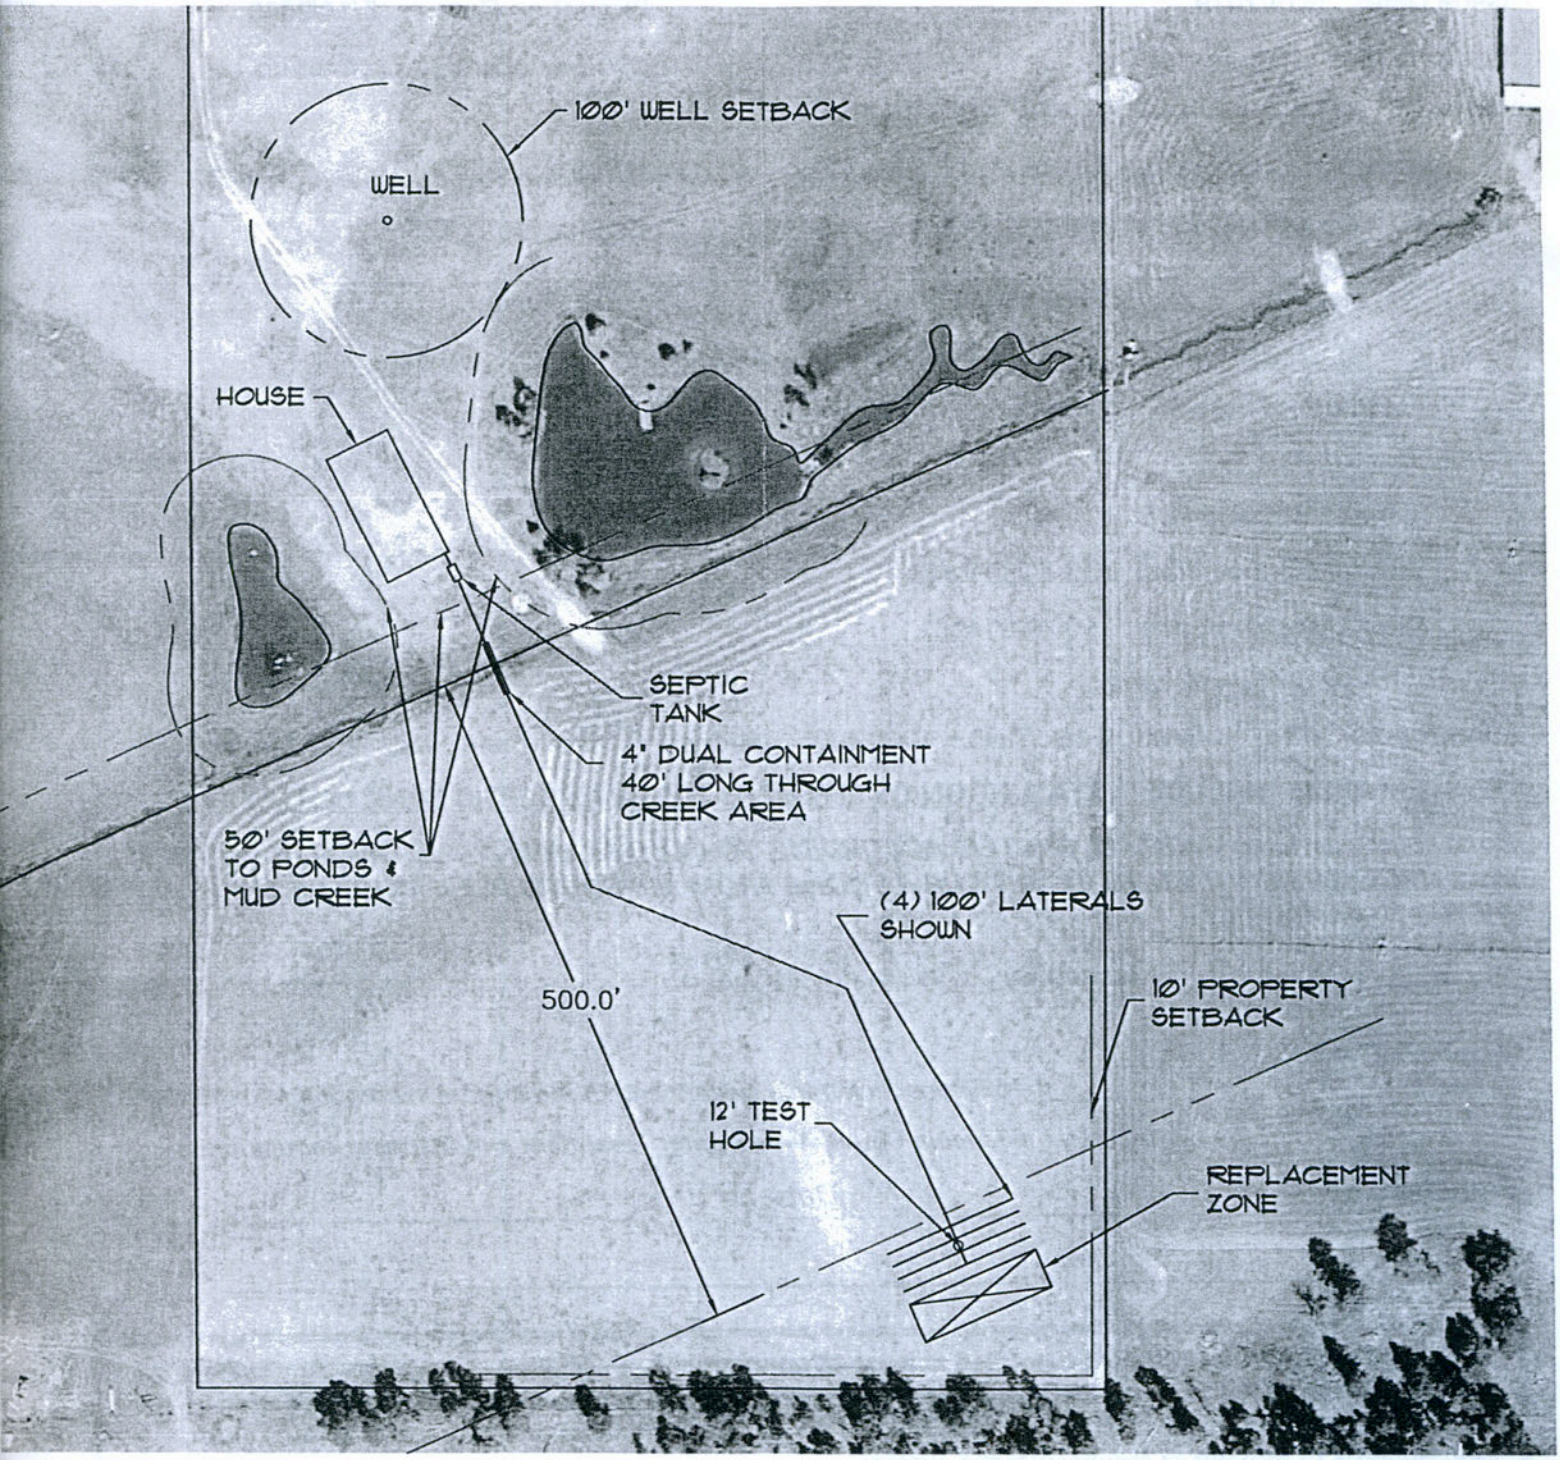

ROGER DAY SITE LAYOUT

THIS DRAWING IS PROPERTY OF KEI UN
HAS BEEN SECURED BETWEEN OWNER
IT CAN NOT BE SUBMITTED TO ANY OTH
WITHOUT WRITTEN APPROVAL FROM KEI