LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/14/2019 Expiration Date: 5/14/2020

Property Owner: Jared Dehaven c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Chuck Riley License No. 147

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S24 T27 R28

Address or Location: Crystal Lake Area View Lots, Lot 1

Geo/Assessors code: 0000018470

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 130 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Charles J Riley *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Charles J Riley *Date:* 5-24-19

Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Name: Mofified Site plan for
LOT 1 of Bertelsen Crystal Lake
Area View lots
ES#27-93-S43-1078
County: Lincoln
Location: sec.-24T27N-R28W
E.Q.#

Legend

- test hole
- proposed drainfield site
- proposed replacement area
- existing well site w/ 100' isolation zone
- mixing zone

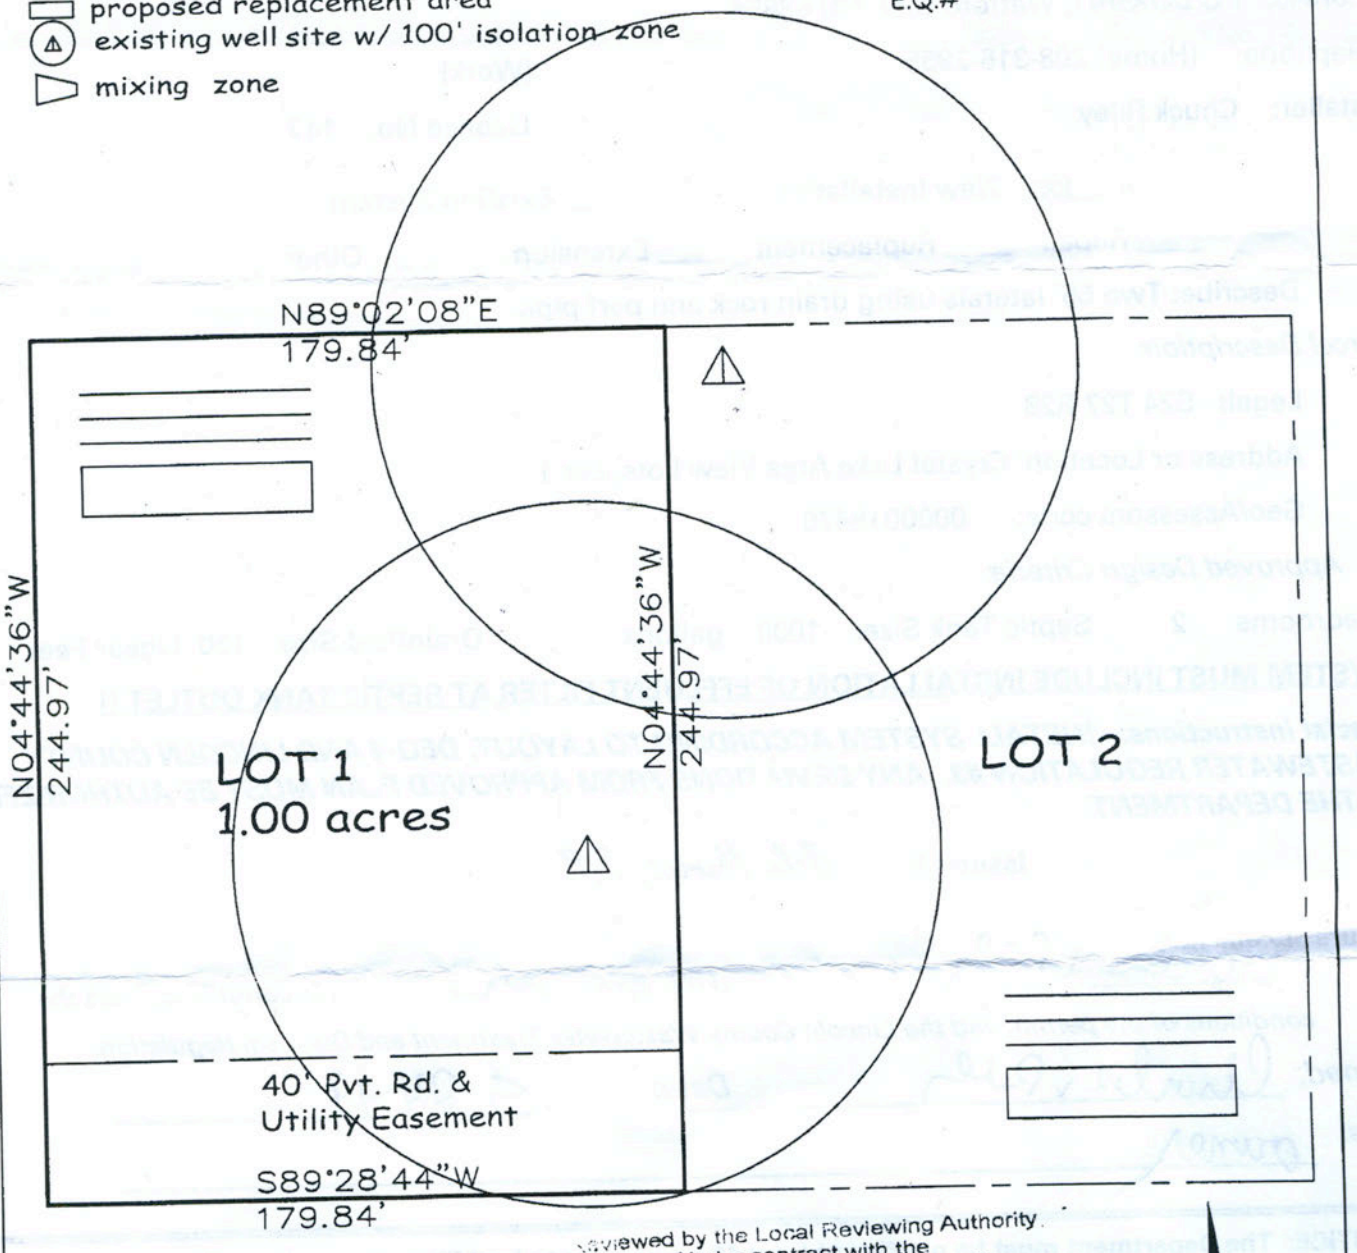

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Local Reviewer — Date 5/13/19

Accepted under contract

DEQ Representative — Date

Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795