LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2019 Expiration Date: 8/21/2020

Property Owner: Thomas Ditchey c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: DJ Welch License No. 155

xx New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 80' laterals using gravelless chambers for house and cabin.

Parcel Description:

Legal: S20 T29 R33

Address or Location: 335 Dorr Skeels Road

Geo/Assessors code: 0000005876

Approved Design Criteria:

Bedrooms 3/2 Septic Tank Size: 1500 gallons Drainfield Size: 440 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

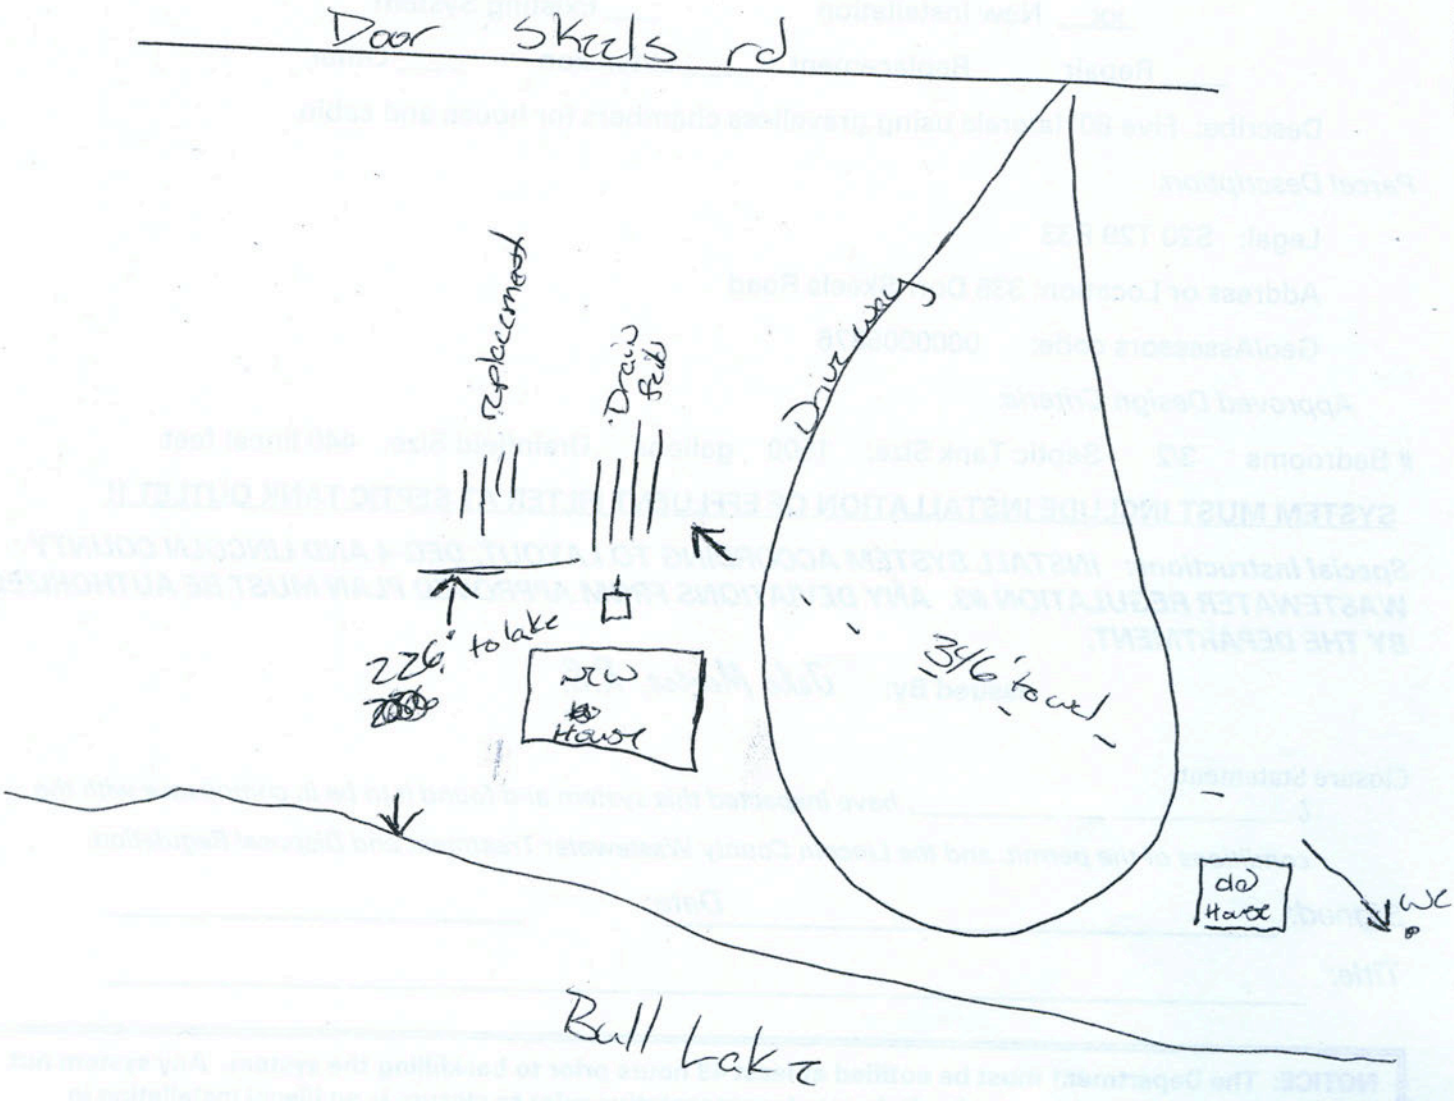
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Door Skeels rd
replacement
Drain field
Driveway
226' to lake
NEW House
134' to road
old House
WC
Bull Lake