LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 1/8/2019 Expiration Date: 1/8/2020

Property Owner: Robert Dunlap c/o: Barb Renkema

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 94' pressure dosed laterals in 3' wide trenches.

Parcel Description:

Legal: S36 T35 R26

Address or Location: COS 3694/4167 Parcel 1

Geo/Assessors code: 0000014332

Approved Design Criteria:

Bedrooms 6 Septic Tank Size: 2000/500 gallons Drainfield Size: 375 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, BUCK SCHERMERHORN *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 6/18/19


Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

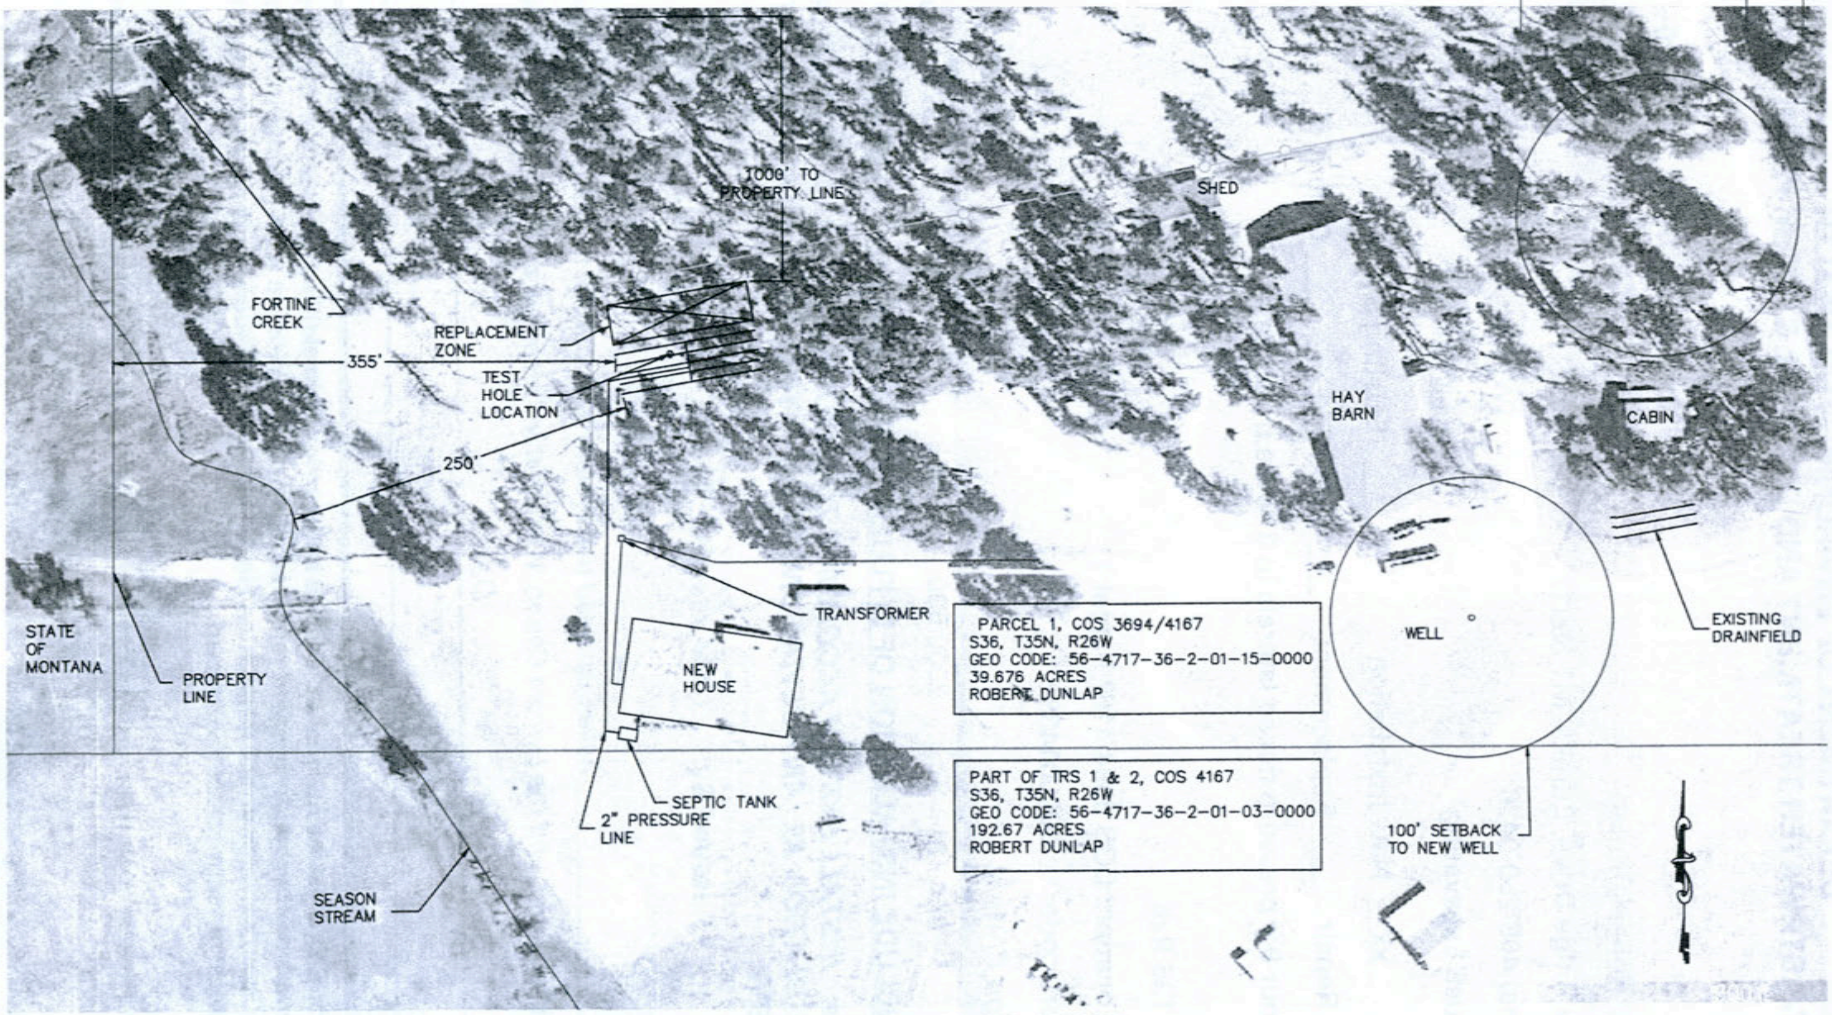

DUNLAP RANCH NEW SEPTIC LAYOUT

REV	DESCRIPTION	BY/DATE	APPR/DATE

COMPANY: MDS	SCALE: 1/16 & NOTED	DUNLAP HAY RANCH NEW SEPTIC SYSTEM LAYOUT	
CONTRACT: MDS02918	DATE: 9/1/18	CONCEPT LOT LAYOUT	12/3/18
PLOT FILE: PWL-0001	WEIGHT: —	DRAWN BY: G. CLOUSE	12/XX/18
		DWG NO: 441-001	REV NO: 1

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SIGNED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT