LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2019 Expiration Date: 8/21/2020

Property Owner: William Edinger c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Rupert Schreiner License No. 19

xx New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Four 94' trenches using drain rock and perf pipe.

Parcel Description:

Legal: S33 T34 R26

Address or Location: COS 3347 Parcel B

Geo/Assessors code: 0000001616

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 375 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Rupert Schreiner *Date:* 9-19-19

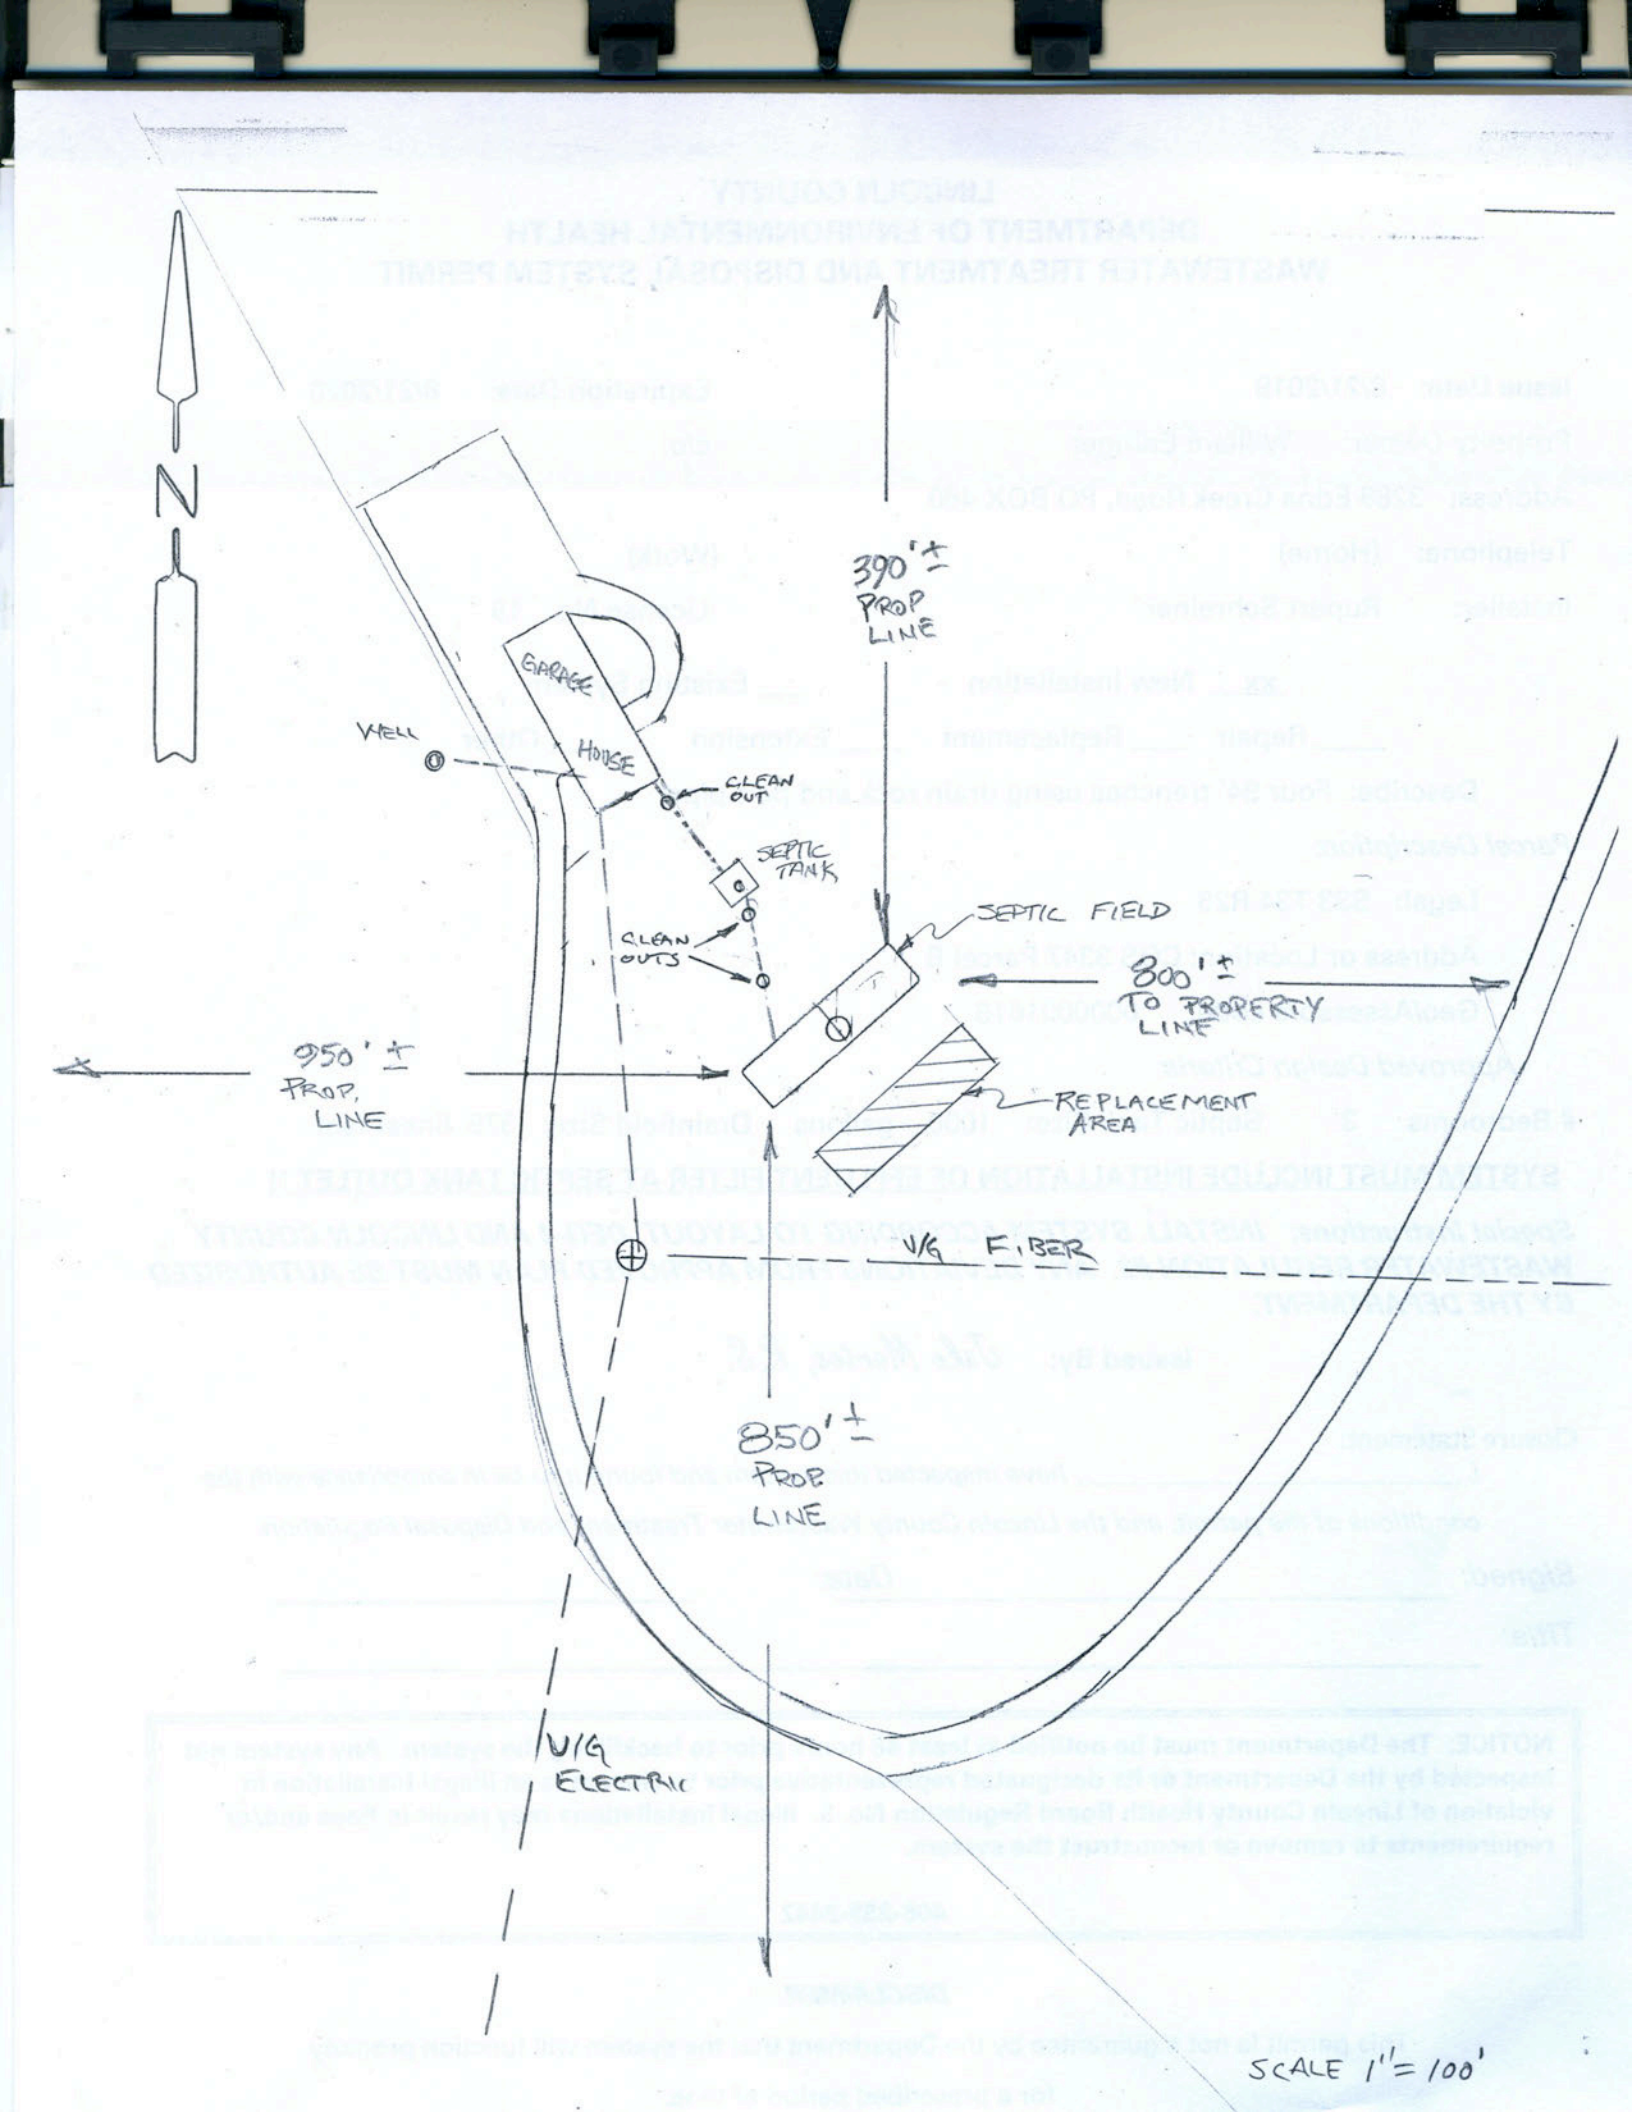
Title: Lic # 19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
390' ± PROP LINE
GARAGE
HOUSE
WELL
CLEAN OUT
SEPTIC TANK
CLEAN OUTS
SEPTIC FIELD
800' ± TO PROPERTY LINE
950' ± PROP. LINE
REPLACEMENT AREA
U/G FIBER
850' ± PROP LINE
U/G ELECTRIC
SCALE 1" = 100'