LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/22/2019 Expiration Date: 4/22/2020

Property Owner: Robert Edmundson c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tom Cole License No. 1

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 60' JTM laterals using ~~drain rock and perf pipe.~~ ARMTECS CHAMBERS JTM

Parcel Description:

Legal: S19 T31 R33

Address or Location: Wilderness Plateau Block 3 Lot 25

Geo/Assessors code: 0000011123

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 195 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 10-17-19

Title: owner operator


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

# SITE PLAN
SCALE = 1" = 20'

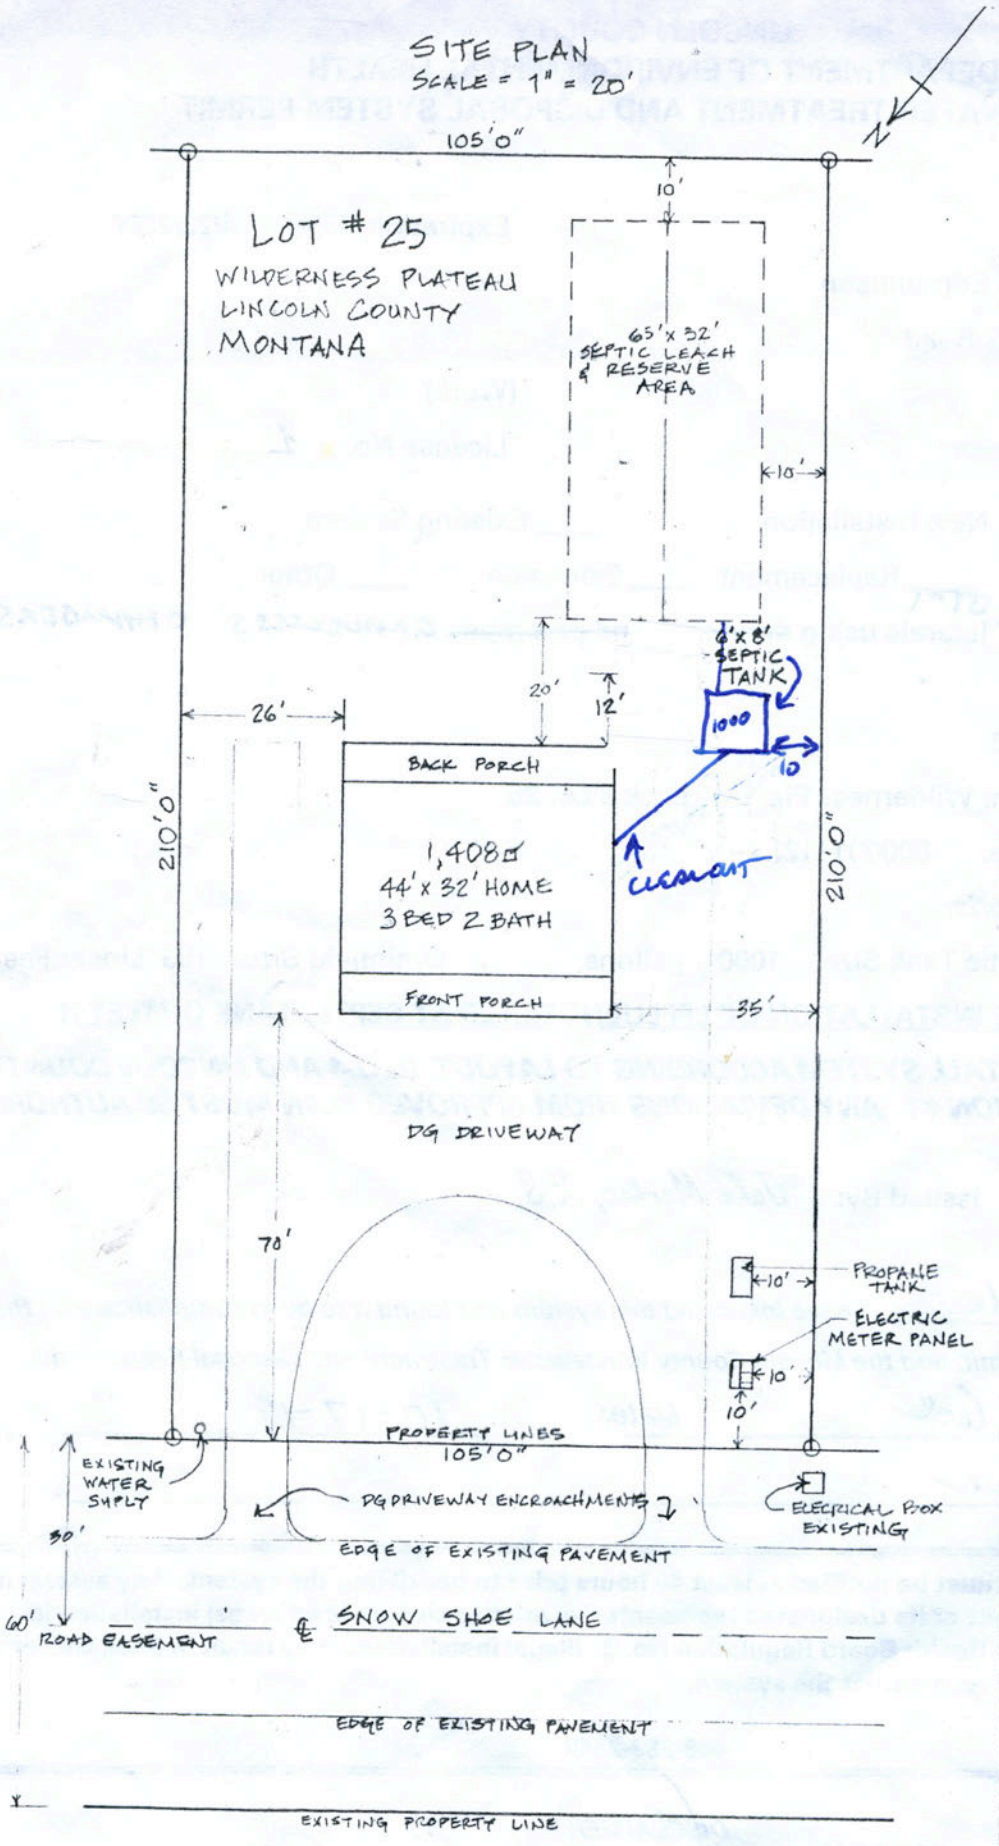

OWNER: ROBERT & BONNIE EDMUNDSON
PHONE: (760) 420-1310 E-MAIL: realtorrobert46@gmail.com