LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2019 Expiration Date: 8/21/2020

Property Owner: Christopher Foster c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Self K+D Hayes Dirt Work License No. 144

xx New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Three 85' pressure dosed laterals in 3' wide trenches.

Parcel Description:

Legal: S21 T36 R27

Address or Location: COS 4093 Parcel B

Geo/Assessors code: 0000014860

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 255 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, M Kent Hayes, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: M. Kent Hayes *Date:* 12-22-2019

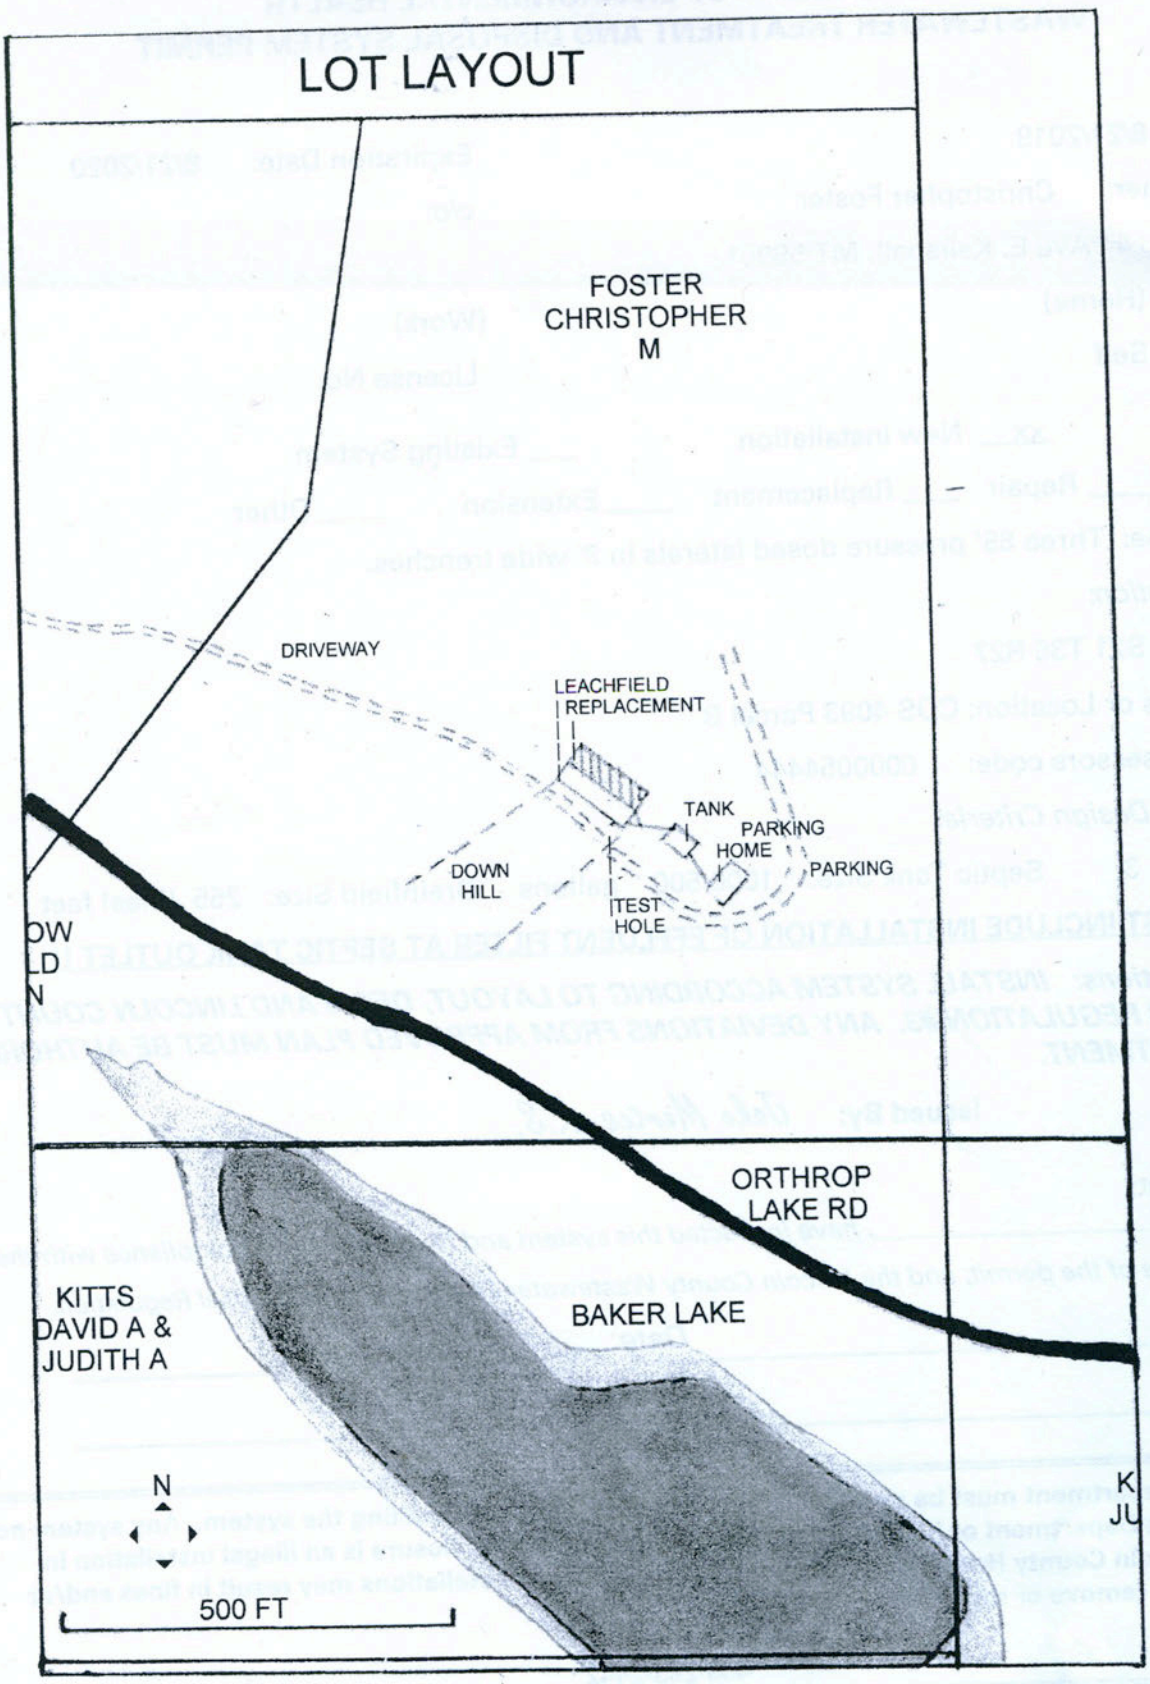
Title: Owner Operator K+D Hayes Dirt Work

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time


LOT LAYOUT
FOSTER
CHRISTOPHER
M
DRIVEWAY
LEACHFIELD
REPLACEMENT
TANK
PARKING
HOME
PARKING
DOWN
HILL
TEST
HOLE
ORTHROP
LAKE RD
KITTS
DAVID A &
JUDITH A
BAKER LAKE
N
500 FT