County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/28/2018 Expiration Date: 8/28/2019

Property Owner: Benjamin Girod c/o: Tom Cole

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

__xx__ New Installation ___ Existing System

___ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 100' laterals using gravelless chambers. Size reduced per 0.4 app rate.

Parcel Description:

Legal: S18 T29 R30

Address or Location: Airport Way Lot 3

Geo/Assessors code: 0000056195

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 400 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 8-31-18

Title: owner/operator

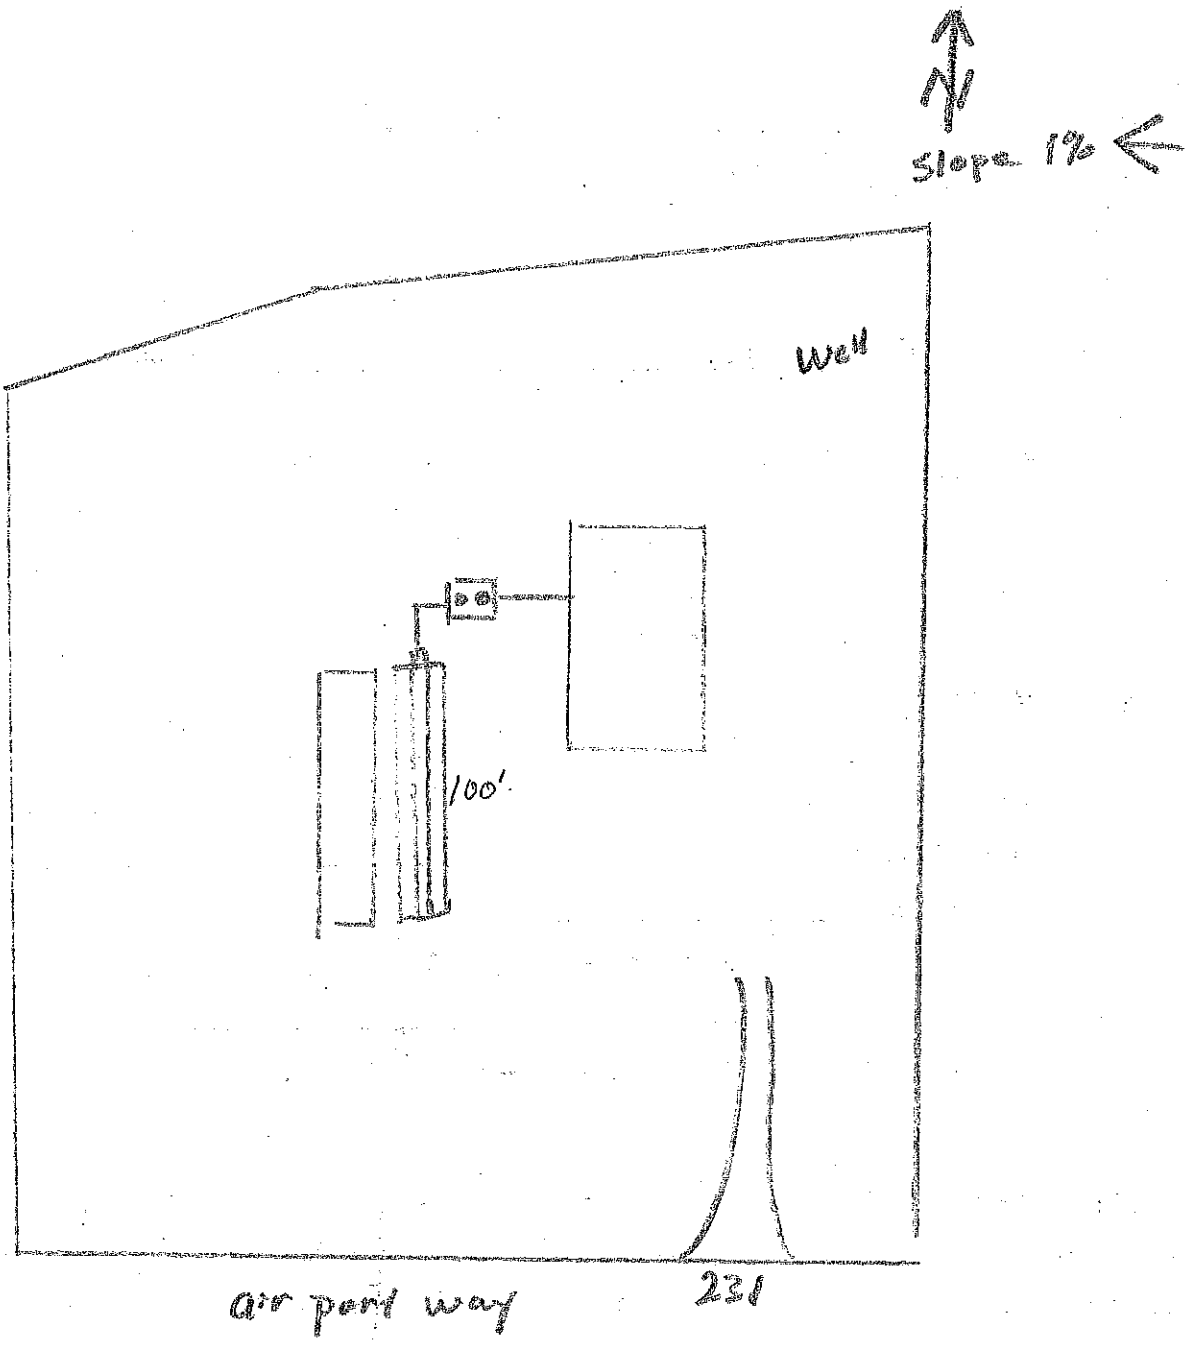
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

for a prescribed period of time


N
Slope 1%
well
100'
air port way
231