LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/14/2017 Expiration Date: 9/14/2018

Property Owner: Brad Gronley c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Shayne Nelson License No. 118

__xx__ New Installation ___ Existing System

____ Repair _____ Replacement ____ Extension ____ Other

Describe: Two 84' pressure dosed laterals in 3' wide trenches using gravelless chambers (0.4)

Parcel Description:

Legal: S13 T27 R28

Address or Location: The Pines at Fisher River Lot 16

Geo/Assessors code: 0000055042

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 169 linear feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 5/25/18 SHAYNE NELSON

Title: President owner


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
6/28/07

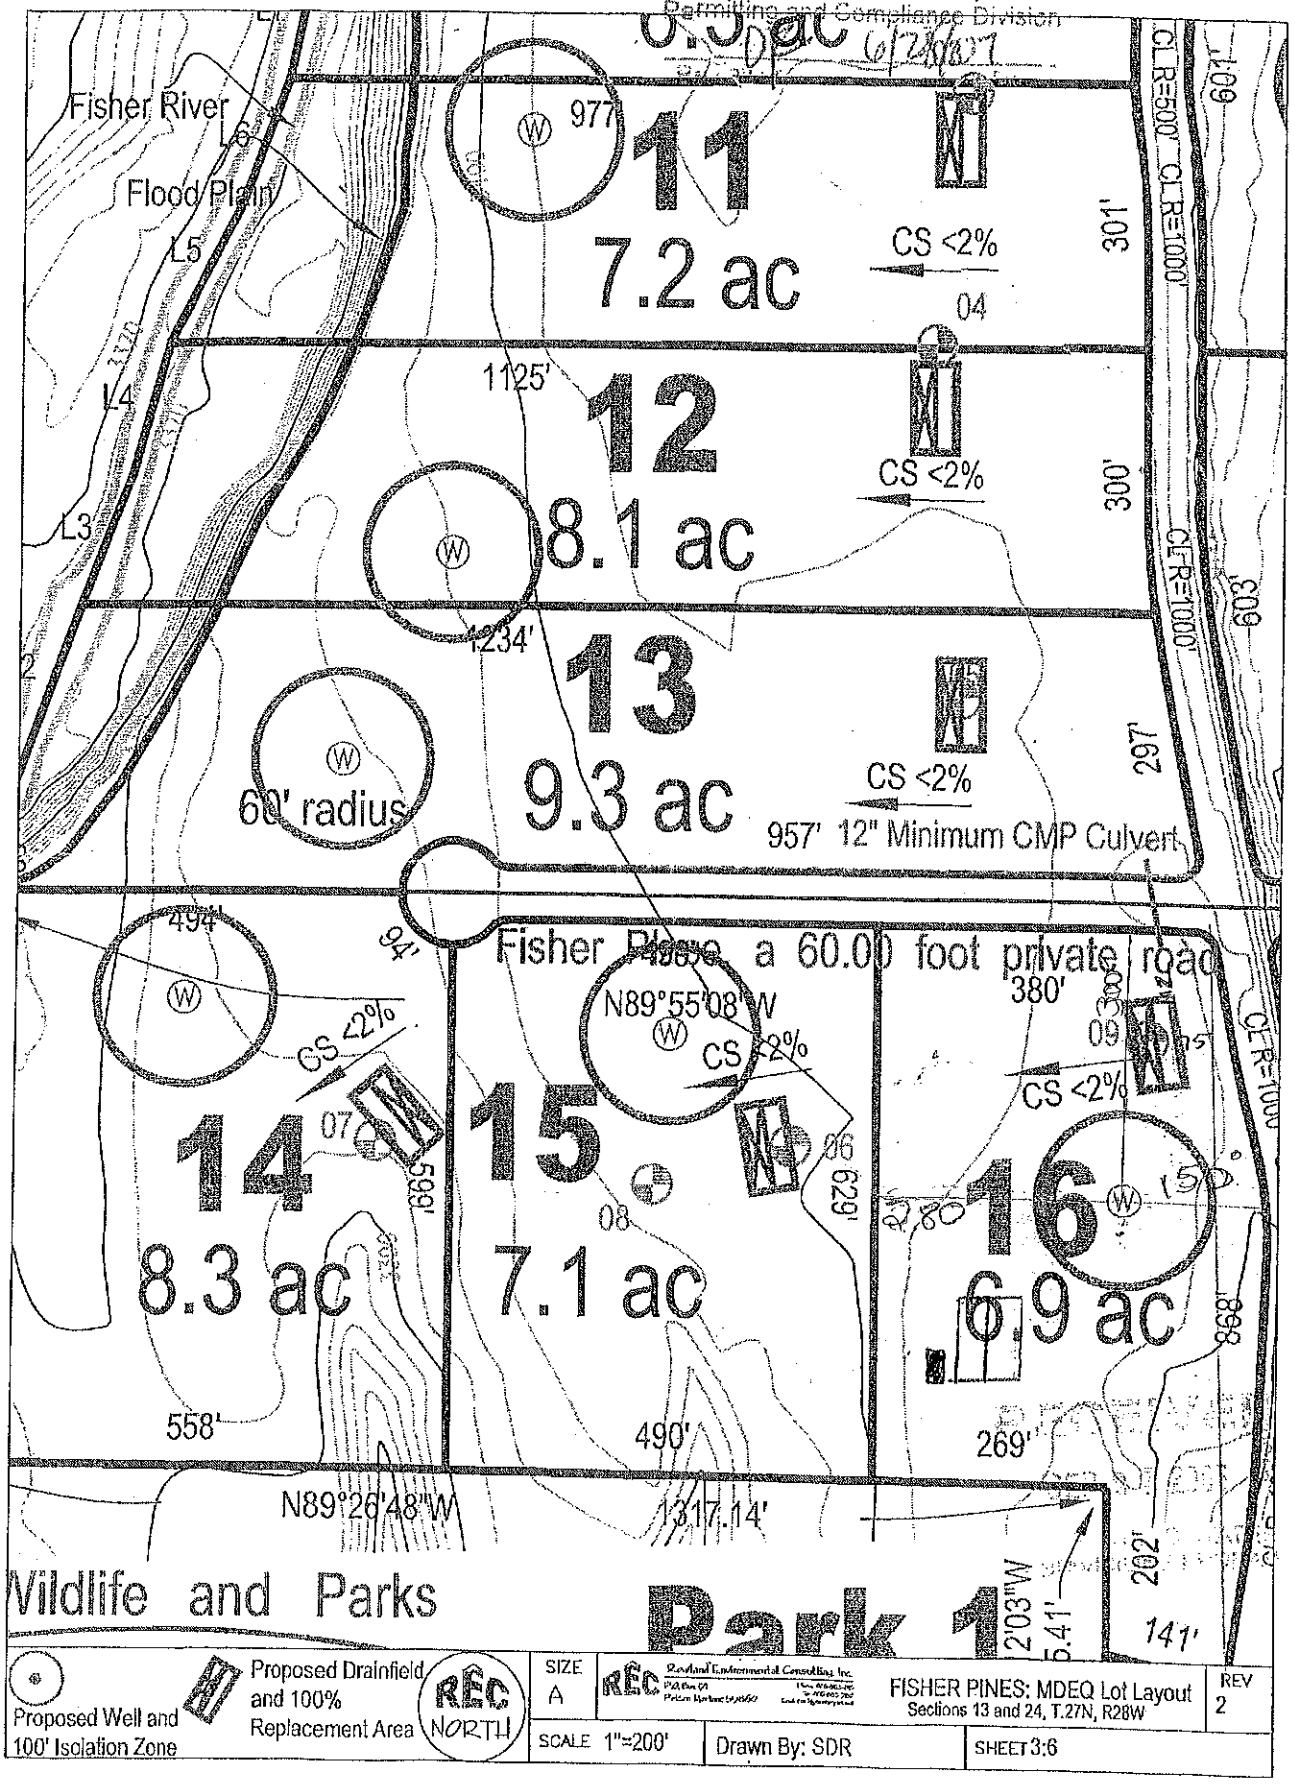

112' 9/14 4/13