LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/26/2016 Expiration Date: 7/26/2017

Property Owner: Nick Grotjohn c/o: Terry Oedewaldt

Address: 494 Taylor Road, Libby, MT 59923

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

____ New Installation ___xx_ Existing System

__xx__ Repair ____ Replacement ____ Extension ____ Other

Describe: Adding a 50' x 10' absorption bed to existing drywells

Parcel Description:

Legal: S9 T30 R31

Address or Location: 494 Taylor Road

Geo/Assessors code: 0000002570

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: ~~50~~ 45 x 10 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 8/2/16


Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

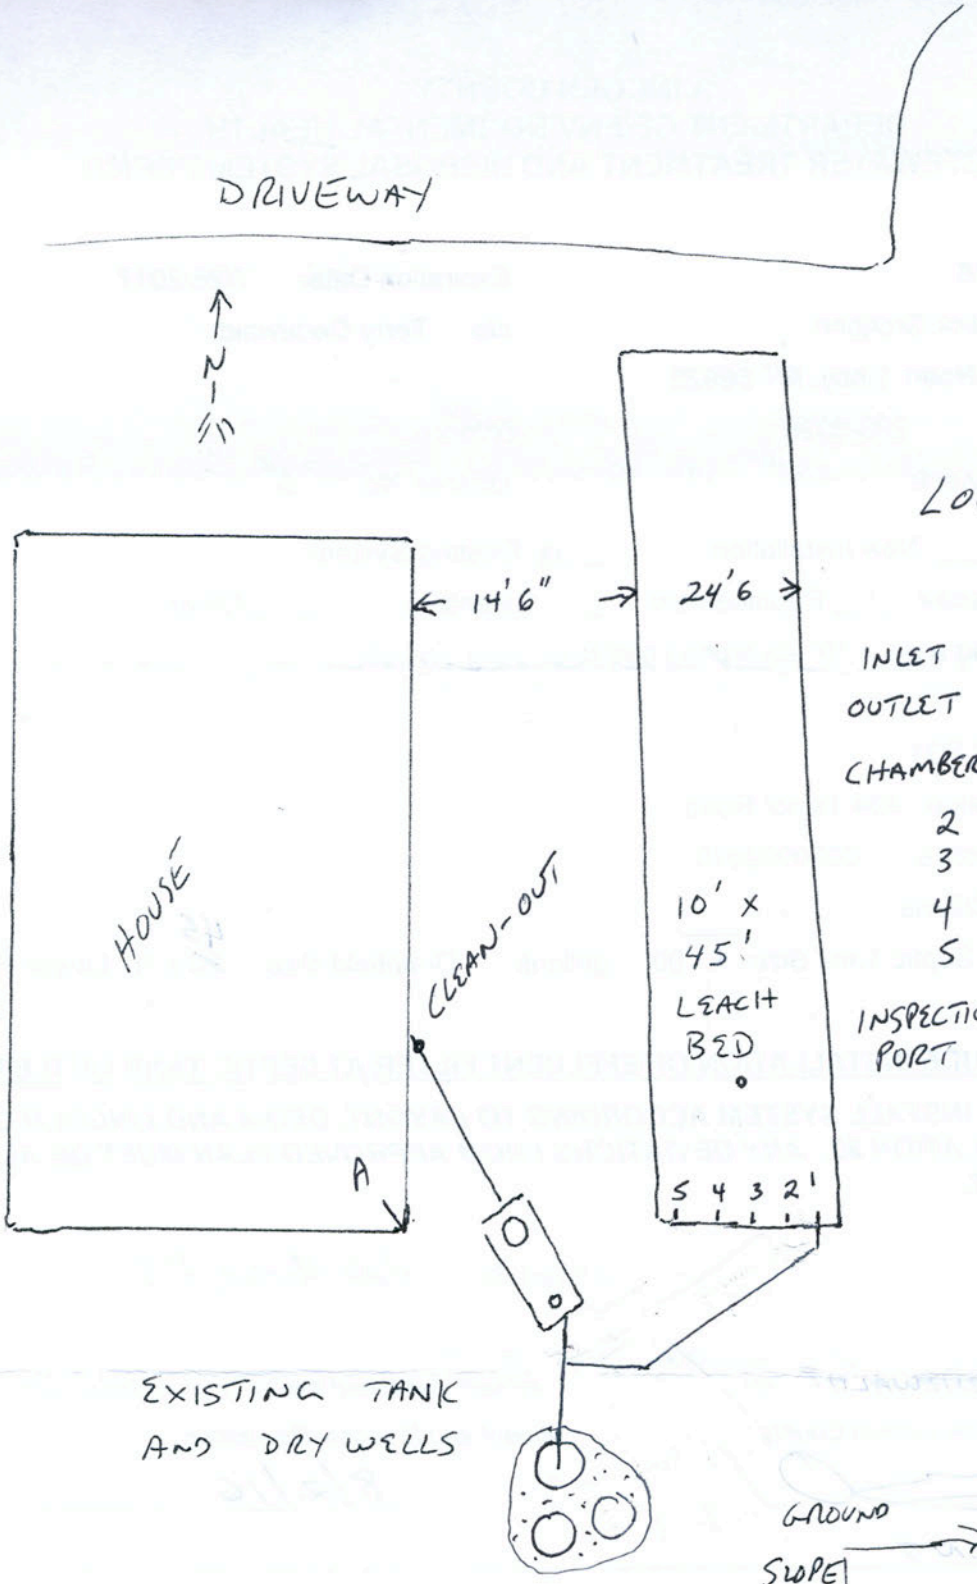

LOCATIONS:

	A	CLEAN/OUT
INLET	8'2	16'
OUTLET	10'8	23'
CHAMBER 1	26'8	23'4
2	24'9	21'6
3	23'	19'9
4	21'2	18'3
5	19'7	16'7
INSPECTION PORT	29'6	18'10

○ WELL