LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/30/2019 Expiration Date: 5/30/2020

Property Owner: Chris Hawthorne c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tony Berget License No. 26

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 54' laterals using gravelless chambers.

Parcel Description:

Legal: S35 T32 R34

Address or Location: Cedar Glenn estates Phase 2 Lot 10

Geo/Assessors code: 0000013753

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 108 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Legend

- ○ perc test
- □ test hole
- ≡ proposed drainfield site
- ▭ proposed replacement area
- ⚠ proposed well site w/ 100' isolation zone
- ▱ mixing zone

Name: Re-write of LOT 10 of Cedar Glen Phase II-
No.27-94-L1-36-213K
owner- Hawthorne
County: Lincoln
Location: SESE¼
sec.35-T32N-R34W
E.Q.# 19-1395

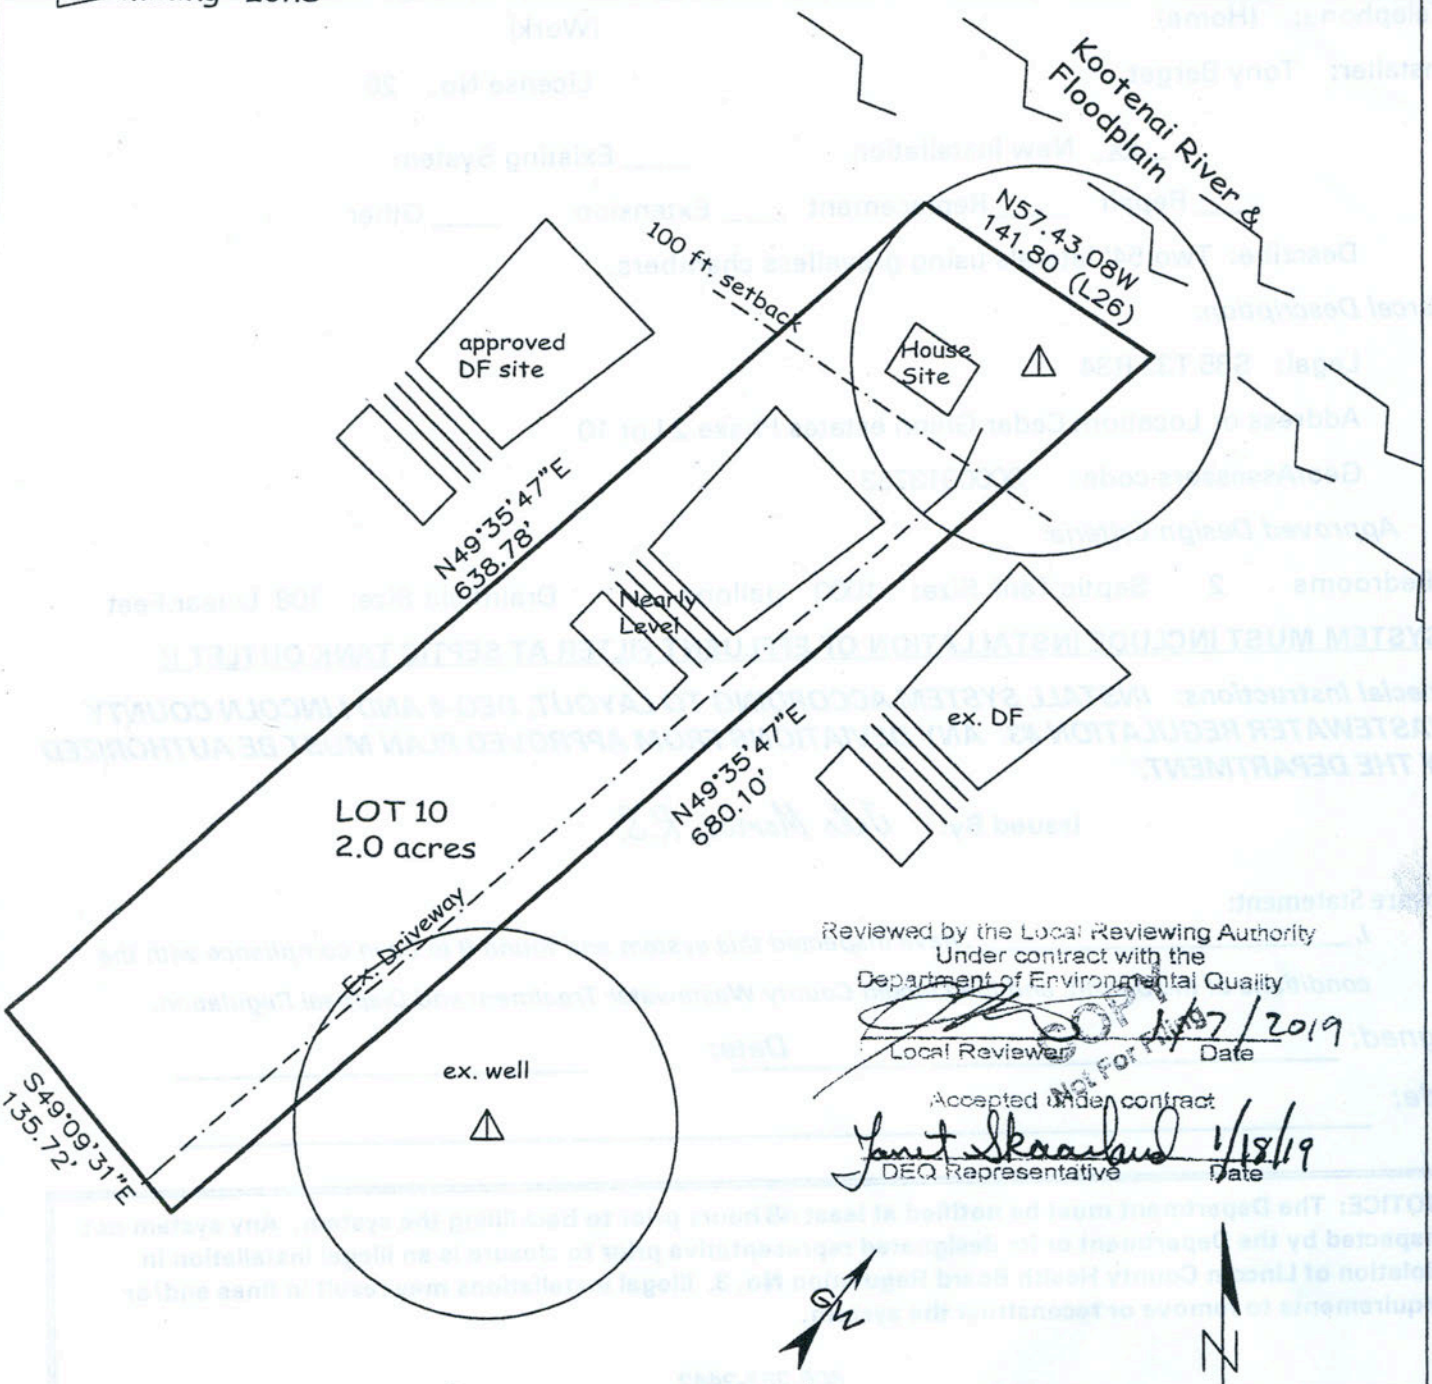

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Local Reviewer — Date 1/17/2019

Accepted under contract

Janet Skaarud 1/18/19
DEQ Representative — Date

RECEIVED

JAN 10 2019

MT DEQ PUBLIC WATER
& SUBDIVISIONS

1" = 100'

Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795