LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/09/2025 Expiration Date: 09/08/2026 Permit#25-54841

Property Owner: William Husted

Mailing Address: [redacted]

Installer: Cory Clasen License #: 181

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: JENNINGS, S26, T36 N, R28 W, LOT 002, ACRES 2.73, PM 6705

Property Address: 501 Kootenai Echo Trl., Rexford, MT 59930 Assessment Code: 54841

DEQ COSA: E.Q.# 05-1483 Jennings RLL Lot 2 Date: 8/13/24

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 4 Laterals @ 84' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 4 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

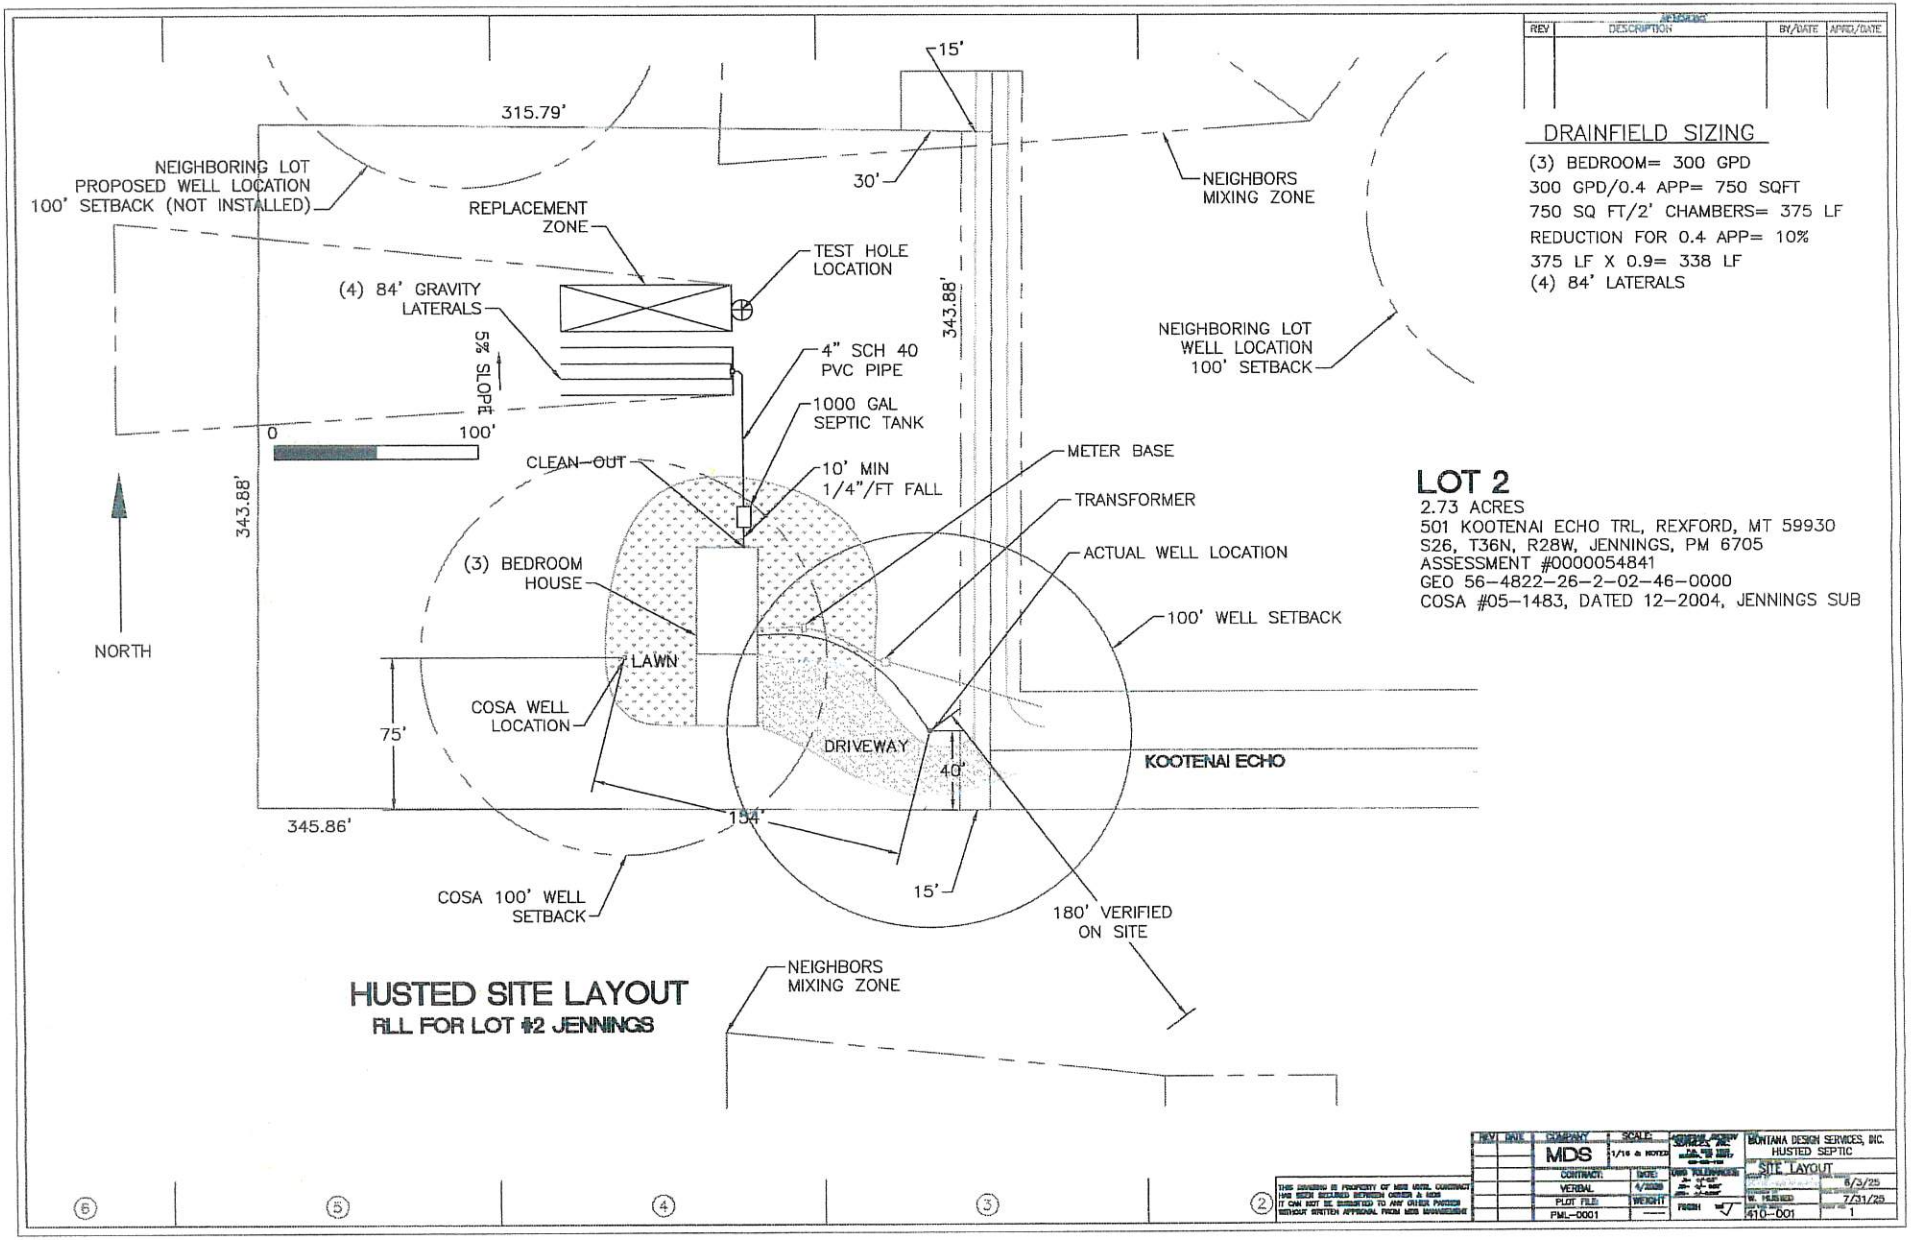

HUSTED SITE LAYOUT

RLL FOR LOT #2 JENNINGS

REV	DESCRIPTION	BY/DATE	APPD/DATE

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.4 APP= 750 SQFT
750 SQ FT/2' CHAMBERS= 375 LF
REDUCTION FOR 0.4 APP= 10%
375 LF X 0.9= 338 LF
(4) 84' LATERALS

LOT 2

2.73 ACRES
501 KOOTENAI ECHO TRL, REXFORD, MT 59930
S26, T36N, R28W, JENNINGS, PM 6705
ASSESSMENT #0000054841
GEO 56-4822-26-2-02-46-0000
COSA #05-1483, DATED 12-2004, JENNINGS SUB

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT

REV	DATE	COMPANY	SCALE	MONTANA DESIGN SERVICES, INC.
		MDS	1/16 = 1'-0"	HUSTED SEPTIC
		CONTRACT	DWG	SITE LAYOUT
		VERBAL	4/2025	6/3/25
		PLOT FILE	WEIGHT	W. HUSTED 7/31/25
		PML-0001		410-001 1