LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/13/2019 Expiration Date: 5/13/2020

Property Owner: Mitch Kennedy c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Chuck Reily License No. 147

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 95' laterals using gravelless chambers.

Parcel Description:

Legal: S26 T30 R31

Address or Location: Throop Subdivision Lot 3

Geo/Assessors code: 0000050091

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 190 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

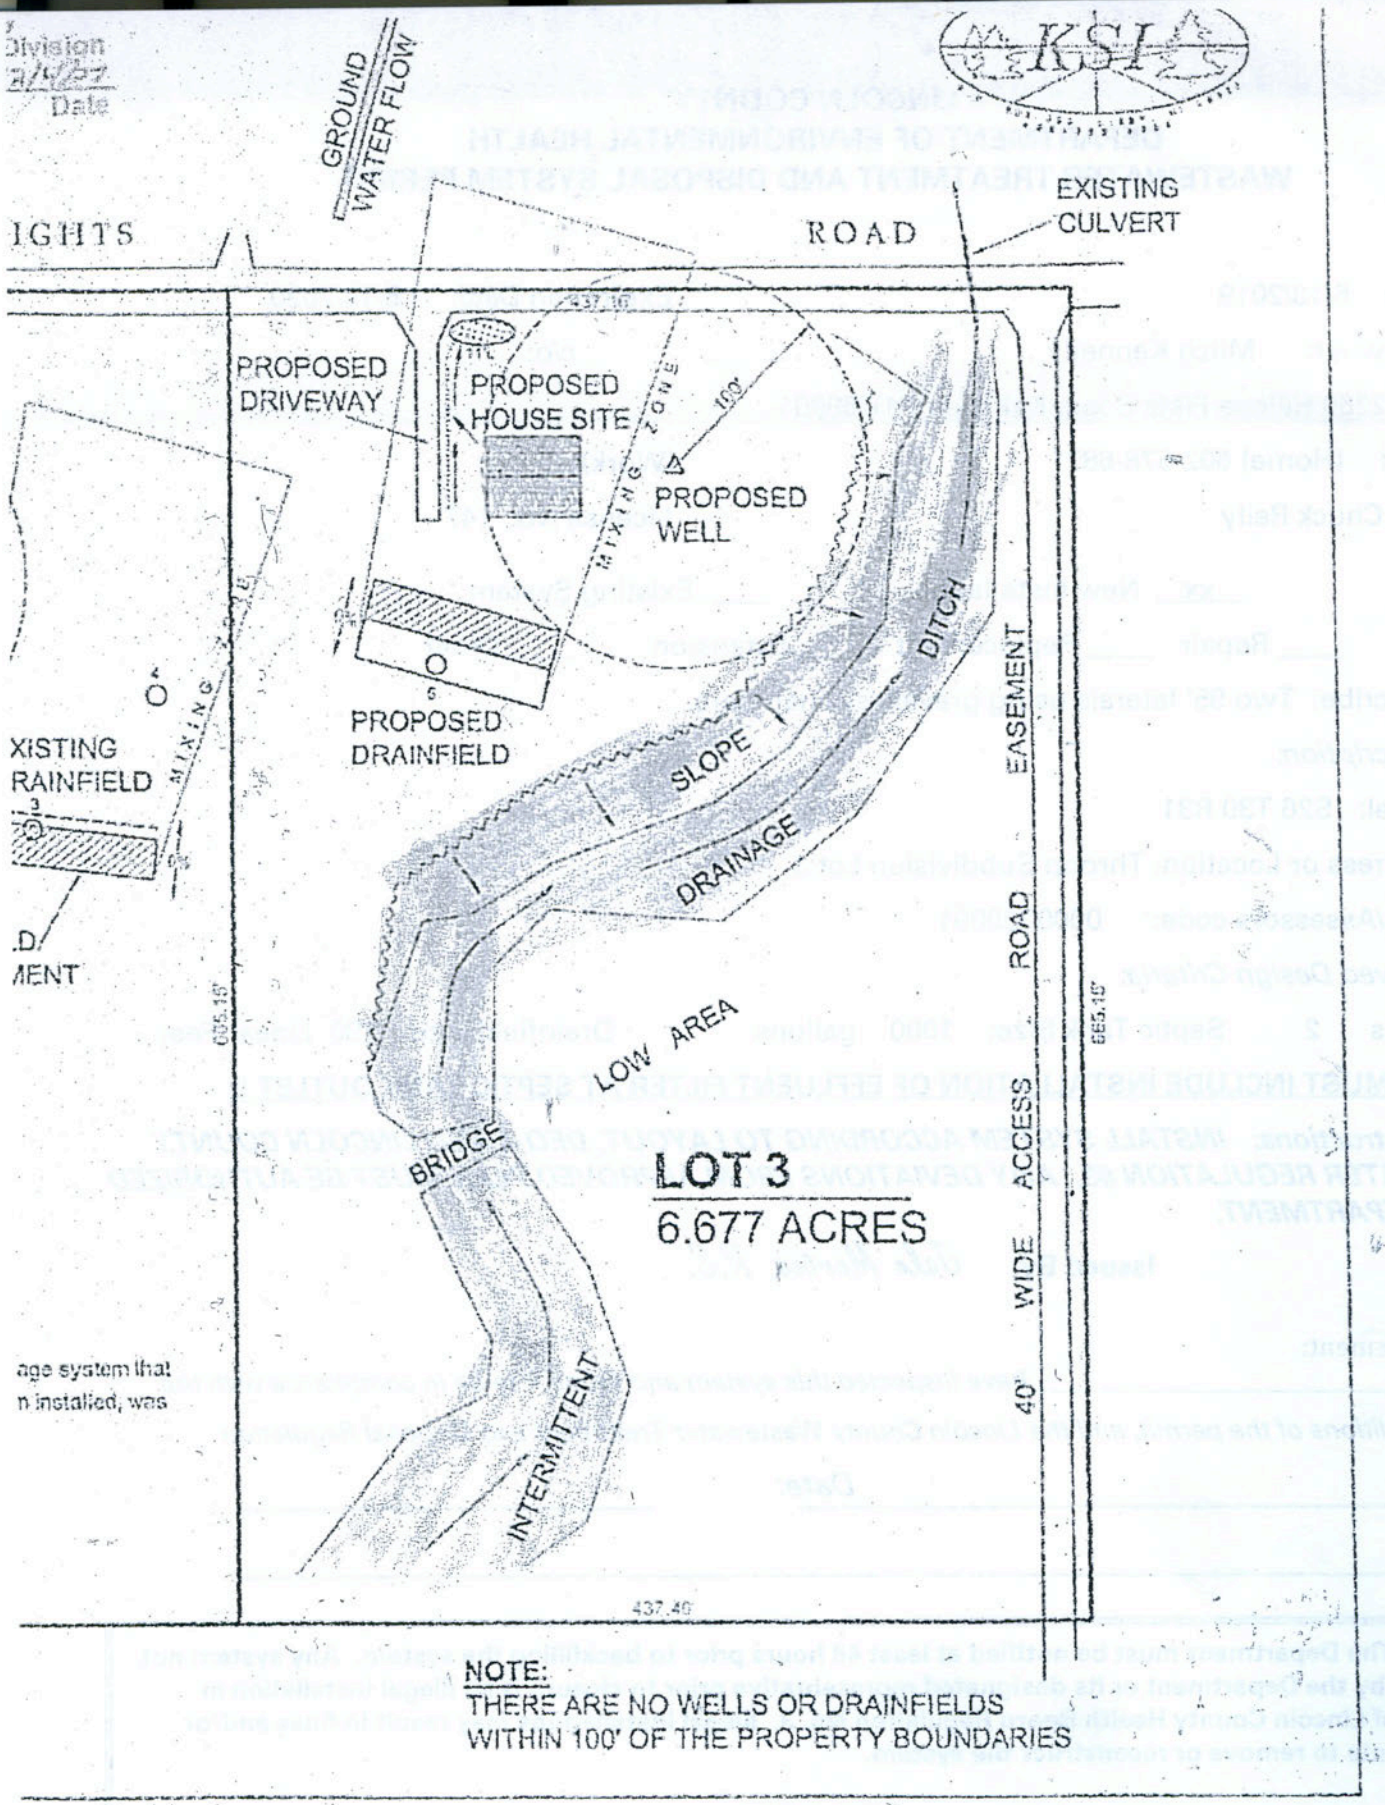
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Division
3/4/22
Date
GROUND WATER FLOW
KSI
IGHTS
ROAD
EXISTING CULVERT
437.16
PROPOSED DRIVEWAY
PROPOSED HOUSE SITE
MIXING ZONE
100'
PROPOSED WELL
DITCH
EASEMENT
PROPOSED DRAINFIELD
XISTING RAINFIELD
SLOPE
DRAINAGE
.D/
MENT
LOW AREA
BRIDGE
LOT 3
6.677 ACRES
ROAD
WIDE ACCESS
40'
INTERMITTENT
665.15'
437.46
age system that
n installed, was
NOTE:
THERE ARE NO WELLS OR DRAINFIELDS
WITHIN 100' OF THE PROPERTY BOUNDARIES