LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/12/2019 Expiration Date: 7/12/2020

Property Owner: Mark Kresge c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Darwin Pluid License No. 164

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 84' pressure dose laterals in 3' wide trenches using gravelless chambers.

Parcel Description:

Legal: S27 T36 R26

Address or Location: Glen Lake Hills Lot 4

Geo/Assessors code: 0000054698

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500/500 gallons Drainfield Size: 336 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Darwin Pluid, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Darwin Pluid *Date:* 9/18/19

Title: Earth Works Owner

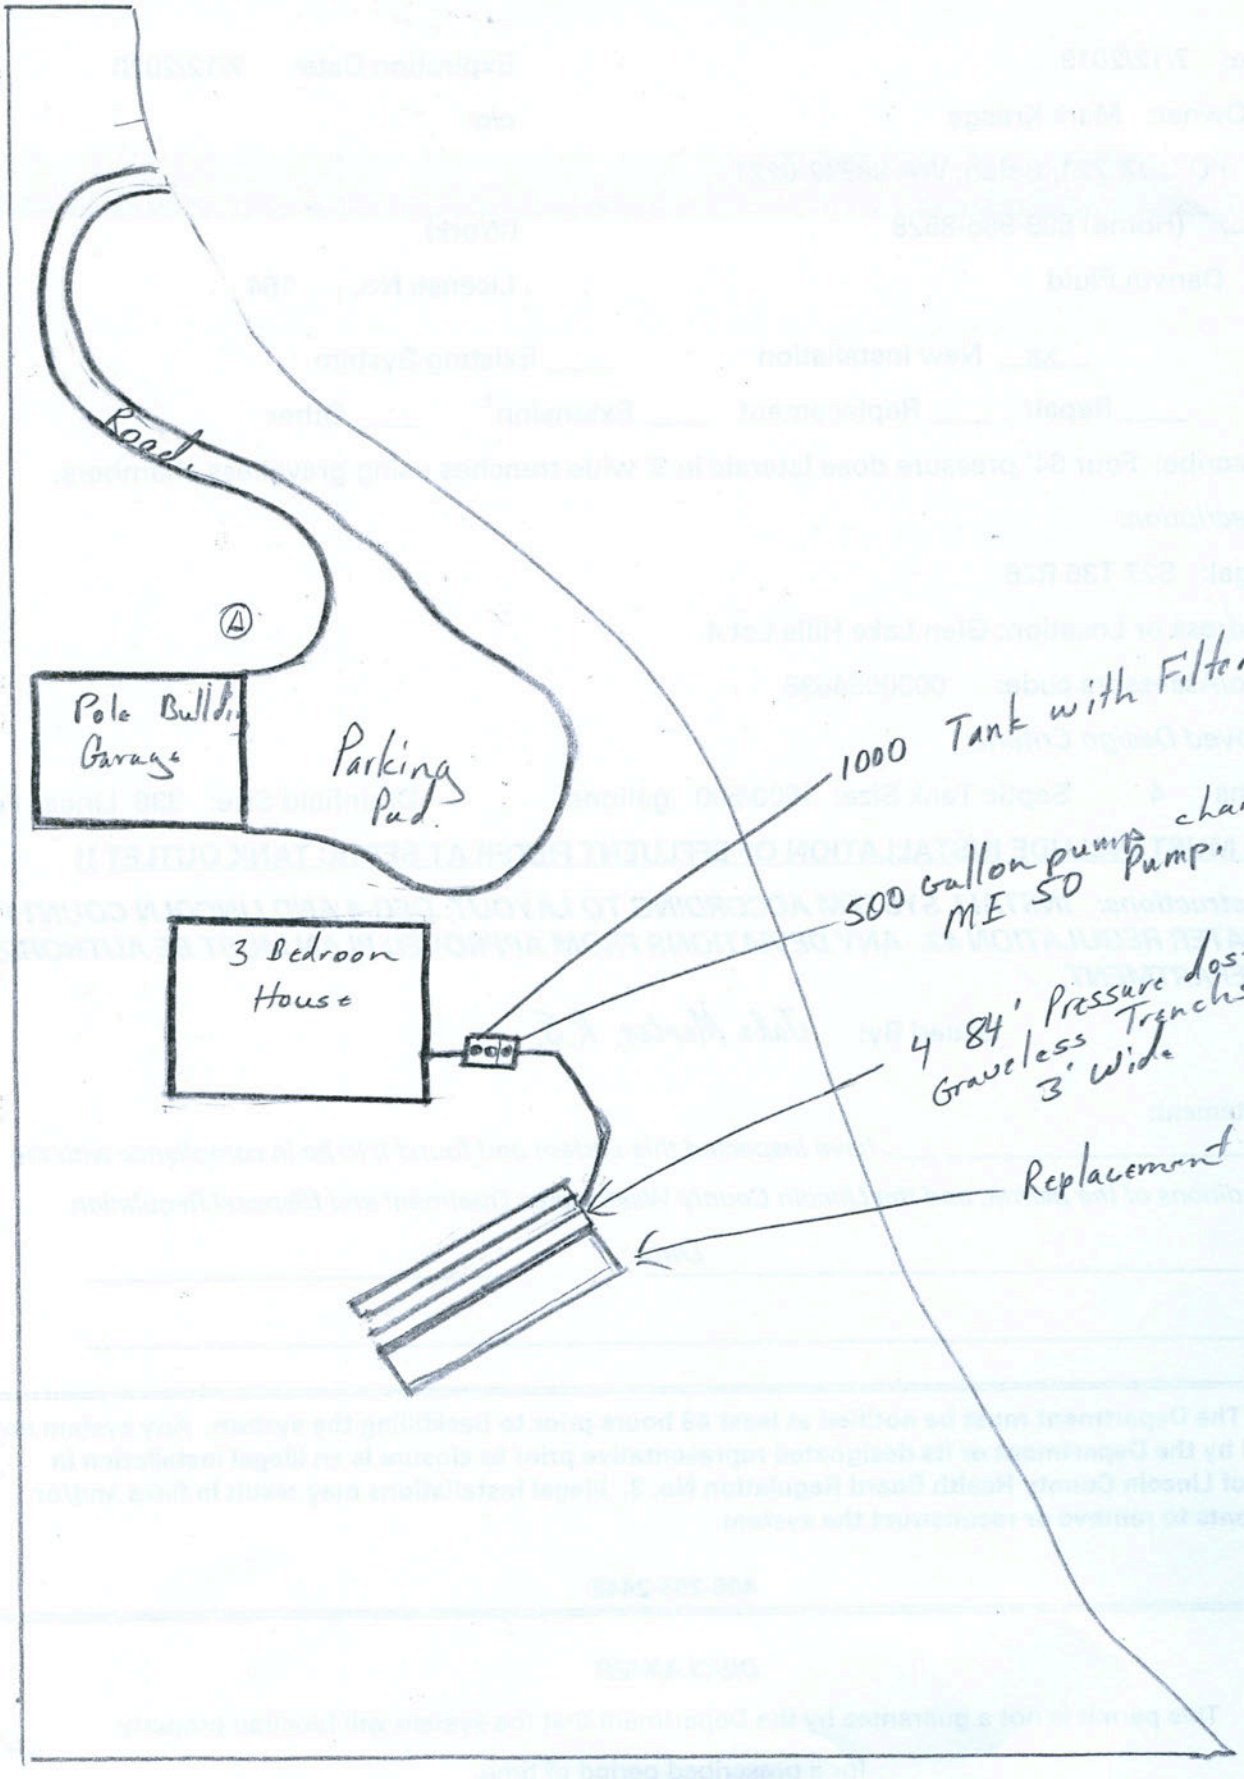
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

LOT LAYOUT


Road
A
Pole Bldg.
Garage
Parking
Pad
3 Bedroom
House
1000 Tank with Filter
500 Gallon pump chamber
ME 50 Pump
4 84' Pressure dose
Graveless Trenches
3' wide
Replacement