LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/12/2018

Expiration Date: ~~4/12/2018~~ 4/12/2019 JTM

Property Owner: MT DNRC

c/o: Kevin Gartland

Address: [redacted]

Telephone: (Home) [redacted]

(Work)

Installer:

License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' Pressure-dosed laterals in 3' wide trenches. (no expansion w/o rereview)

Parcel Description:

Legal: S36 T34 R25

Address or Location: US HWY 93 and Mt. Marston Rd

Geo/Assessors code: 0000010205

Approved Design Criteria:

Bedrooms 1 Septic Tank Size: 1000/500 gallons Drainfield Size: 130 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

DNRC LEASE LAND-GARTLAND
LEASE #3050809, LOT 4
WATER AND SEWER
LOT LAYOUT

SECTION 36-T34N-R25W
LINCOLN COUNTY

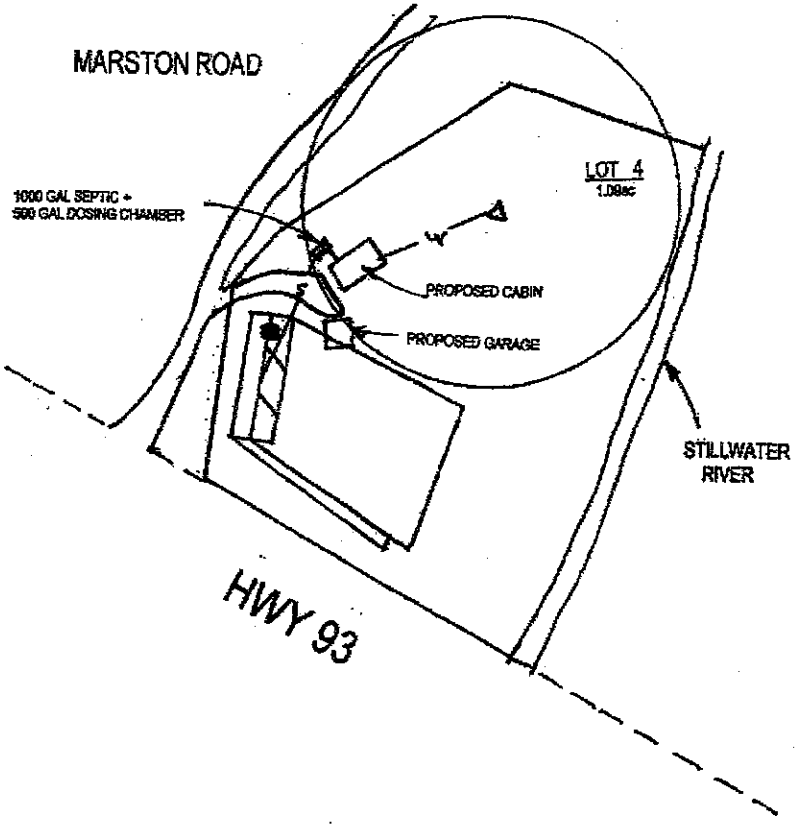

DRAINFIELD SIZING: 1 BEDROOM UPD
DEQ=0.4gpdpsf
150/0.4 = 375sf
375sf/3 = 125lf, 125lf/2 = 2-65ft laterals

LEGEND

- PRIMARY / REPLACEMENT DRAINFIELD
- Δ PROPOSED WELL
- ■ TEST HOLE
- -W- WATERLINE
- -S- SEWER LINE

N

1" = 100'

NO DRAINFIELDS/WELLS/APPROVALS (100FT)

Jere Johnson, RS
4572 Whitefish Stage Road
Whitefish MT 59937