# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/27/2018 Expiration Date: 8/27/2019

Property Owner: Brad Nykoluk c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating, Inc License No. 135

__xx__ New Installation ___ Existing System

___ Repair ___ Replacement ____ Extension ____ Other

Describe: Three 70' laterals using drain rock and perf pipe.

*Parcel Description*:

Legal: S26 T36 R28

Address or Location: Cato Subdivision Lot 1

Geo/Assessors code: 0000055864

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 210 Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

*I,* Buck Schermerhorn *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* [signature] *Date:* 8-31-18


*Title:* President


**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

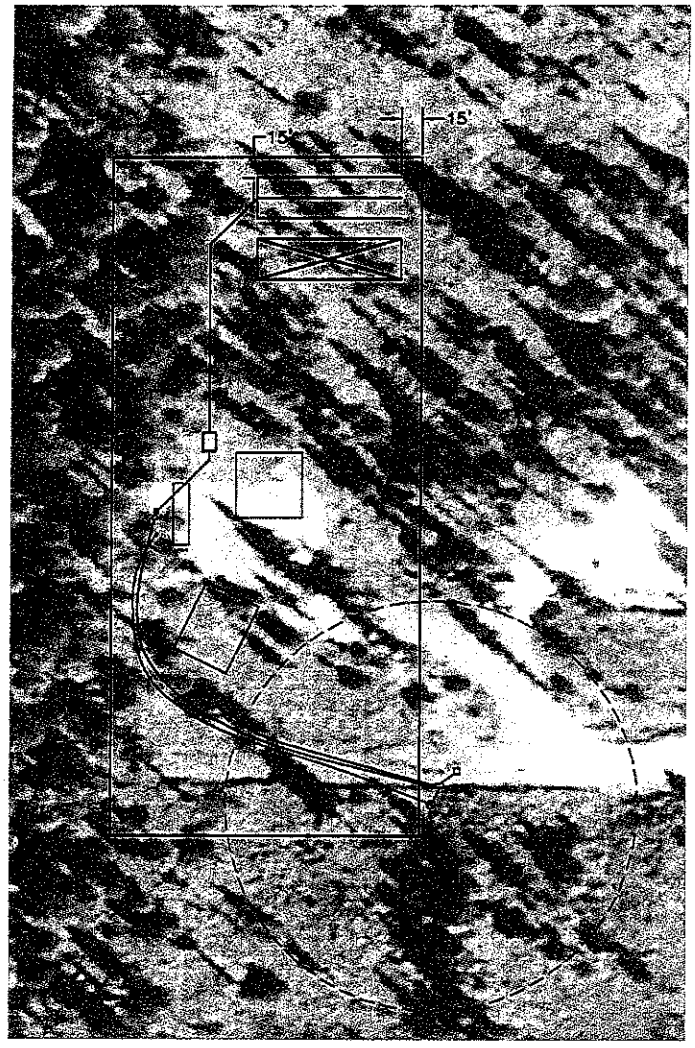

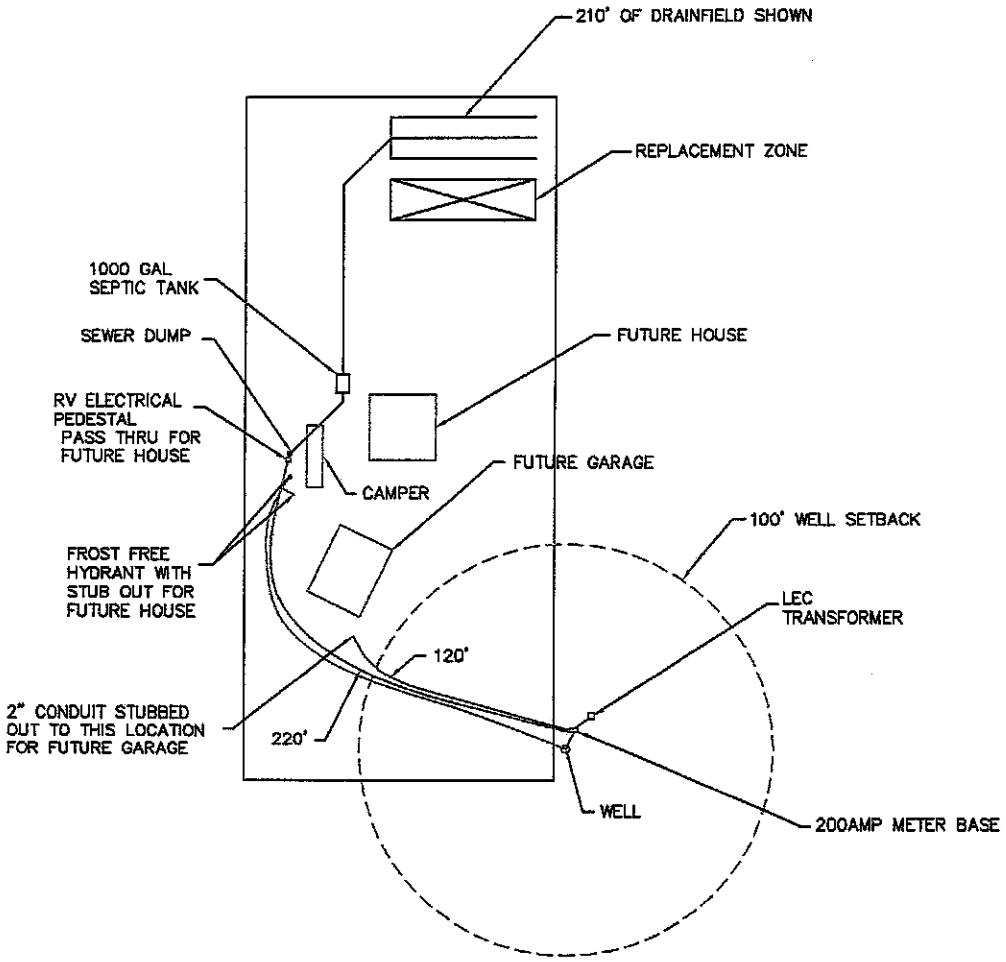
# NYKOLUK LOT LAYOUT

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| | | COMPANY | SCALE | | | KODIAKMSA EXCAVATING NYKOLUK PROJECT | |
| | | KEI | 1/16 = 1'-0" | | | SITE LAYOUT | |
| | | CONTRACT | DATE | | | DRAWN | 6/28/18 |
| | | VERSAL | 6/28/18 | | | CHECKED | |
| | | PLOT FILE | WEIGHT | | | B. NYKOLUK | 6/XX/18 |
| | | PAL-0001 | ---- | | | 62718-001 | 1 |

THIS DRAWING IS PROPERTY OF KEI INC. COMPANY AND SHALL NOT BE USED, REPRODUCED, COPIED, OR LOANED IN WHOLE OR IN PART, NOR SHALL IT OR ITS CONTENTS BE DISCLOSED TO ANY OTHER PERSONS WITHOUT WRITTEN APPROVAL FROM KEI INC.

⑥ ⑤ ④ ③ ②