LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/1/2019 Expiration Date: 5/1/2020

Property Owner: Brad Osler c/o: Koocanusa Excavating

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 55' by 31' elevated sand mound system (1643 sqft).

Parcel Description:

Legal: S16 T34 R25

Address or Location: Dicky Lake Lots Lot 6

Geo/Assessors code: 0000001528

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 1643 sq Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, BUCK SCHERMERHORN *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Buck Schermerhorn *Date:* 7/15/19

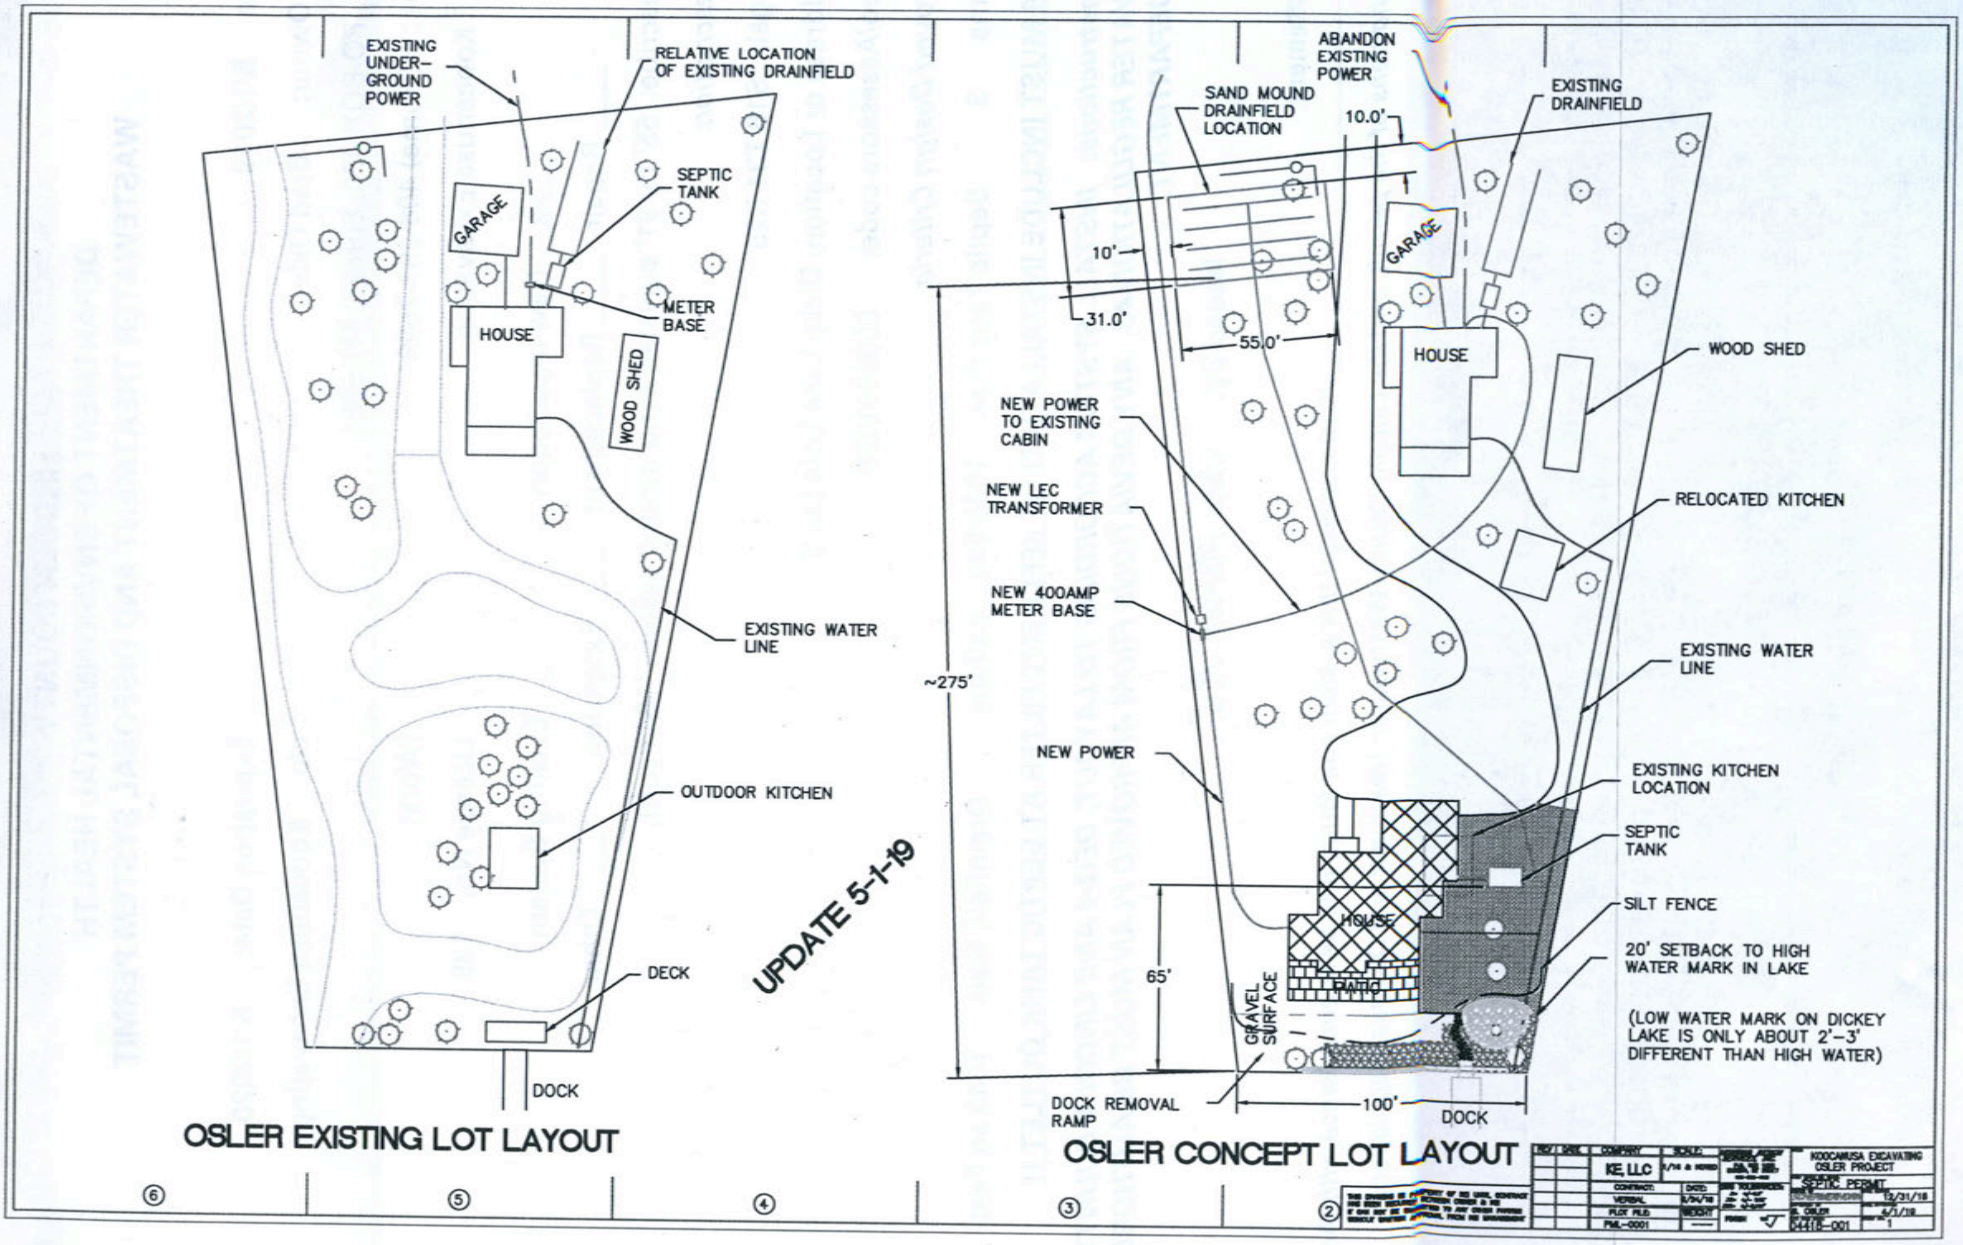
Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


EXISTING UNDER-GROUND POWER
RELATIVE LOCATION OF EXISTING DRAINFIELD
SEPTIC TANK
GARAGE
METER BASE
HOUSE
WOOD SHED
EXISTING WATER LINE
OUTDOOR KITCHEN
DECK
DOCK
OSLER EXISTING LOT LAYOUT
UPDATE 5-1-19
ABANDON EXISTING POWER
SAND MOUND DRAINFIELD LOCATION
10.0'
EXISTING DRAINFIELD
10'
31.0'
55.0'
GARAGE
HOUSE
WOOD SHED
NEW POWER TO EXISTING CABIN
NEW LEC TRANSFORMER
NEW 400AMP METER BASE
RELOCATED KITCHEN
EXISTING WATER LINE
~275'
NEW POWER
EXISTING KITCHEN LOCATION
SEPTIC TANK
SILT FENCE
HOUSE
20' SETBACK TO HIGH WATER MARK IN LAKE
65'
PATIO
GRAVEL SURFACE
(LOW WATER MARK ON DICKEY LAKE IS ONLY ABOUT 2'-3' DIFFERENT THAN HIGH WATER)
DOCK REMOVAL RAMP
100'
DOCK
OSLER CONCEPT LOT LAYOUT
KE, LLC
KOOCANUSA EXCAVATING
OSLER PROJECT
SEPTIC PERMIT
12/31/18
6/1/19
04418-001
⑥
⑤
④
③
②