LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 4/3/2018

Property Owner: Clint Oster

Mailing Address: [redacted]

Telephone: (Home) [redacted] (Work)

Name of Person Who Installed System Being Reviewed: Keith Mack

Type of System Work Reviewed:

_xx_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 100' sand lined trenches using drain rock and perf pipe.

Property Description:

Legal: S3 T35 R32

Address or Location: 361 Red Band Road Flamingo Subdivision Lot 6

Reviewed Design Components:

Wastewater Flows: 300 Sewer Lines: 30" Septic Tank: 1000 Effluent Filter: Yes

Dosing or Lift Tank: No Drainfield Size: 200lf Drainfield Construction: Standard/Sandlined

Hydraulic Function: yes

Comments:

System Review Documentation Statement:

I, Keith Mack, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.

Signed: K L Mack *Date:* 4-25-18

Title: Mack Excavating Owner

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

LEGEND


- E- HOMESITE
- E- WELL
- E- SEPTIC TANK
- E- DRAINFIELD AND REPLACEMENT SITE
- P- MIXING ZONE
- E- LOT BOUNDARY
- E- DRIVEWAY/PARKING LIMITS

GRAPHIC SCALE

100 0 50 100

(IN FEET)

1 inch = 100 ft.

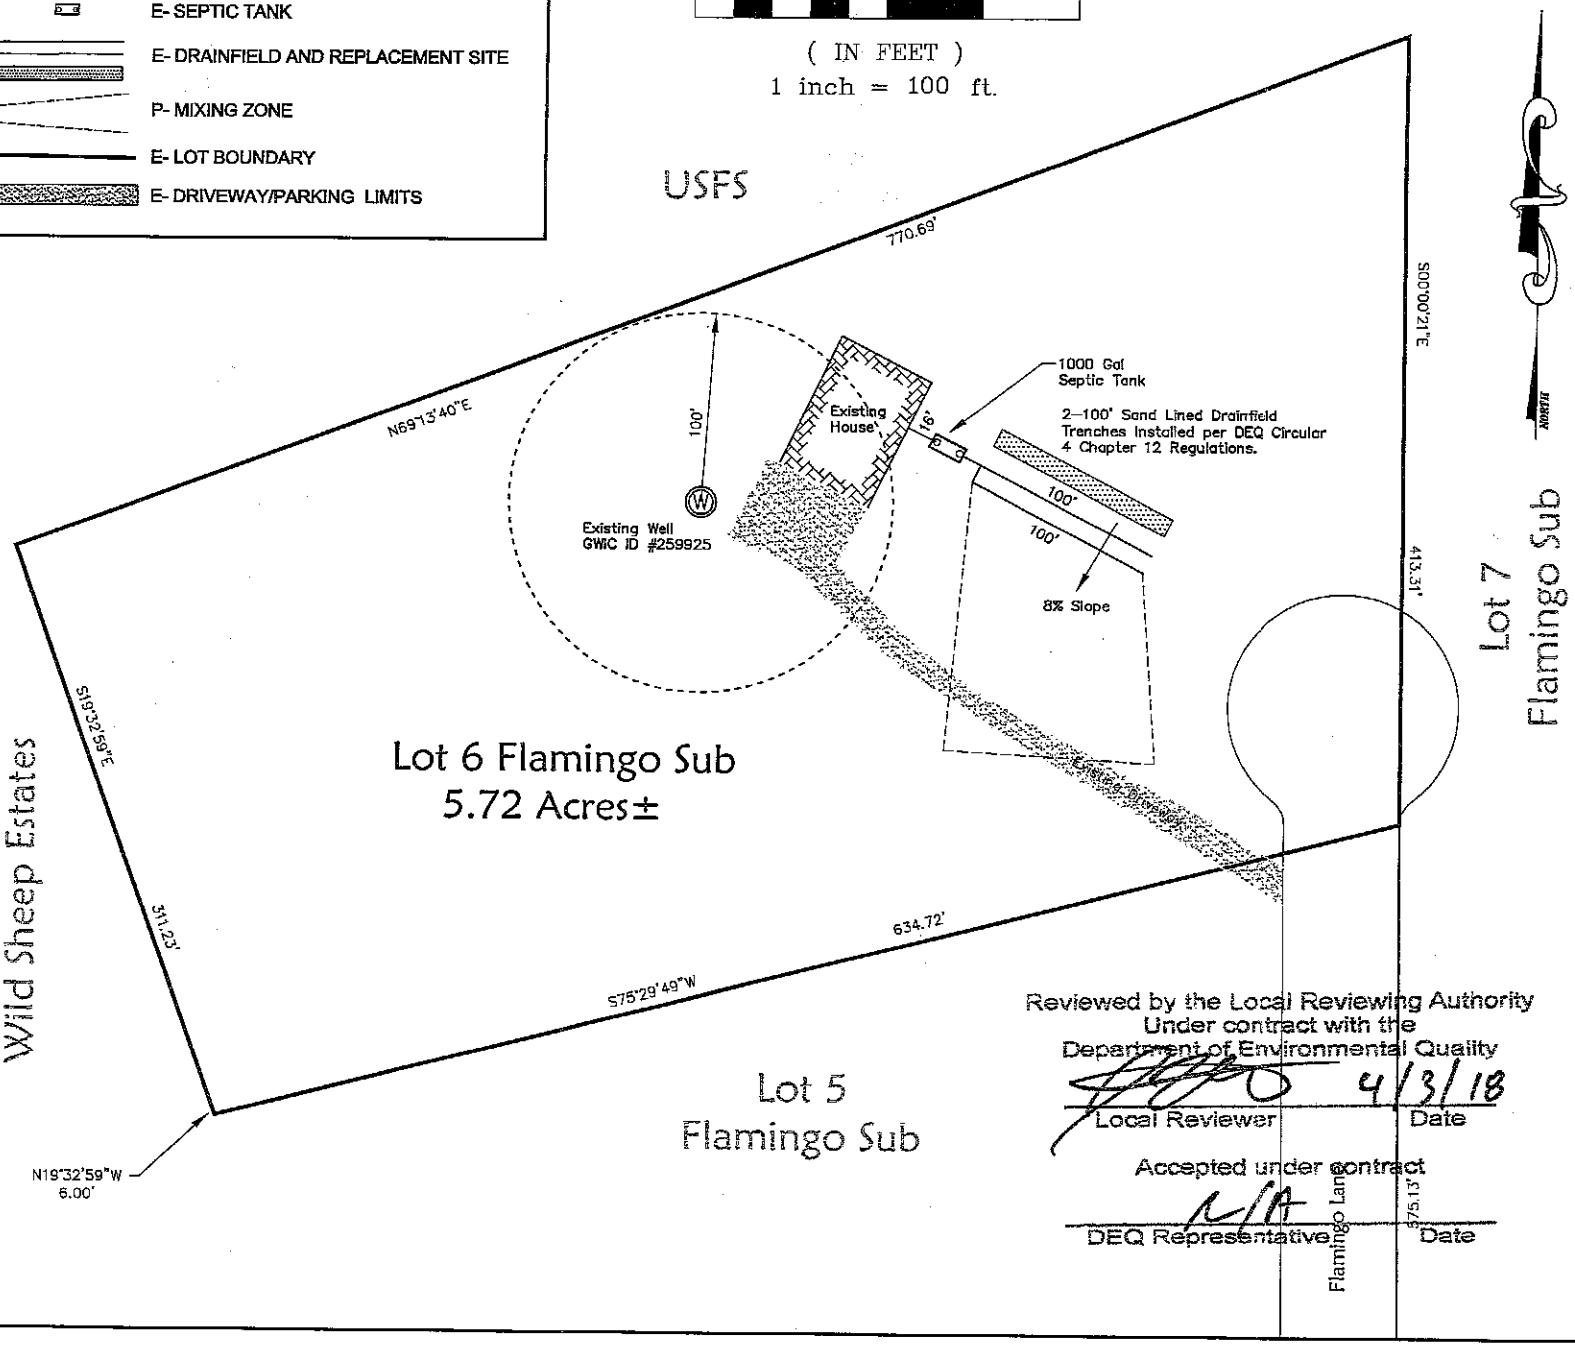

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Local Reviewer — Date 4/3/18

Accepted under contract

DEQ Representative — Date

Sec 2 and Sec 3
T 35 N R 32W
Sec 34 and Sec 35
T 36 N R 32W
Lincoln County
Montana

Owner:
Clint and Christine Oster

Date:
March 2018

Lot 6 ReWrite
Flamingo Subdivision
Lot Layout

DRAWING SET DATE

ISSUES/REVISIONS 1 = ISSUE △ = REVISION

No.	Date	Purpose	By	Check
1	3/2018	DEQ Submit	JSM	

PROJECT NUMBER 2018-002
SHEET TITLE: Lot 6 Re-Write
FILE No.
BOOK PAGE
DRAWN BY: B. McCully

SHEET No. 1 OF -