# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/3/2019 Expiration Date: 7/3/2020

Property Owner: Kenneth Pelphrey c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Brenneman's Excavation License No. 170

___ New Installation __xx__ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Four 100' laterals using gravelless chambers for house.

*Parcel Description*:

Legal: S29 T35 R25

Address or Location: Tract 1B Plat 2056 1875 Deep Creek Road, Fortine

Geo/Assessors code: 0000000624

*Approved Design Criteria*:

# Bedrooms 4 Septic Tank Size: 1500/500 gallons Drainfield Size: 400 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Elmer Brenneman *Date:* 7-8-2019

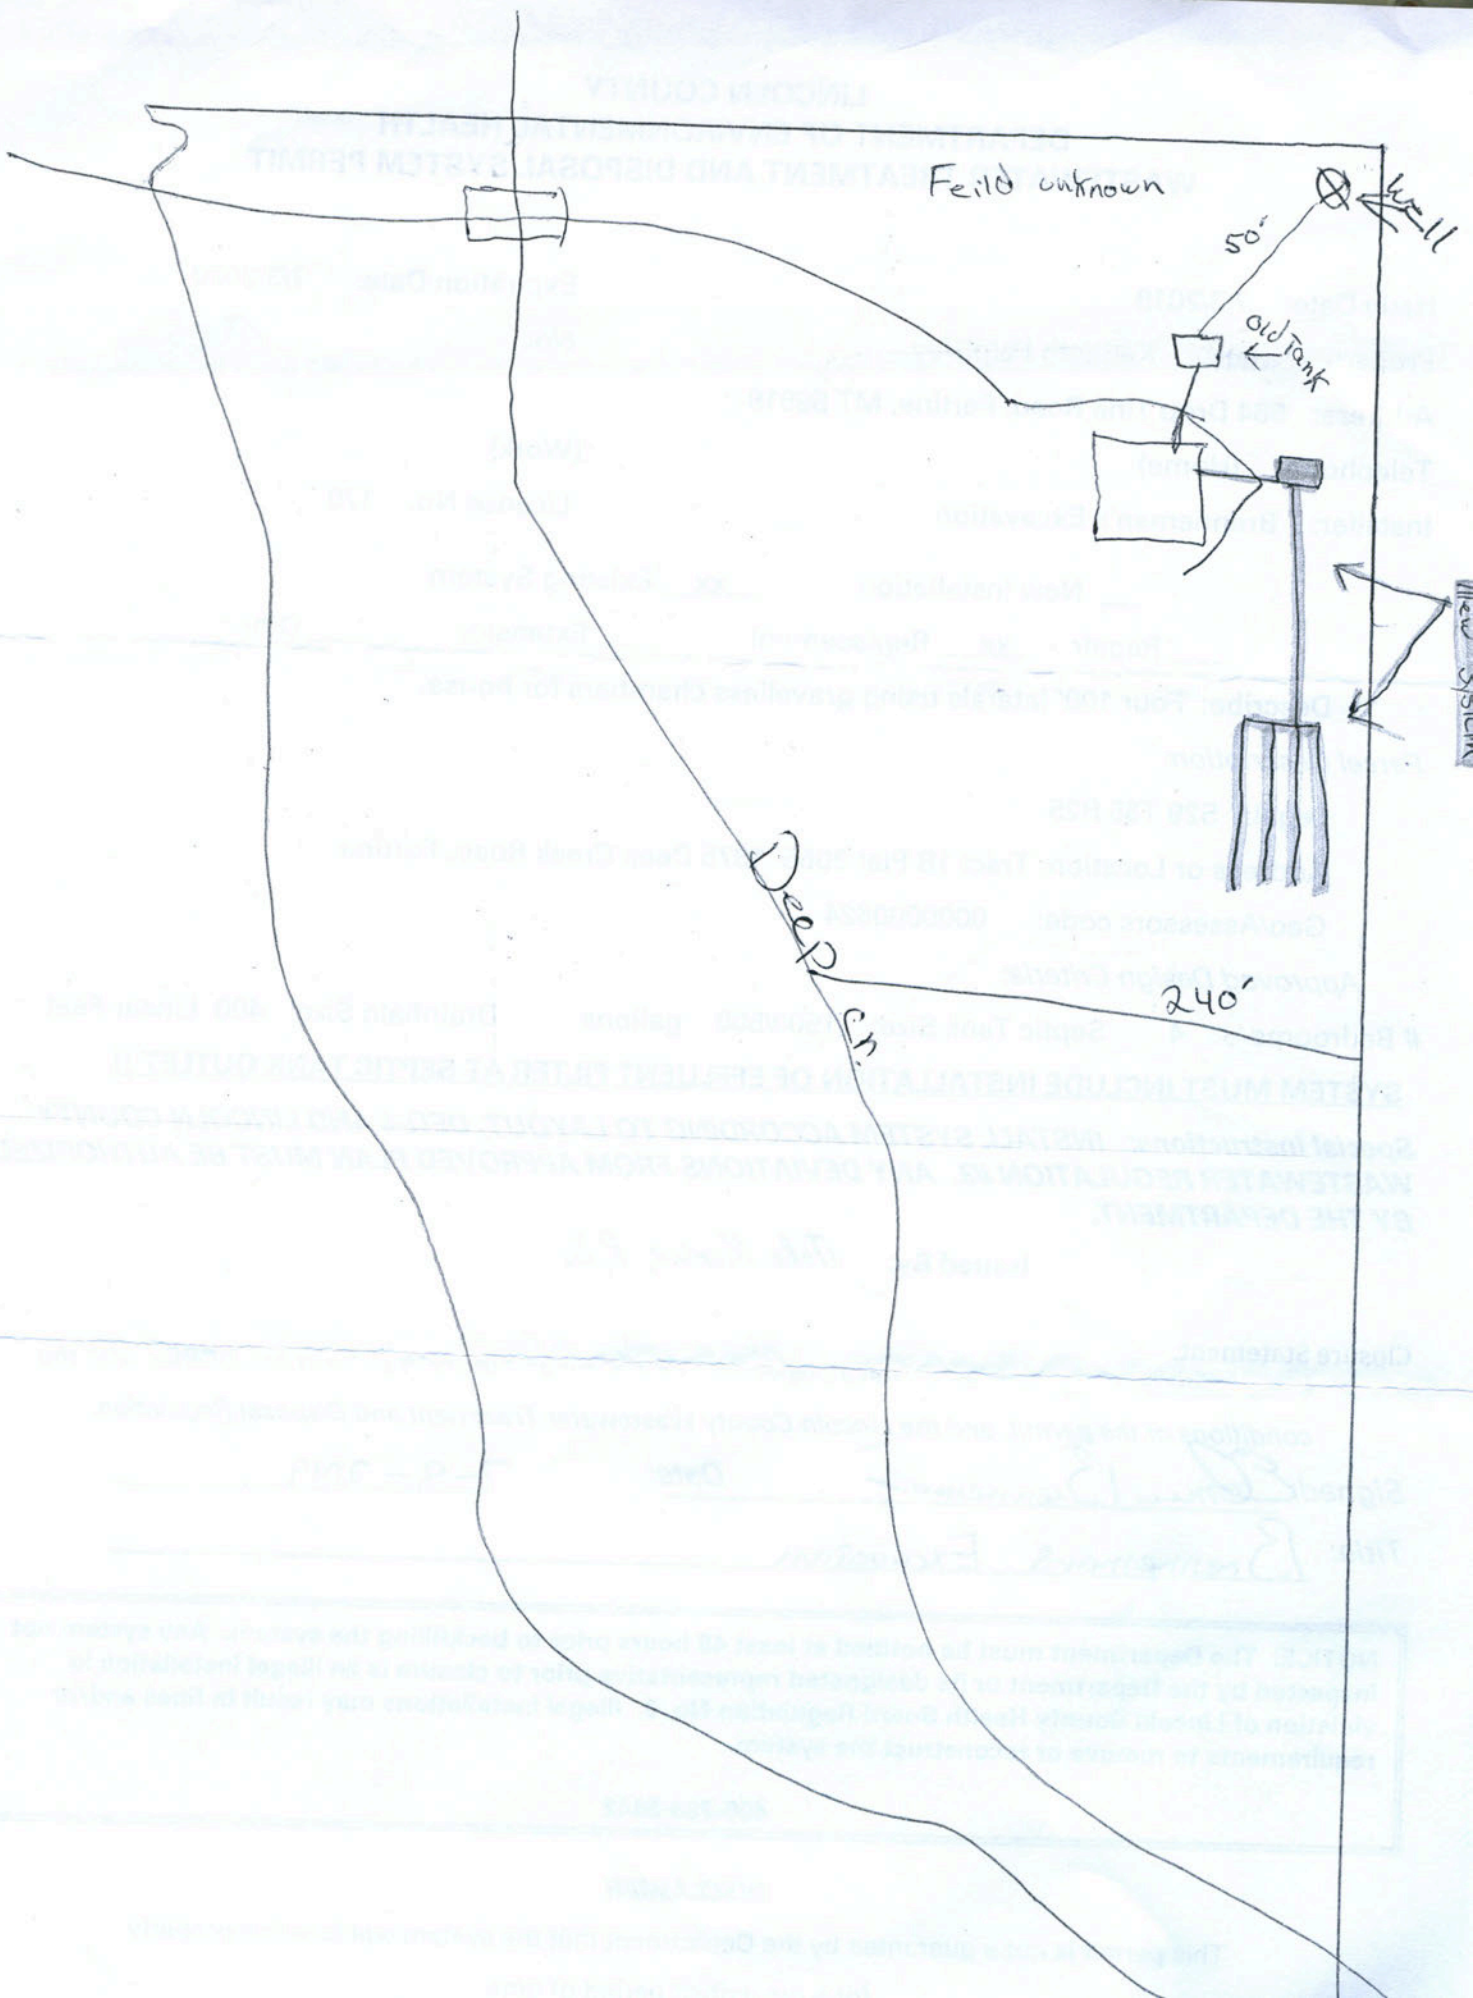
*Title:* Brenneman's Excavation

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Feild unknown
well
50'
old Tank
Deep Cr.
240'