LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/28/2019

Expiration Date: 5/28/2020

Property Owner: Derek Robinson

c/o: Koocanusa Plumbing

Address: [redacted]

Telephone: (Home) (Work)

Installer: David Hull

License No. 169

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 78' laterals using gravelless chambers.

Parcel Description:

Legal: S20 T37 R27

Address or Location: Murry Island Lot 1

Geo/Assessors code: 0000007688

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 234 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, David Hull, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: David Why *Date:* 6-17-19

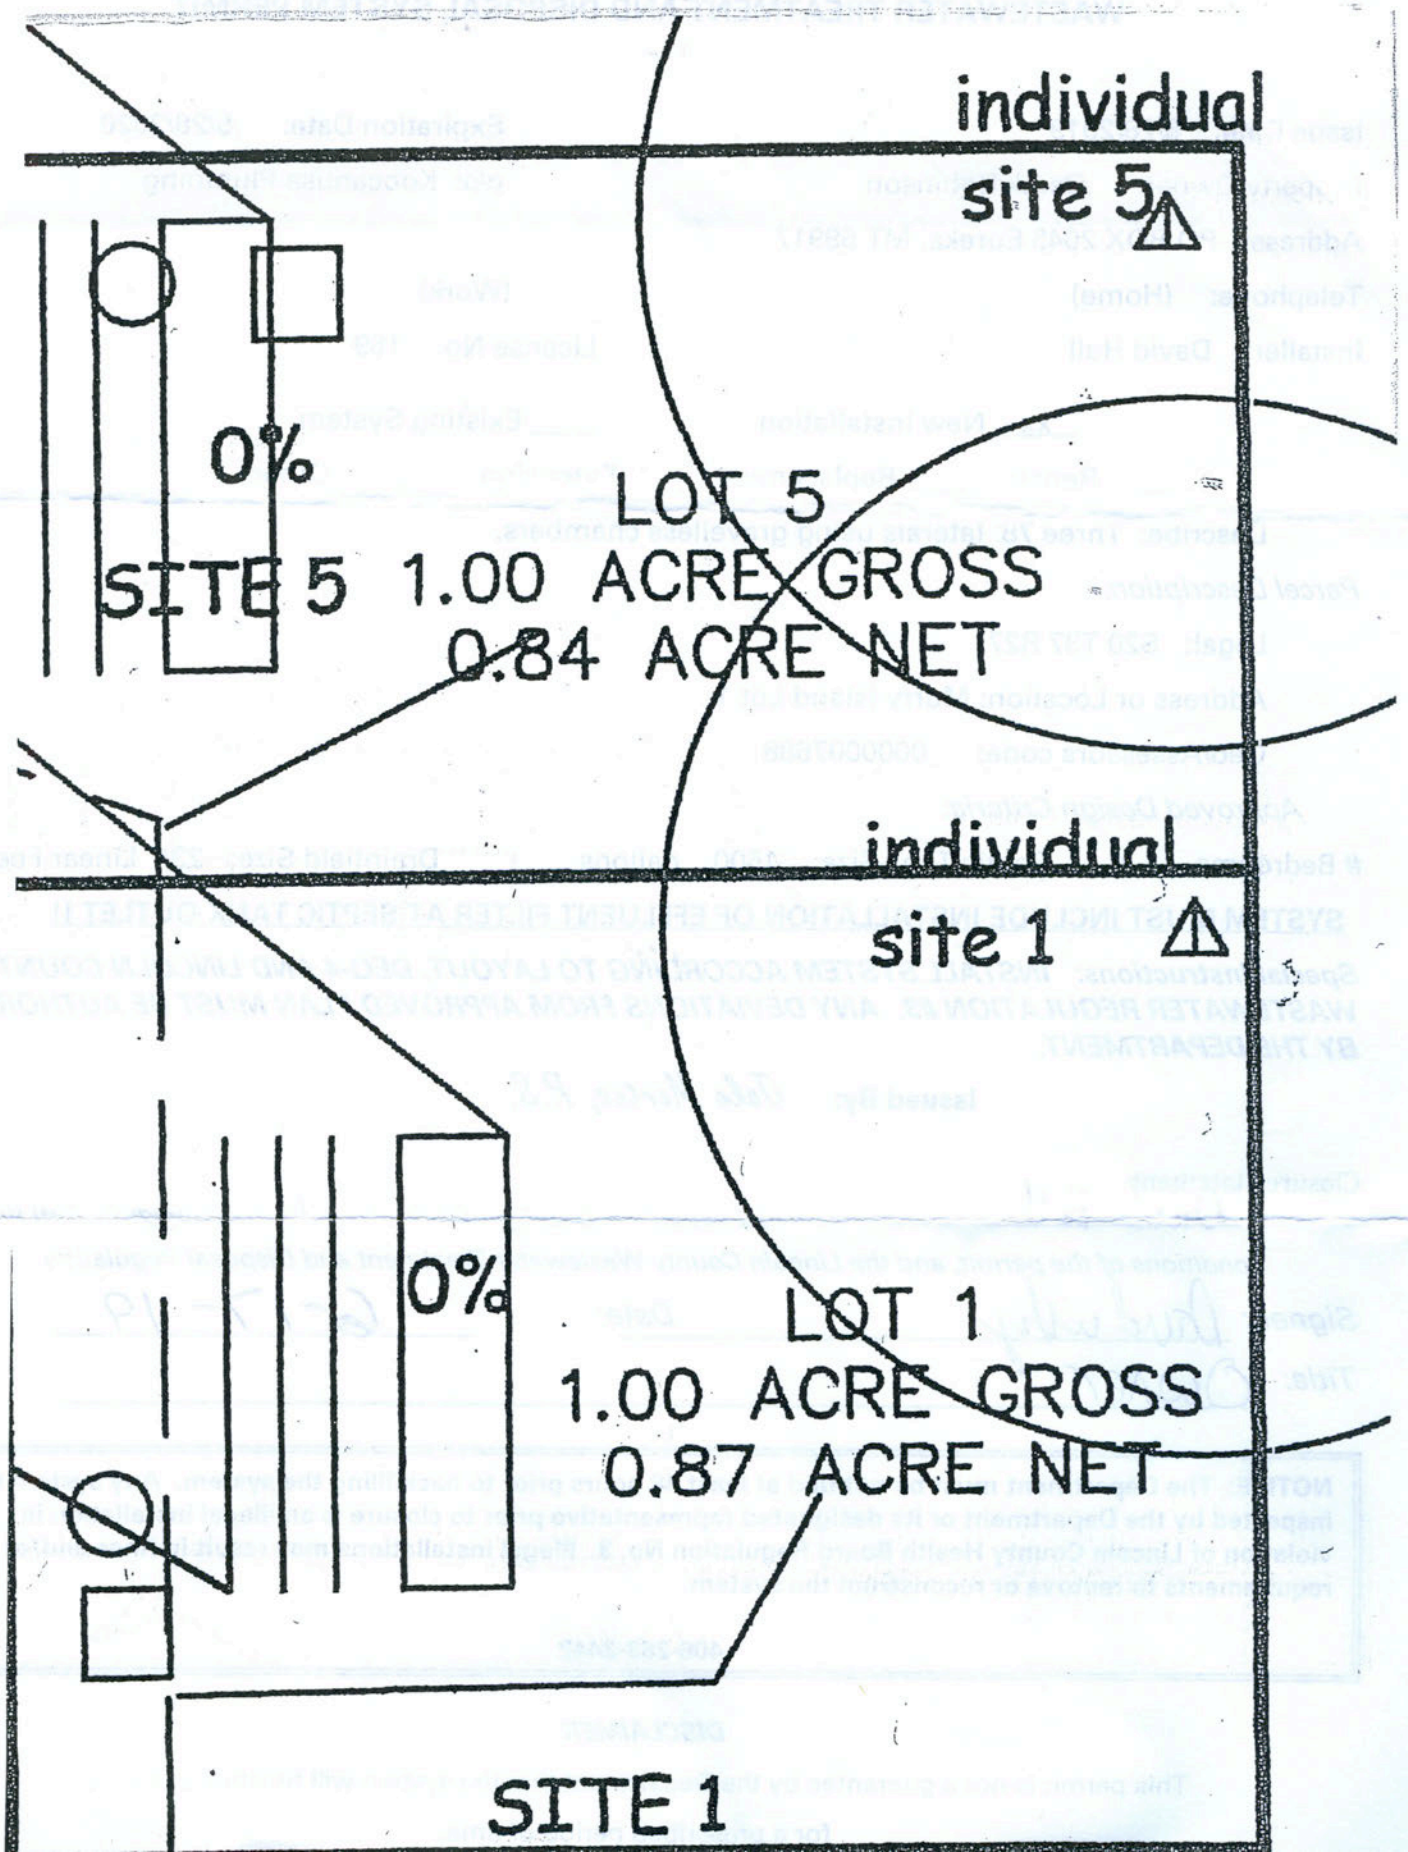
Title: Owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


individual
site 5
0%
LOT 5
SITE 5 1.00 ACRE GROSS
0.84 ACRE NET
individual
site 1
0%
LOT 1
1.00 ACRE GROSS
0.87 ACRE NET
SITE 1