LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 9/5/2018

Property Owner: Joe Roy

Mailing Address: [redacted]

Telephone: (Home) [redacted] (Work)

Name of Person Who Installed System Being Reviewed: Jim Voyles

Type of System Work Reviewed:

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 100' laterals using gravelless chambers.

Property Description:

Legal: S06 T34 R26

Address or Location: Whispering Pines Koocanusa 1 Lot 2

Reviewed Design Components:

Wastewater Flows: 300 Sewer Lines: 24" Septic Tank: 1500 Effluent Filter: Yes

Dosing or Lift Tank: no Drainfield Size: 400 lf Drainfield Construction: gravelless

Hydraulic Function: Yes

Comments: ☑ APPROVED 9/5/18

System Review Documentation Statement:

I, JIM VOYLES *, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.*

Signed: _____ *Date:* Sept 5 2018

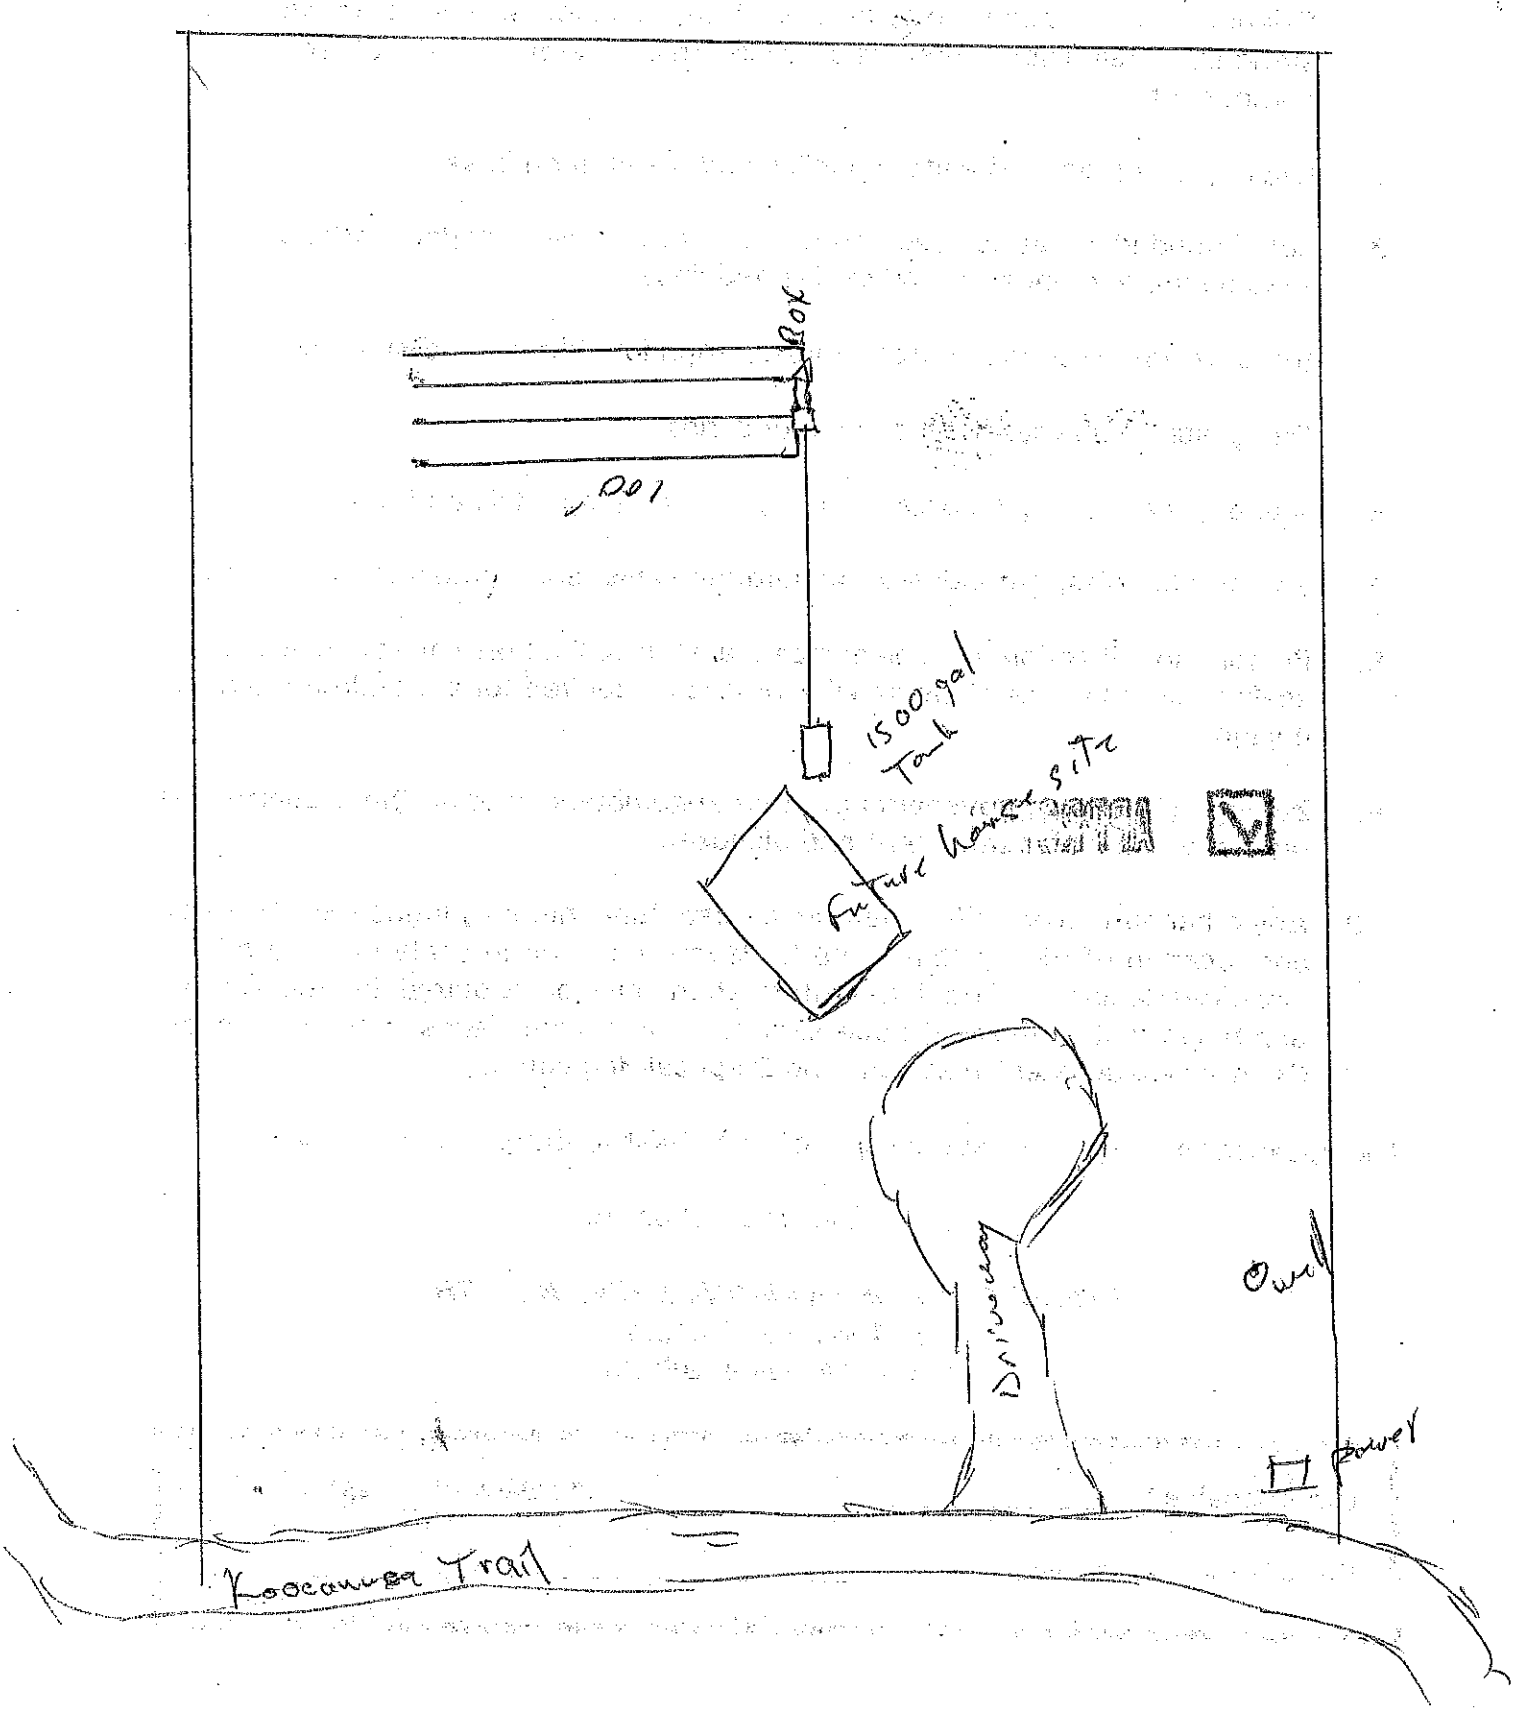
Title: Owner #22

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

LOT LAYOUT


Roof
DOI
1500 gal Tank
Future house site
Driveway
Owl
Power
Toccoa Trail