LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/12/2019 Expiration Date: 7/12/2020

Property Owner: Cameron Selmer c/o: Darwin Pluid

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Darwin Pluid License No. 164

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 75' laterals using gravelless chambers.

Parcel Description:

Legal: S14 T37 R27

Address or Location: AJ Estates Lot 13

Geo/Assessors code: 0000054428

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Darwin Pluid, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Darwin Pluid Date: 8/30/19

Title: Earth Works Owner Lisc # 164

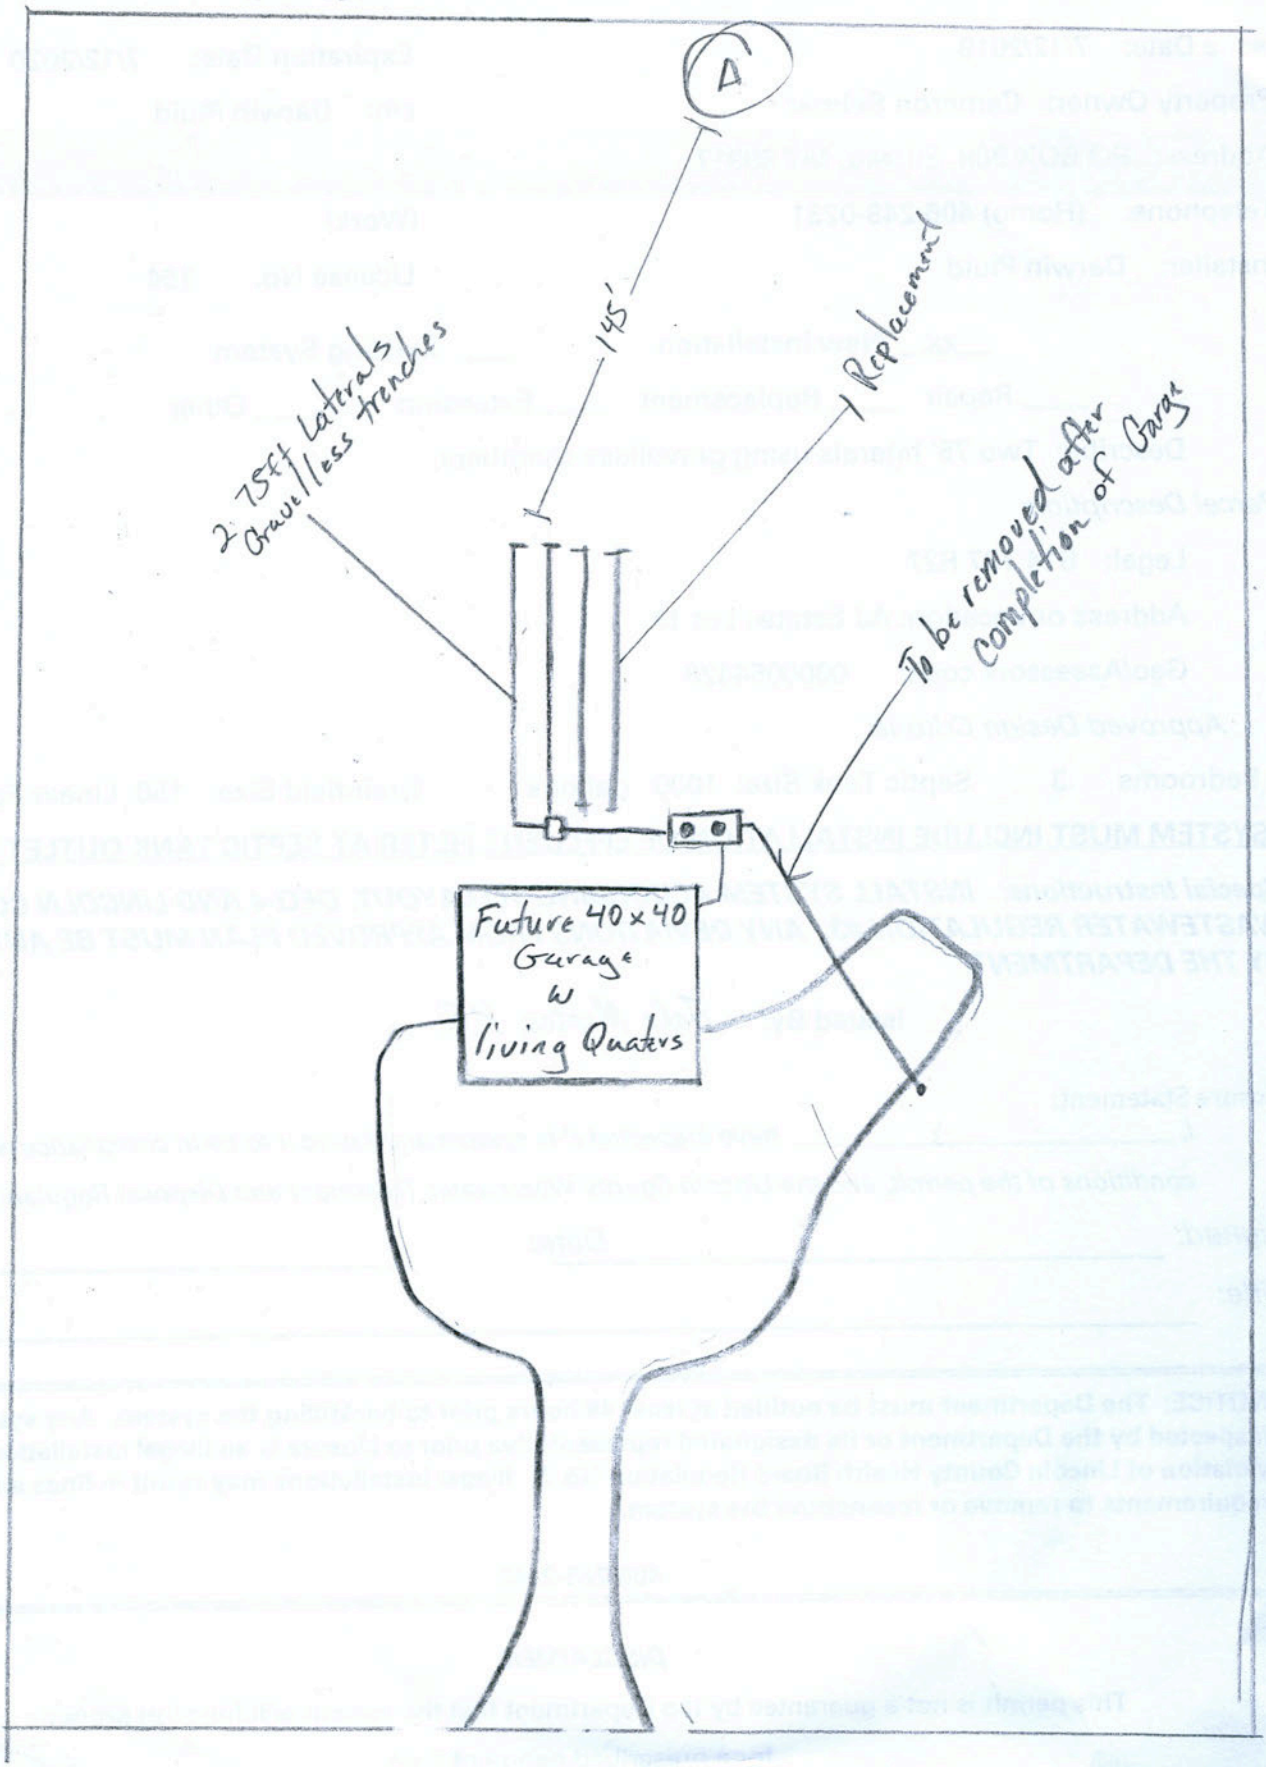
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


A
145'
2 75ft Laterals
Gravelless trenches
Replacement
To be removed after
completion of Garage
Future 40 x 40
Garage
w
living Quaters