LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 7/27/2018

Property Owner: Linda Setzer

Mailing Address: [redacted]

Telephone: (Home) [redacted] (Work)

Name of Person Who Installed System Being Reviewed: Koocanusa Plumbing & Electric

Type of System Work Reviewed:

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 52' laterals using drain rock and perf pipe.

Property Description:

Legal: S14 T36 R27

Address or Location: 570 12th street, Eureka, MT TR 2-16 CS 1925

Reviewed Design Components:

Wastewater Flows: 350 gal/day Sewer Lines: 5 x 52' Septic Tank: 1000/500 Effluent Filter: Yes

Dosing or Lift Tank: N/A Drainfield Size: 260 Drainfield Construction: Drainrock/PP

Hydraulic Function: Yes

Comments:

System Review Documentation Statement:

I, Kaylan Caldwell, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.

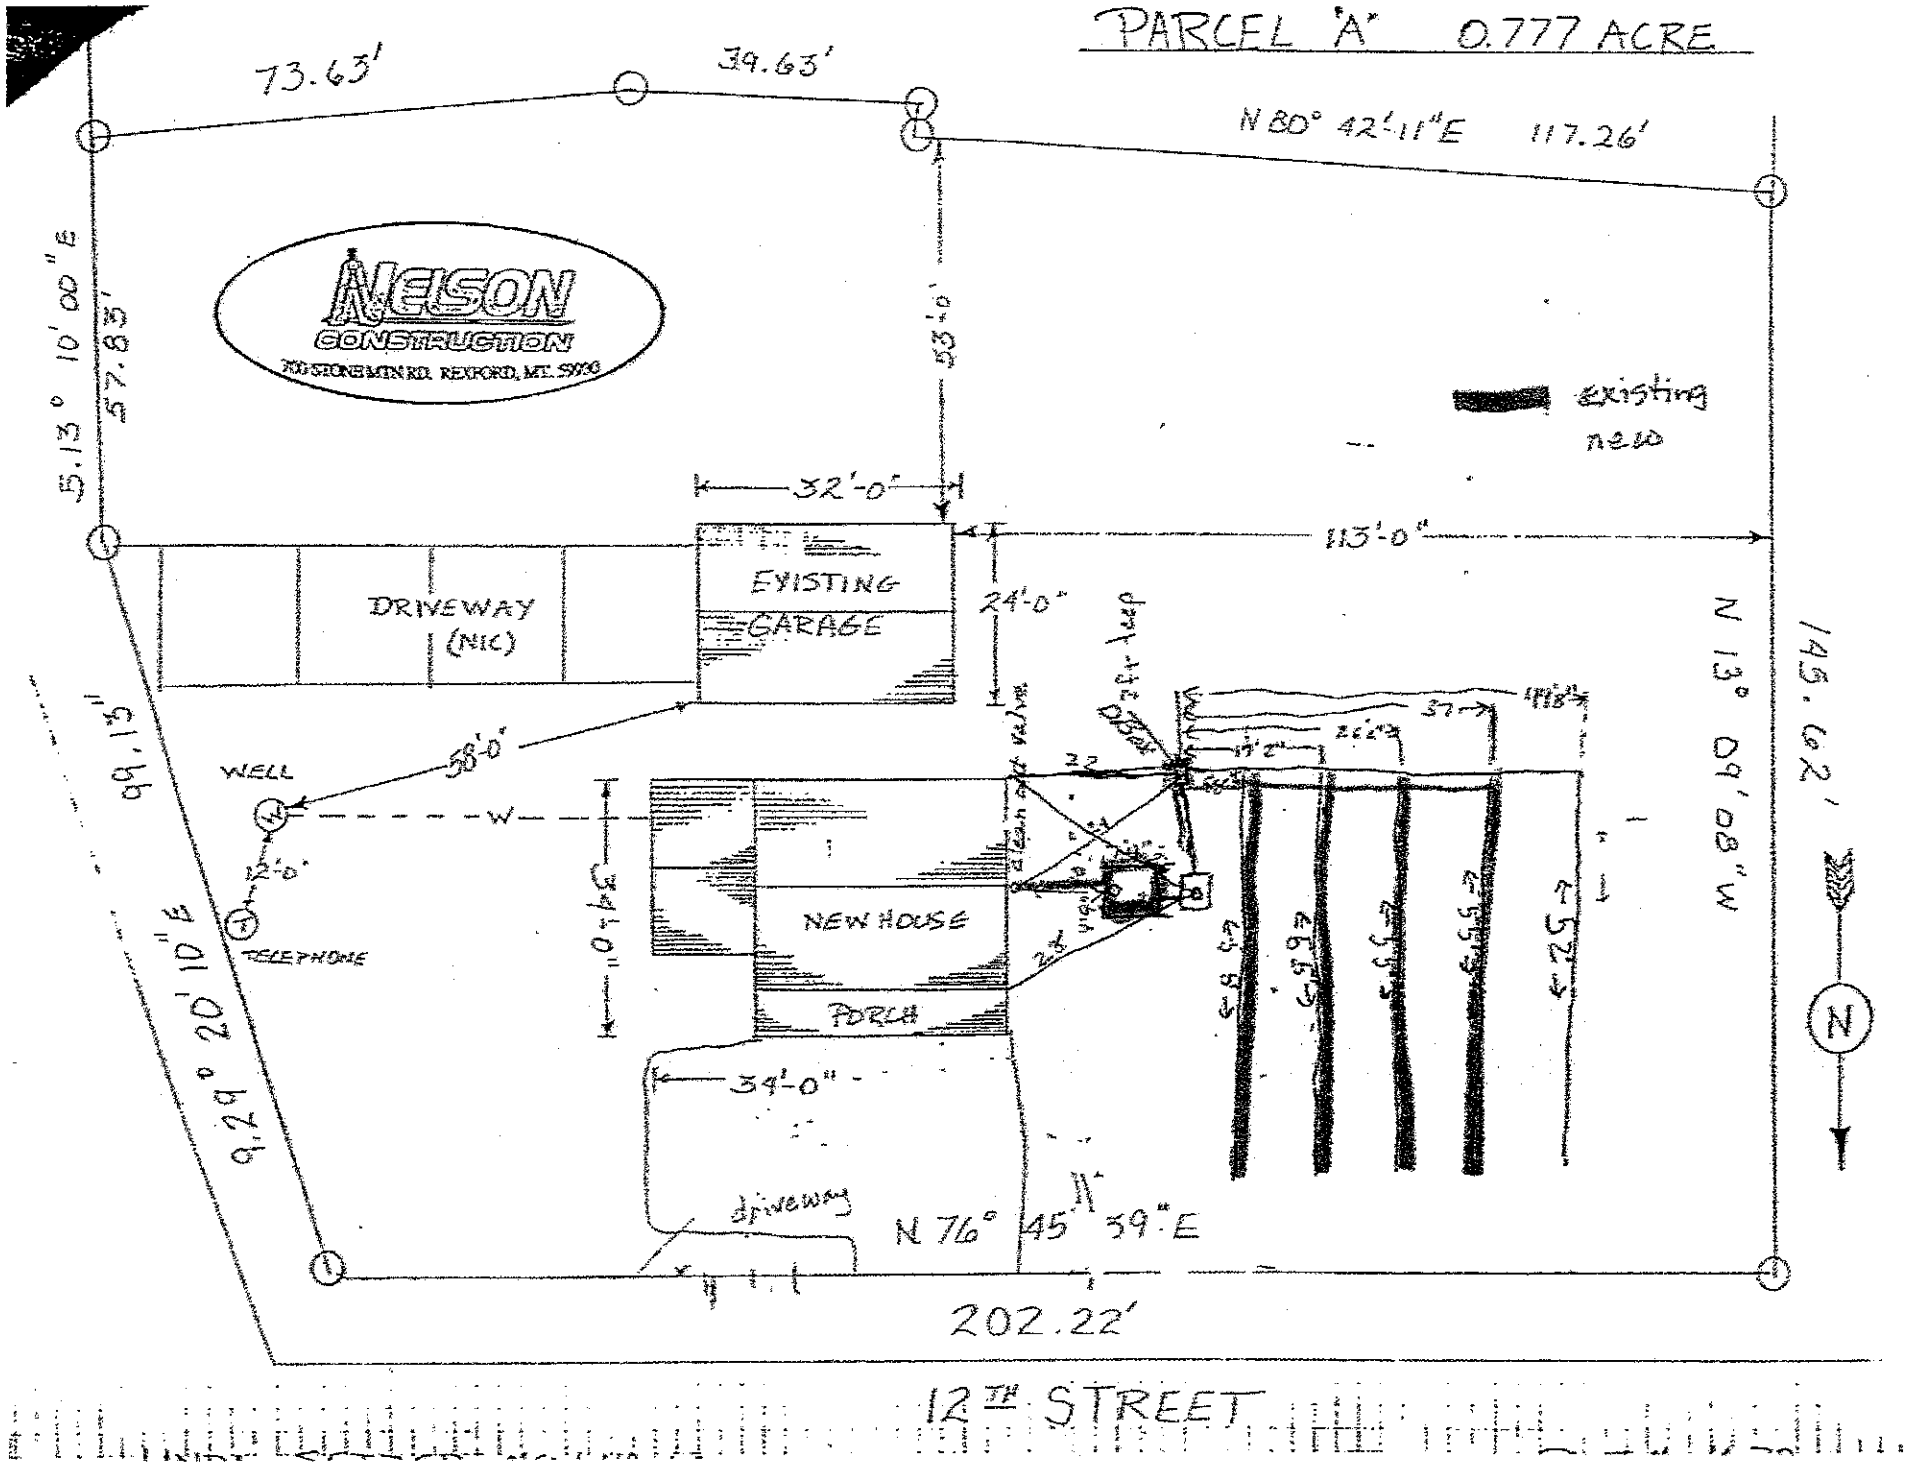
Signed: Kaylan Caldwell *Date:* 10/19/18

Title: Septic Installer

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.


PARCEL "A" 0.777 ACRE
73.63'
39.63'
N 80° 42'-11" E 117.26'
S 13° 10' 00" E
57.83'
53'-0"
NELSON CONSTRUCTION
EXISTING
NEW
32'-0"
113'-0"
DRIVEWAY (NIC)
EXISTING GARAGE
24'-0"
N 13° 09' 08" W
149.62'
99.15'
58'-0"
WELL
W
12'-0"
TELEPHONE
34'-0"
NEW HOUSE
PORCH
34'-0"
S 29° 20' 10" E
92.29'
driveway
N 76° 45' 39" E
202.22'
12TH STREET
N