LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/17/2015 Expiration Date: RE-ISSUE 6/21/19

Property Owner: ~~Rocky & Georgia Bothman~~ ROBERT SILL c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: PRESSURE DOSED – STEP Drainfield using chambers, sizing reduction allowed per .6 app rate. See size below.

Parcel Description:

Legal: S30 T31 R31

Address or Location: Govt. Lot 1 and 7 Parcel A

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

two 100' trenches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes

Closure Statement:

I, JAKE MERTES *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 6/21/18

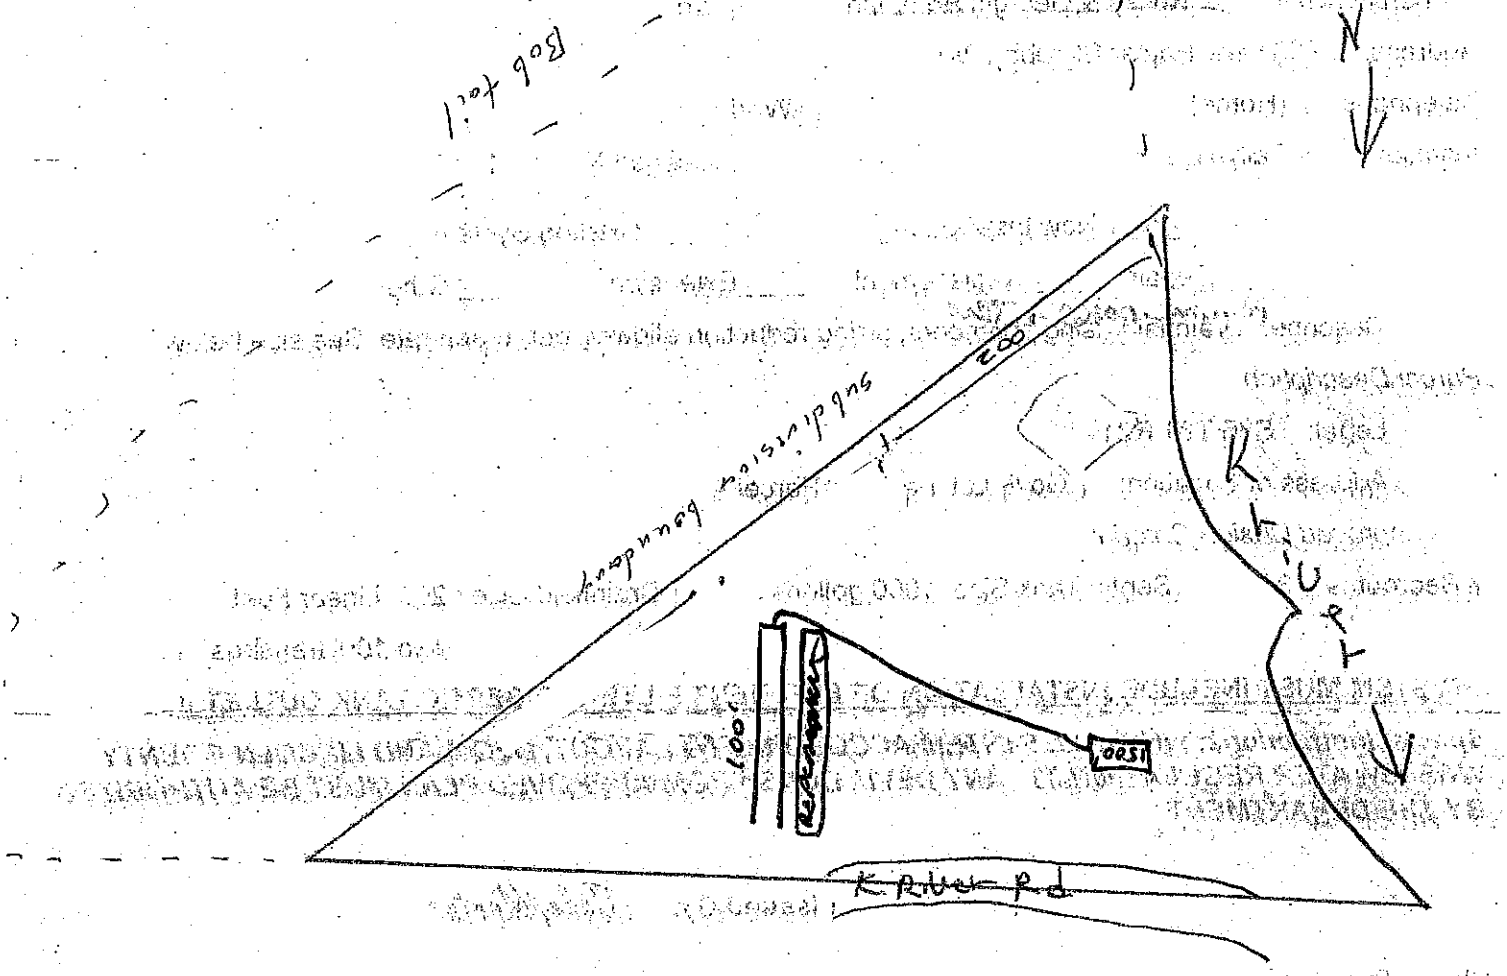
Title: SANITARIAN

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Subdivision boundary
200'
100'
Easement
ISOO
K River Rd
NOT TO SCALE