LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/25/2019 Expiration Date: 6/25/2020

Property Owner: Evan Smith c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Rupret Schreiner License No. 19

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' pressure dosed laterals in 3' wide trenches using drainrock.

Parcel Description:

Legal: S07 T34 R25

Address or Location: CS 4411 Parcel B

Geo/Assessors code: 0000052618

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 250 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Rupert Schreiner *Date:* 9-23-19

Title: Lic #19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

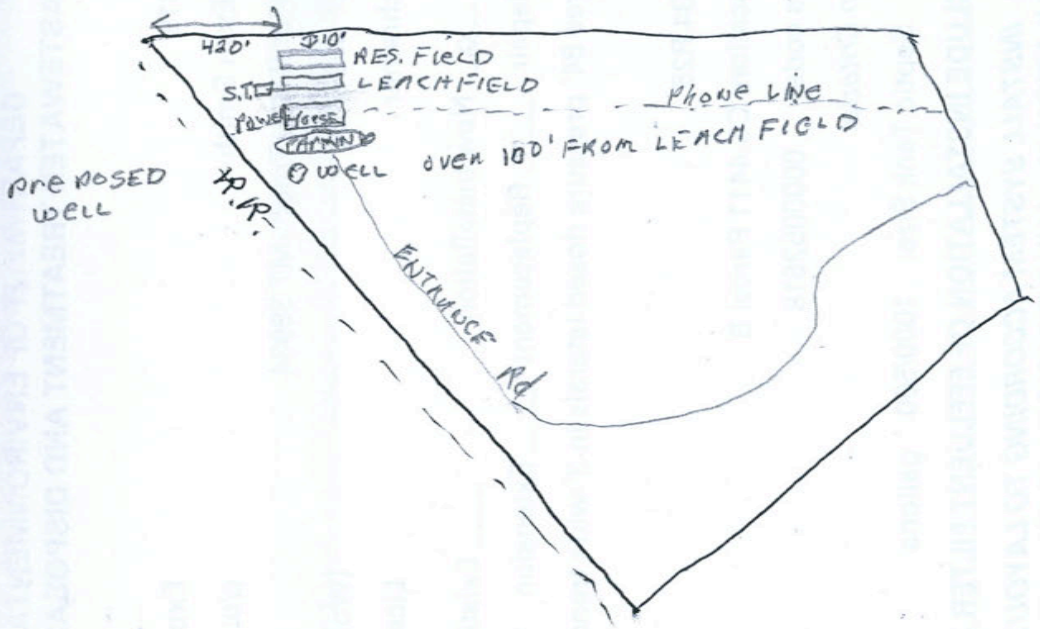
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

↑N

EVAN SMITH


420'
210'
RES. FIELD
LEACH FIELD
S.T.
Phone Line
Power
House
Cabin
well
over 100' FROM LEACH FIELD
PROPOSED WELL
ENTRANCE Rd