LINCOLN COUNTY
SEPTIC SYSTEM PERMIT NO. NEW

ISSUED TO: KURT SPENCER DATE: 8-28-85

ADDRESS: [redacted] PHONE: [redacted]

ISSUED BY (sign.) Ronald L Anderson RS

INSPECTION BY (sign.) _____ DATE: _____

(You must notify the Department of Environmental Health a minimum of 8 working day hours before backfilling the septic system, so that it can be inspected.)

CONTRACTOR: _____

DESCRIPTION OF SYSTEM:

LOCATION OF PROPOSED SYSTEM SE 1/4 of SEC 26 NE 1/4 of SEC 35 T3N R3W

SEPTIC TANK 1000 gal. ABSORPTION AREA: 300 ft^2


SEWAGE DISCHARGE — gal/day No. of BEDROOMS 3


WATER SUPPLY SOURCE WELL SOIL SANDY SILT SLOPE 1/2%

INSTRUCTIONS: DIG A DITCH AT LEAST 150' IN LENGTH x 2 1/2 - 3' DEEP x 2' WIDE ACCORDING TO LOT LAYOUT AND DITCH DIAGRAM.

5.537 ACRES PERC-RATE 1.66 MIN/INCH

SKETCH OF LOT LAYOUT:

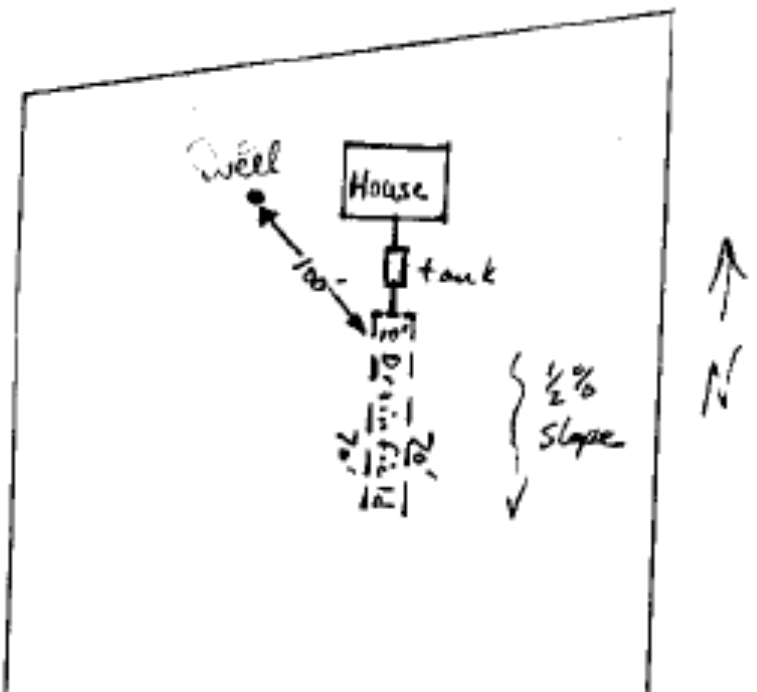

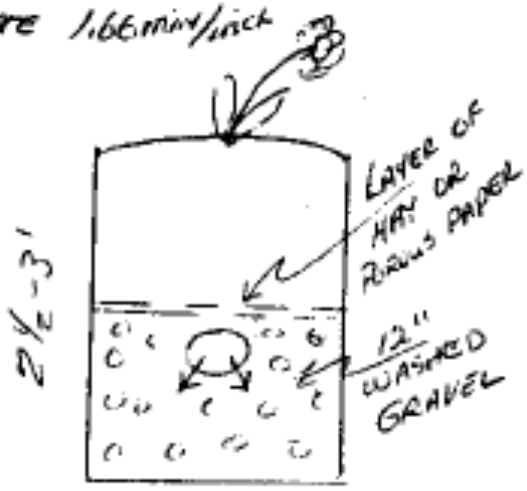

DITCH DIAGRAM

NO SCALE