LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2018 Expiration Date: 8/21/2019

Property Owner: Ron Starkweather c/o: Koocanusa Plumbing

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing License No. 169

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 70' laterals using gravelless chambers.

Parcel Description:

Legal: S03 T36 R27

Address or Location: Lot 4A Glacial High Estates

Geo/Assessors code: 0000054640

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1500 gallons Drainfield Size: 140 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, [signature], *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8-28-18

Title: Owner


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LINCOLN COUNTY, MONTANA
LOT LAYOUT
FATT BOY SUBDIVISION
IN THE NE 1/4 OF SECTION 6
TWP. 36 N., R. 26 W., P.M.M.
FOR: LELAND & DEBORAH MOCKO DATE: AUGUST 2005

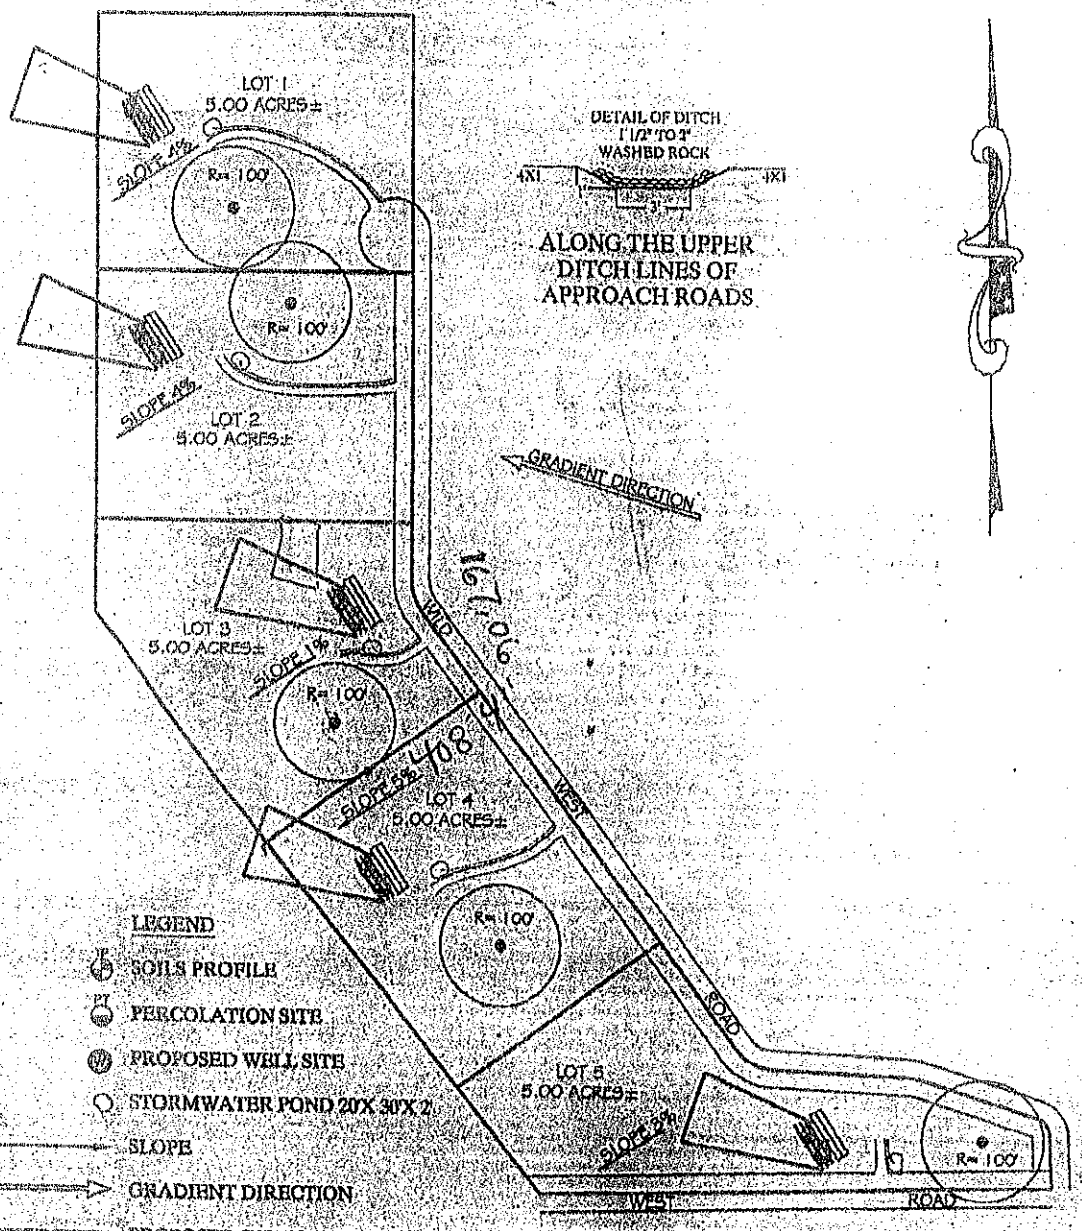

LEGEND

- SP — SOILS PROFILE
- PT — PERCOLATION SITE
- PW — PROPOSED WELL SITE
- STORMWATER POND 20X 30X 2'
- SLOPE
- GRADIENT DIRECTION
- PROPOSED SEPTIC SITE 3-85' TRENCHES 10' APART
- REPLACEMENT SITE 3-85' TRENCHES 10' APART
- 200' MIXING ZONE

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
By: [signature] Date: 11/16/05

SCALE
1 INCH = 200 FT.

Davis Surveying Inc.
TROY MONTANA, (406)295-5441

DATE: 8/2005
DRAWN BY: mlm
FILE: T36R26S6.DWG