County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/14/2017

Expiration Date: 9/14/2018

Property Owner: Royce Steele

~~c/o:~~ phys. add: [redacted]

mailing Address: PO BOX 1208, ~~Troy~~ Libby MT, 59935 23

Telephone: (Home) [redacted] (Work)

Installer: Talley Hoe

License No. 1

no E

___ New Installation xx Existing System

___ Repair xx Replacement ___ Extension ___ Other

Describe: Installing septic tank and two drywells to replace old system

Parcel Description:

Legal: S30 T31 R33

Address or Location: CS 1909 Parcel A

Geo/Assessors code: 0000012597

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 2 drywells

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J. Cole, *have inspected this system and found it to be in compliance with the conditions of the permit and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 9/23/2017

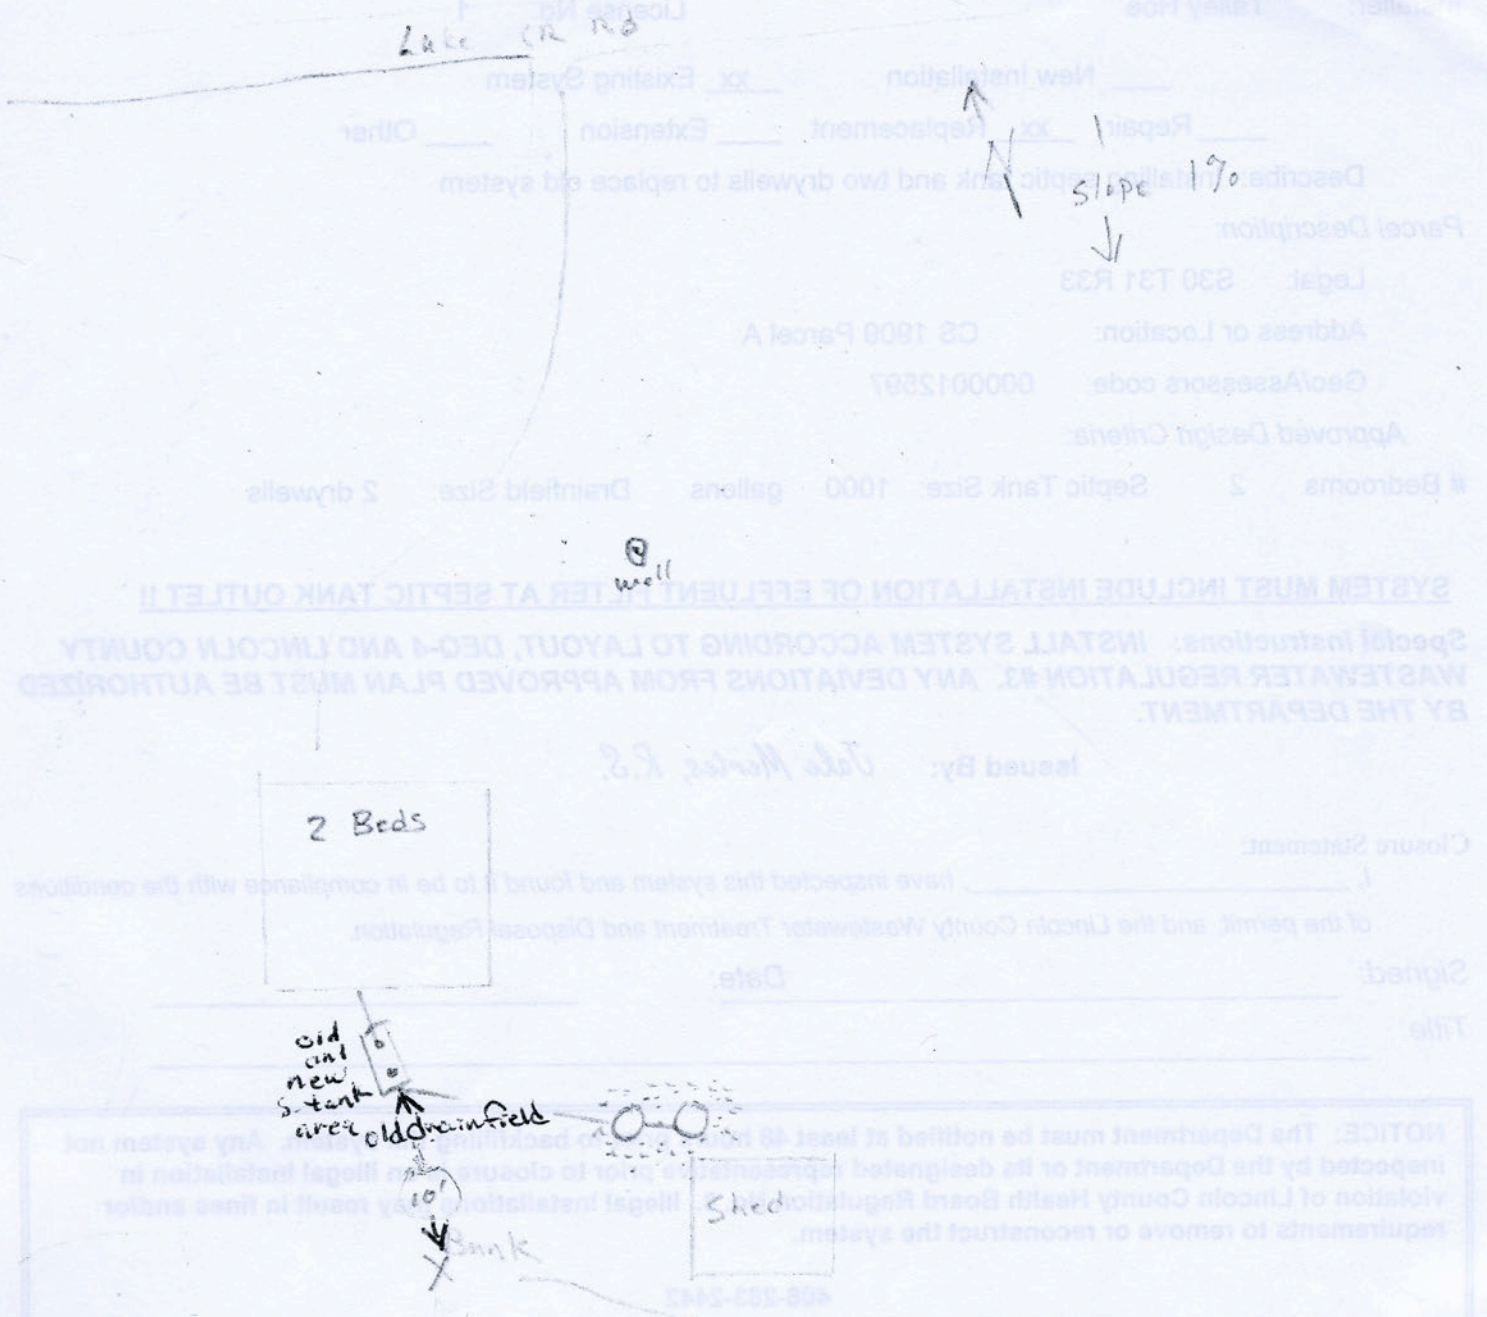
Title: owner/operator of Talley Hoe

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lake
CR Rd
N
slope 1%
well
2 Beds
old
and
new
S-tank
area
old drainfield
10'
Bank
Shed