County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/22/2019

Expiration Date: 7/22/2020

Property Owner: Rosie Strope

c/o: Tom Cole

Address: [redacted]

Telephone: (Home)

(Work)

Installer: Talley Hoe

License No. 1

___ New Installation ___xx___ Existing System

____ Repair ___xx___ Replacement ____ Extension ____ Other

Describe: 32' x 14' absorption bed with gravelless chambers and new 1000 gallon tank.

Parcel Description:

Legal: S32 T31 R31

Address or Location: CS 3333 Parcels A & B or Tracts 10 & 11

Geo/Assessors code: 0000008513

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 448 Sq Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 7-24-2019

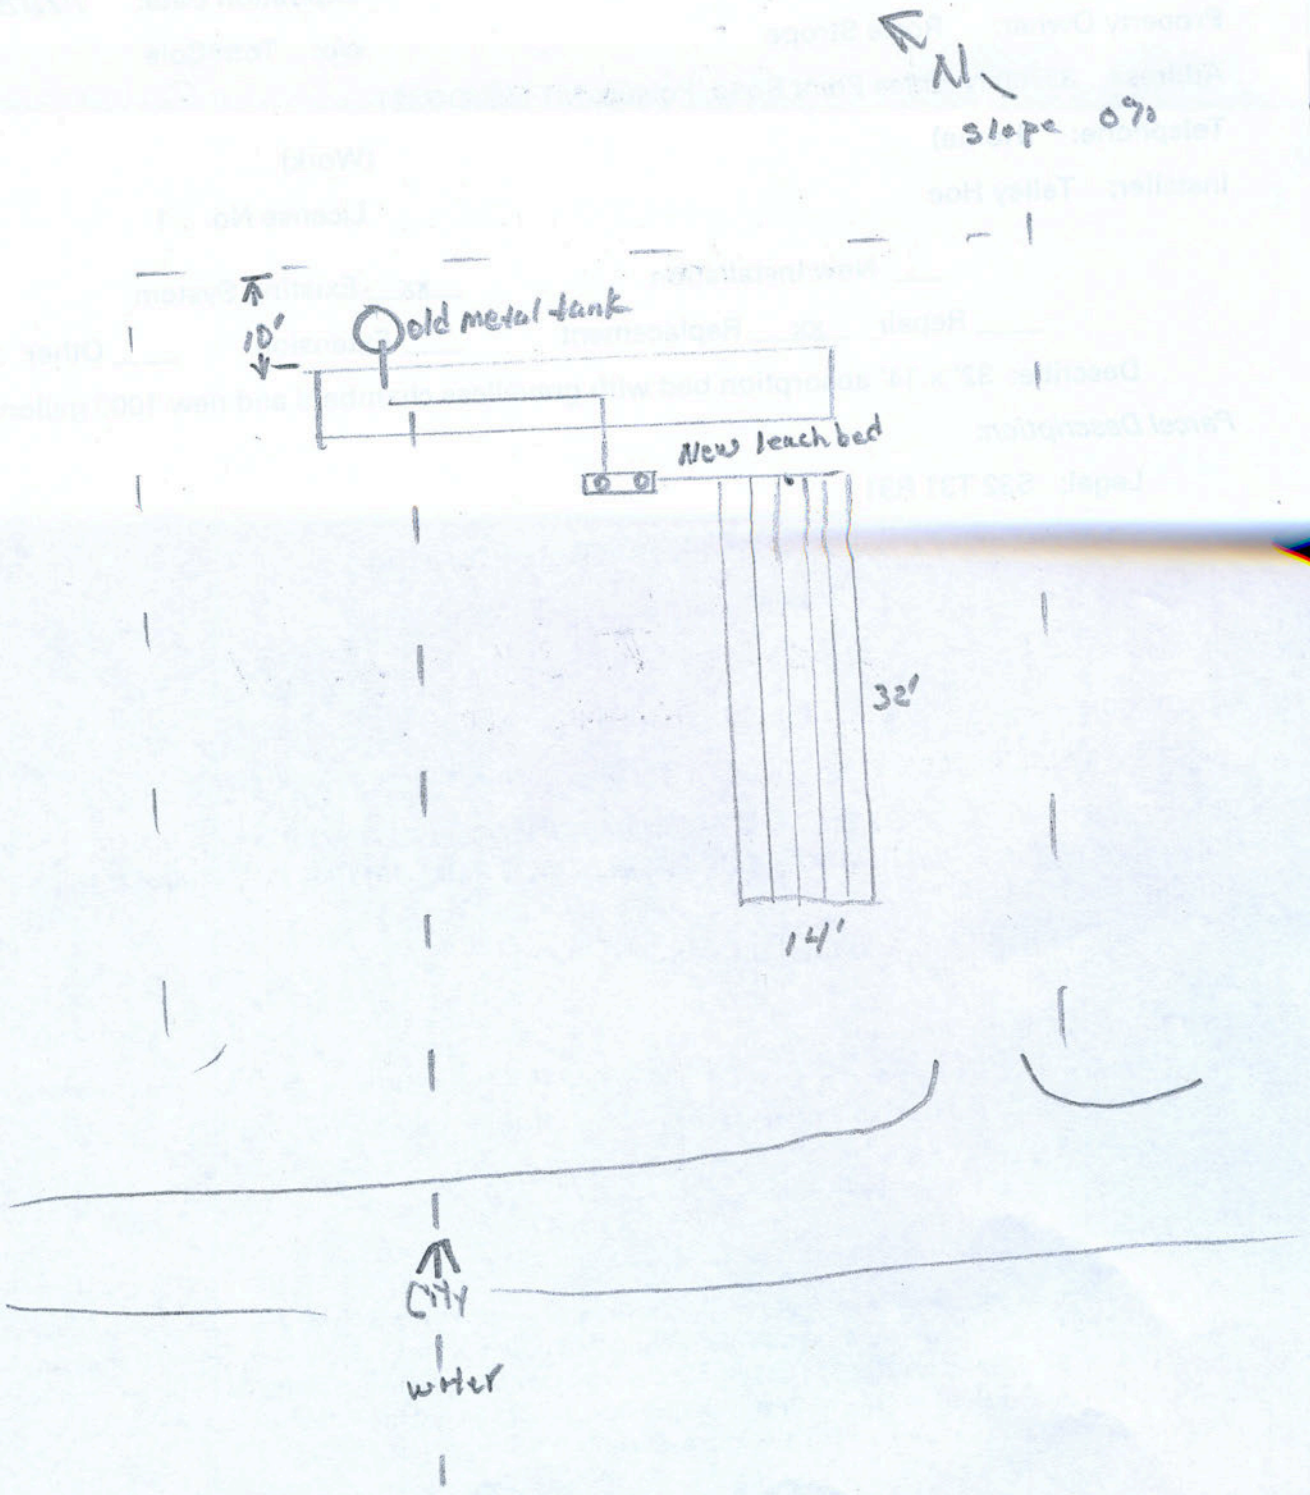
Title: owner/operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
slope 0%
10'
old metal tank
New leach bed
32'
14'
City
water