LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/30/2019 Expiration Date: 5/30/2020

Property Owner: Donald Taggart c/o: Keith Mack

Address: [redacted]

Telephone: (Home) (Work)

Installer: Keith Mack License No. 111

__xx__ New Installation ____ Existing System

____ Repair _____ Replacement ____ Extension ____ Other

Describe: Two 68' pressure dosed laterals using 3' wide gravelless chambers house and shop

Parcel Description:

Legal: S09 T32 R34

Address or Location: Wild River Estates Lot 3A

Geo/Assessors code: 0000020978

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500x2 gallons Drainfield Size: 255 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Keith Mack, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: K L Mack *Date:* 6-10-19

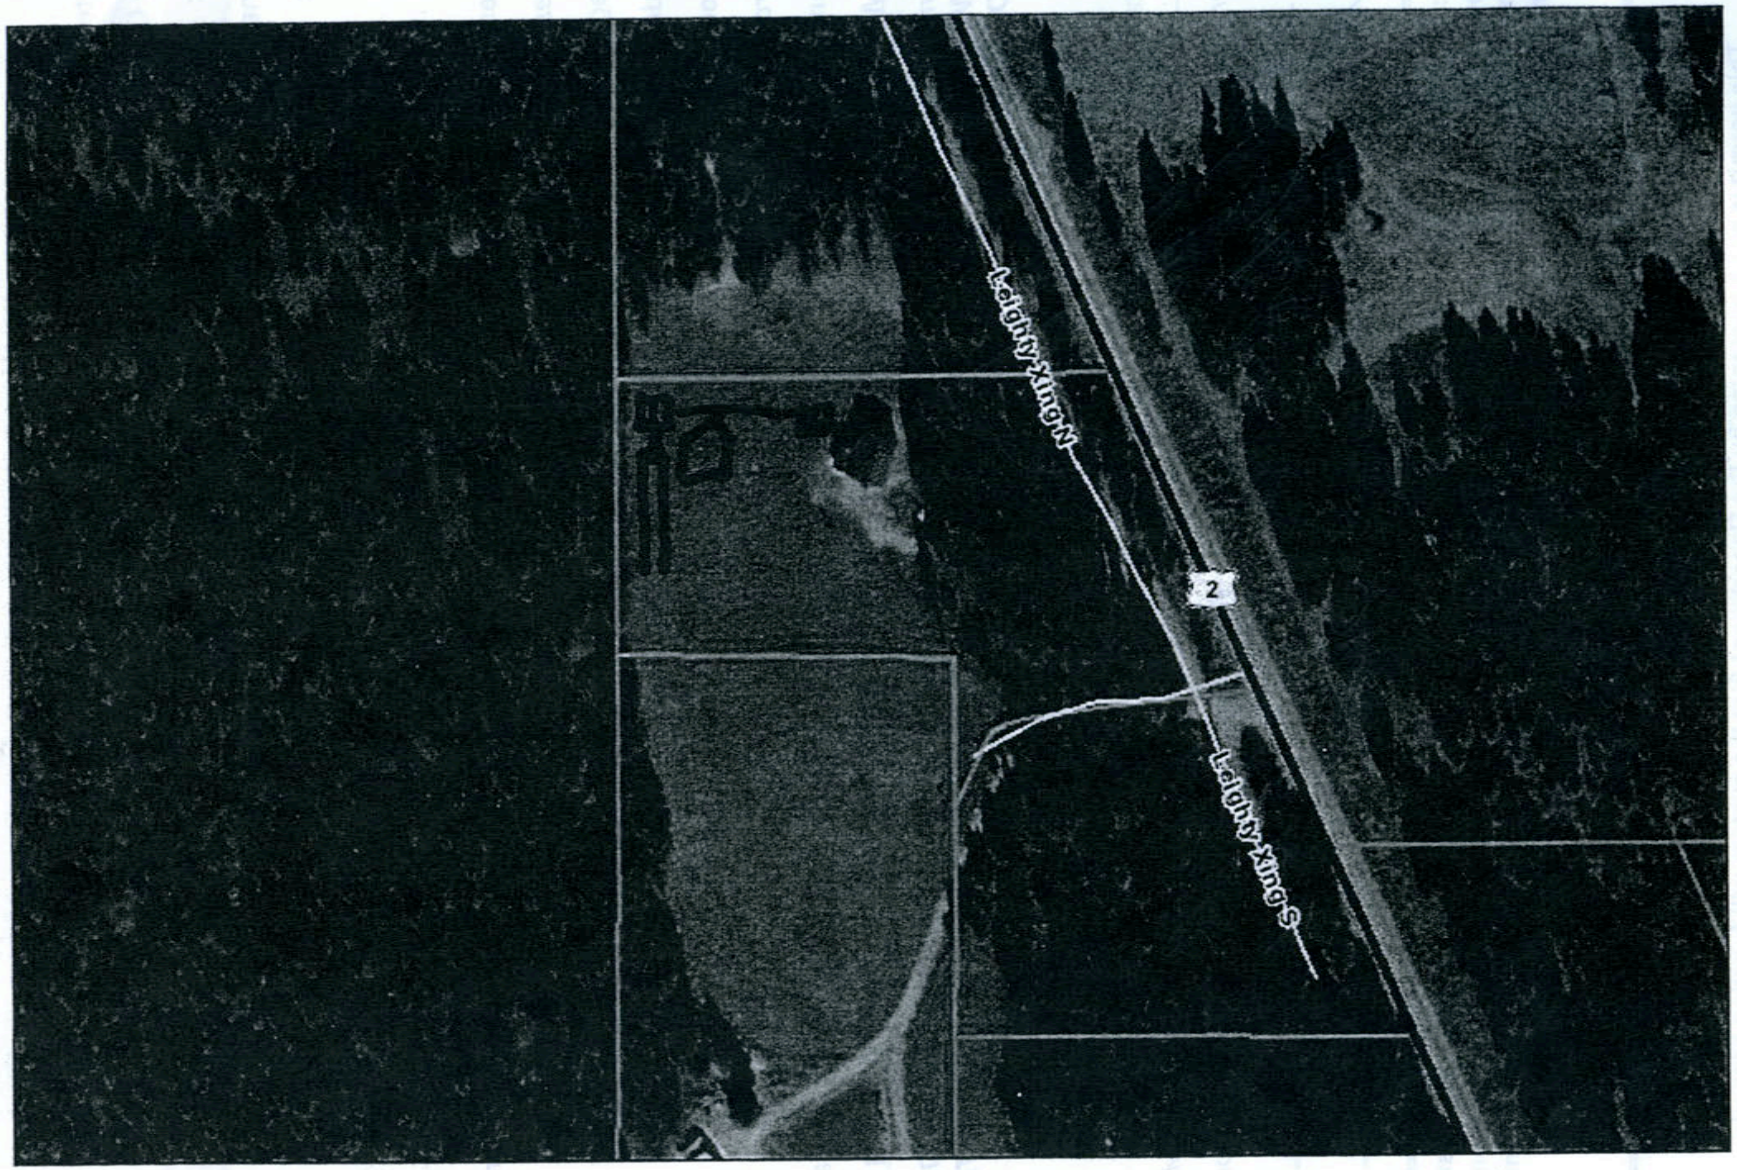
Title: Mack Excavating Owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Leahy Xing N
2
Leahy Xing S