file

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/24/06 Expiration Date: 7/23/07

Property Owner: Dona Taylor c/o:

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Renkema2 License No. 78

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe: Sand-lined drainfield, hair filters on all drains

Parcel Description:

Legal: S13 T37N R27W

Address or Location: Parcel A, Taylor Boundary-line Adjustment

Approved Design Criteria: Proposed use – Animal Shelter

Max Discharge: 458 gpd Septic Tank Size: 1500 gallons Drainfield Size: 240 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SAND-LINED SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Marquardt & Marquardt Surveying
Kalispell, Mt

name- Taylor Boundary-line Adjustment
county- Lincoln
SW location- NW sec. 13 -T37N-R27W
drawn by-Brian S. Launius
E.Q.# 02-2178

RECEIVED
OFFICE
MAR 29 2002
MT DEPT OF ENV QUALITY
PERMITTING & COMPLIANCE DIV

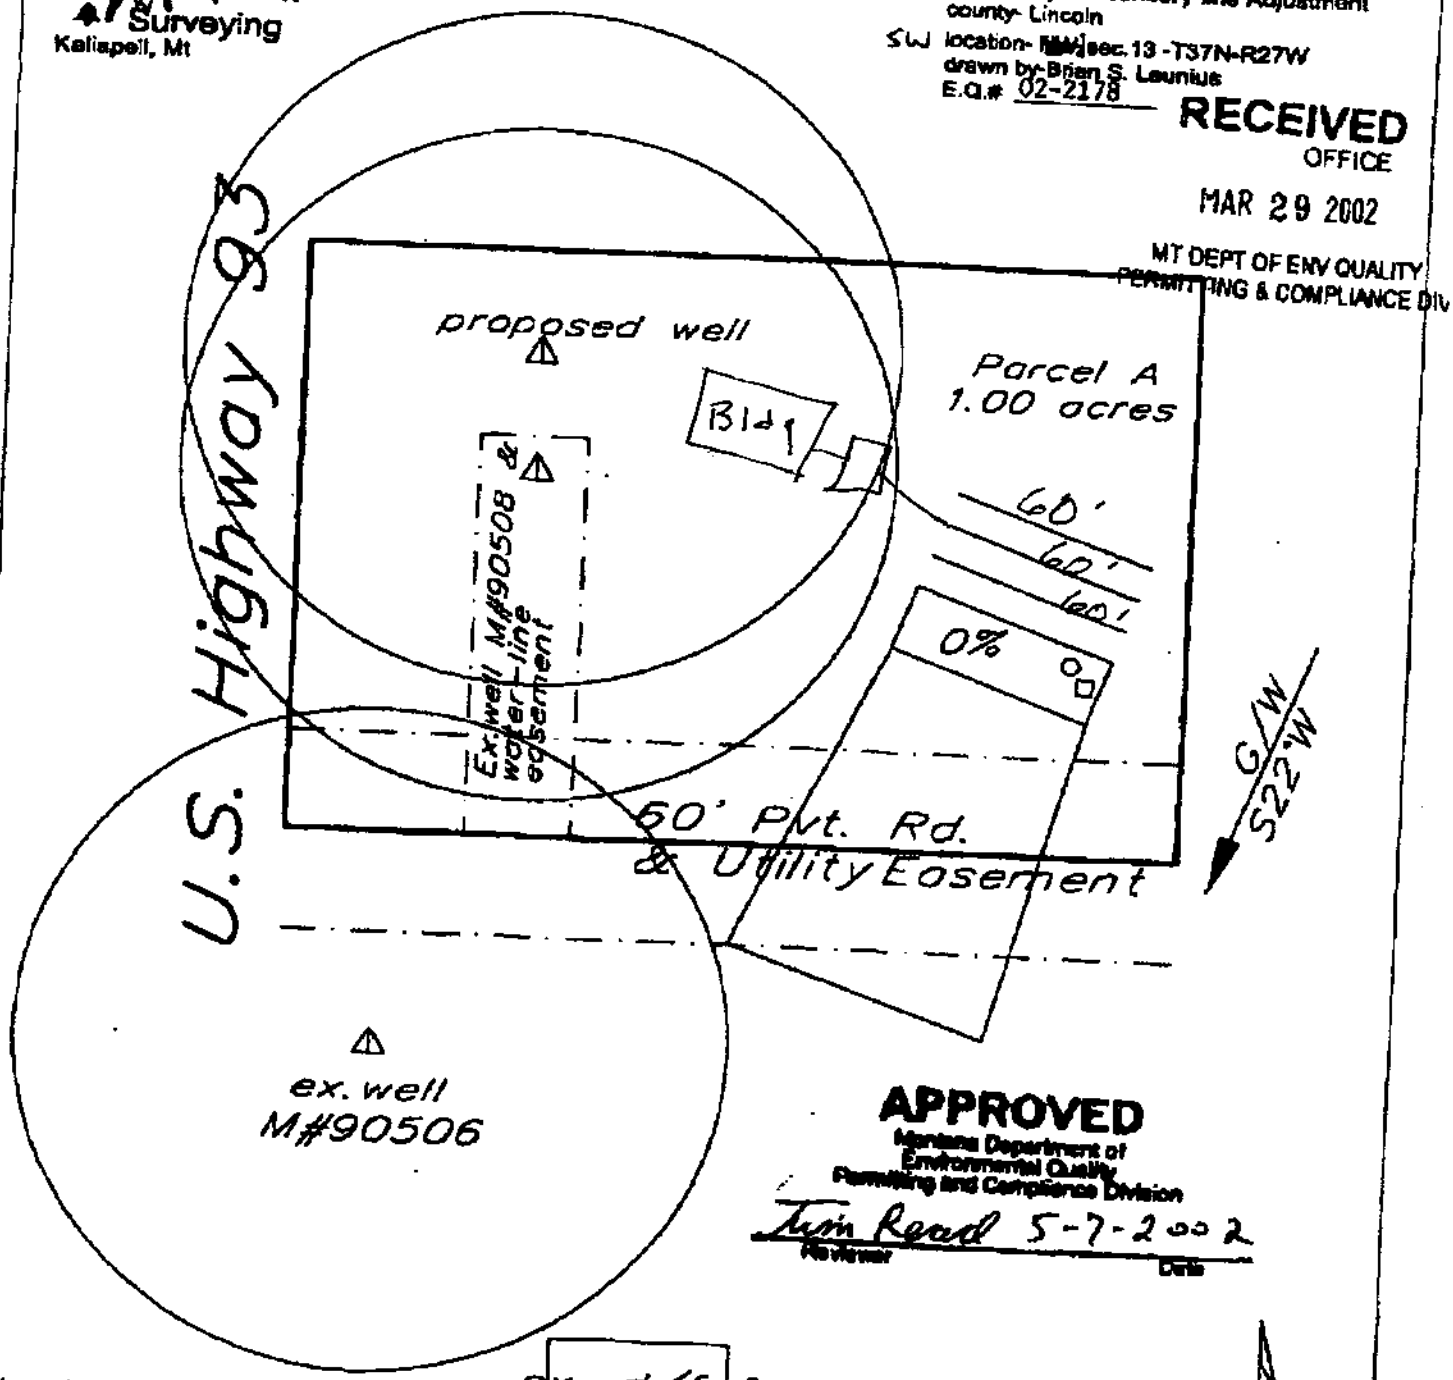

APPROVED
Montana Department of Environmental Quality
Permitting and Compliance Division
Tim Read 5-7-2002
Reviewer Date

Legend
- perc test
- test hole
- well site w/100' isolation zone
- drainfield site
- replacement area
- mixing zone

ex. d/f & replacement area-Lot 1 of Independence Prairie Subdivision-E.O.#99-1286

N

SCALE- 1"= 50'