LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/2/2019 Expiration Date: 5/2/2020

Property Owner: Will Thompson c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Oedewalt Const. License No.

__xx__ New Installation ____ *Existing System*

____ Repair ____ Replacement Extension Other

Describe: Two 75' laterals using gravelless chambers.

Parcel Description:

Legal: S33 T31 R31

Address or Location: Nolan Acres Lot 3

Geo/Assessors code: 0000009033

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

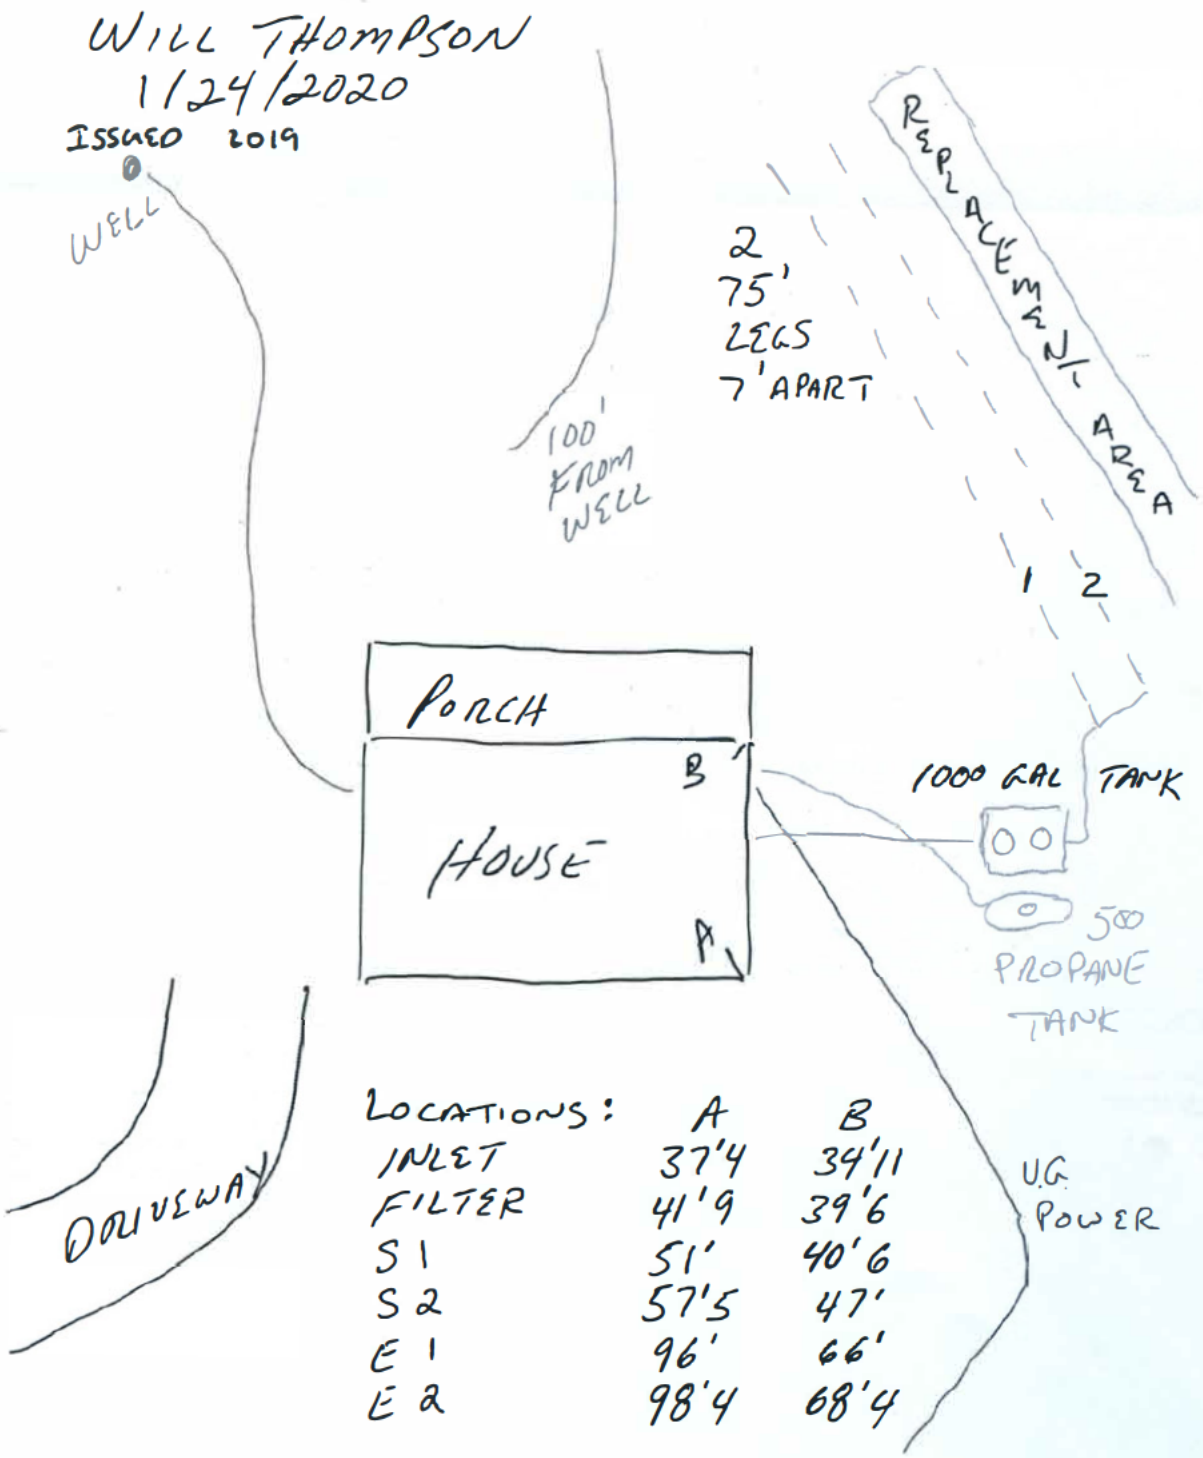
Signed: _____ *Date:* 1/24/2020

Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


WILL THOMPSON
1/24/2020
ISSUED 2019
WELL
100' FROM WELL
2 75' LEGS 7' APART
REPLACEMENT AREA
1 2
PORCH
HOUSE
B
A
1000 GAL TANK
500 PROPANE TANK
DRIVEWAY
U.G. POWER
LOCATIONS: A B
INLET 37'4 34'11
FILTER 41'9 39'6
S1 51' 40'6
S2 57'5 47'
E1 96' 66'
E2 98'4 68'4