# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/3/2018 Expiration Date: 7/3/2019

Property Owner: Tobias Todd c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Self License No.

___ New Installation ____ Existing System

__XX_ Repair__xx__ Replacement ____ Extension ____ Other

Describe: Three 62' laterals using drain rock and perf pipe.

*Parcel Description*:

Legal: S29 T31 R33

Address or Location: School House Lake COS 1104 Parcel A

Geo/Assessors code: 0000012731

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 187 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, Dustin Wicks, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* [signature] *Date:* 7-10-18

*Title:* _____

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


PARCEL 3 SCHOOLHOUSE LAKE
IN SE¼, SEC 29, T31N, R33 W,
NEAR TROY, LINCOLN CTY, MT.

UNDEVELOPED PARCEL

APPROVED RECEIVED

Water Quality Bureau
Montana Department of Health JAN 7 1983
and Environmental Sciences
MONTANA DEPT. OF HEALTH & ENV. SCIENCES
WATER QUALITY BUREAU

Project Officer Date

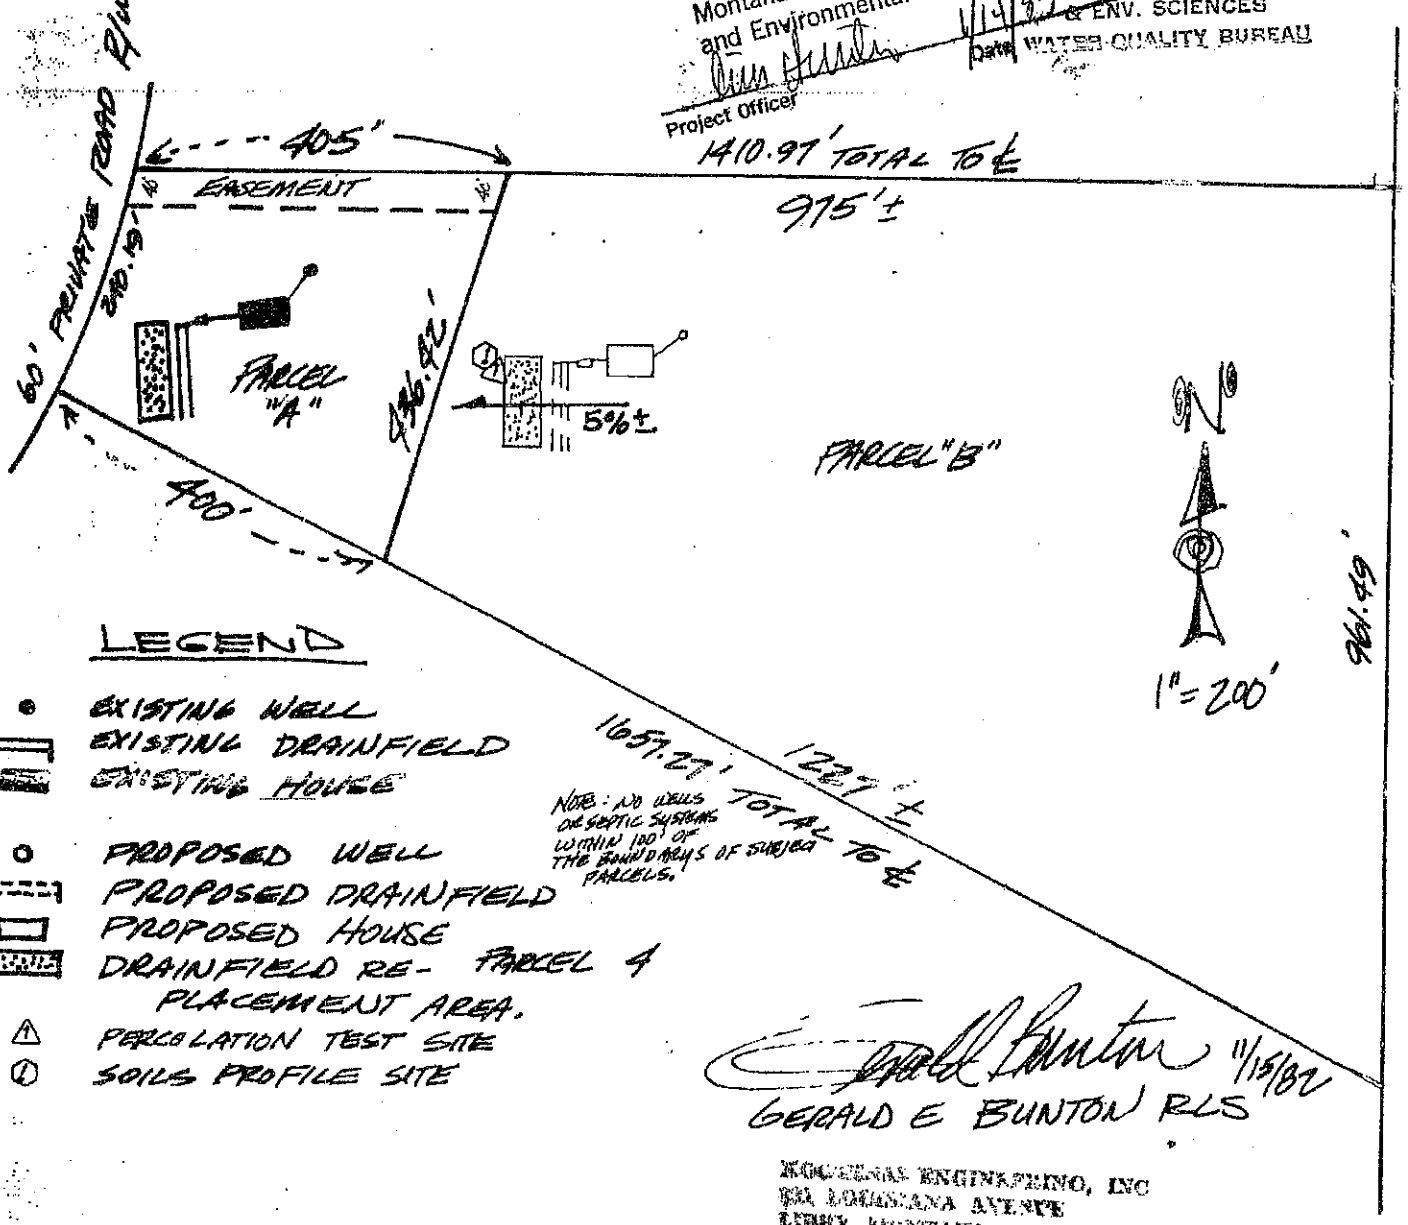


LEGEND

- EXISTING WELL
- EXISTING DRAINFIELD
- EXISTING HOUSE
- PROPOSED WELL
- PROPOSED DRAINFIELD
- PROPOSED HOUSE
- DRAINFIELD RE-PLACEMENT AREA.
- PERCOLATION TEST SITE
- SOILS PROFILE SITE

NOTE: NO WELLS OR SEPTIC SYSTEMS WITHIN 100' OF THE BOUNDARYS OF SUBJECT PARCELS.

PARCEL 4

Gerald E Bunton 11/15/82
GERALD E BUNTON RLS

BUNTON ENGINEERING, INC
[illegible] LOUISIANA AVENUE
LIBBY, MONTANA 59923
406-293-7721