LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/26/2018 Expiration Date: 12/26/2019

Property Owner: Ben Traina c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 75' pressure dosed laterals in 3' wide trenches using gravelless chambers.

Parcel Description:

Legal: S25 T36 R26

Address or Location: COS 1011 Tract 4A

Geo/Assessors code: 000010482

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1500/500 gallons Drainfield Size: 225 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 6/18/19

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REVISIONS			
REV	DESCRIPTION	BY/DATE	APRD/DATE

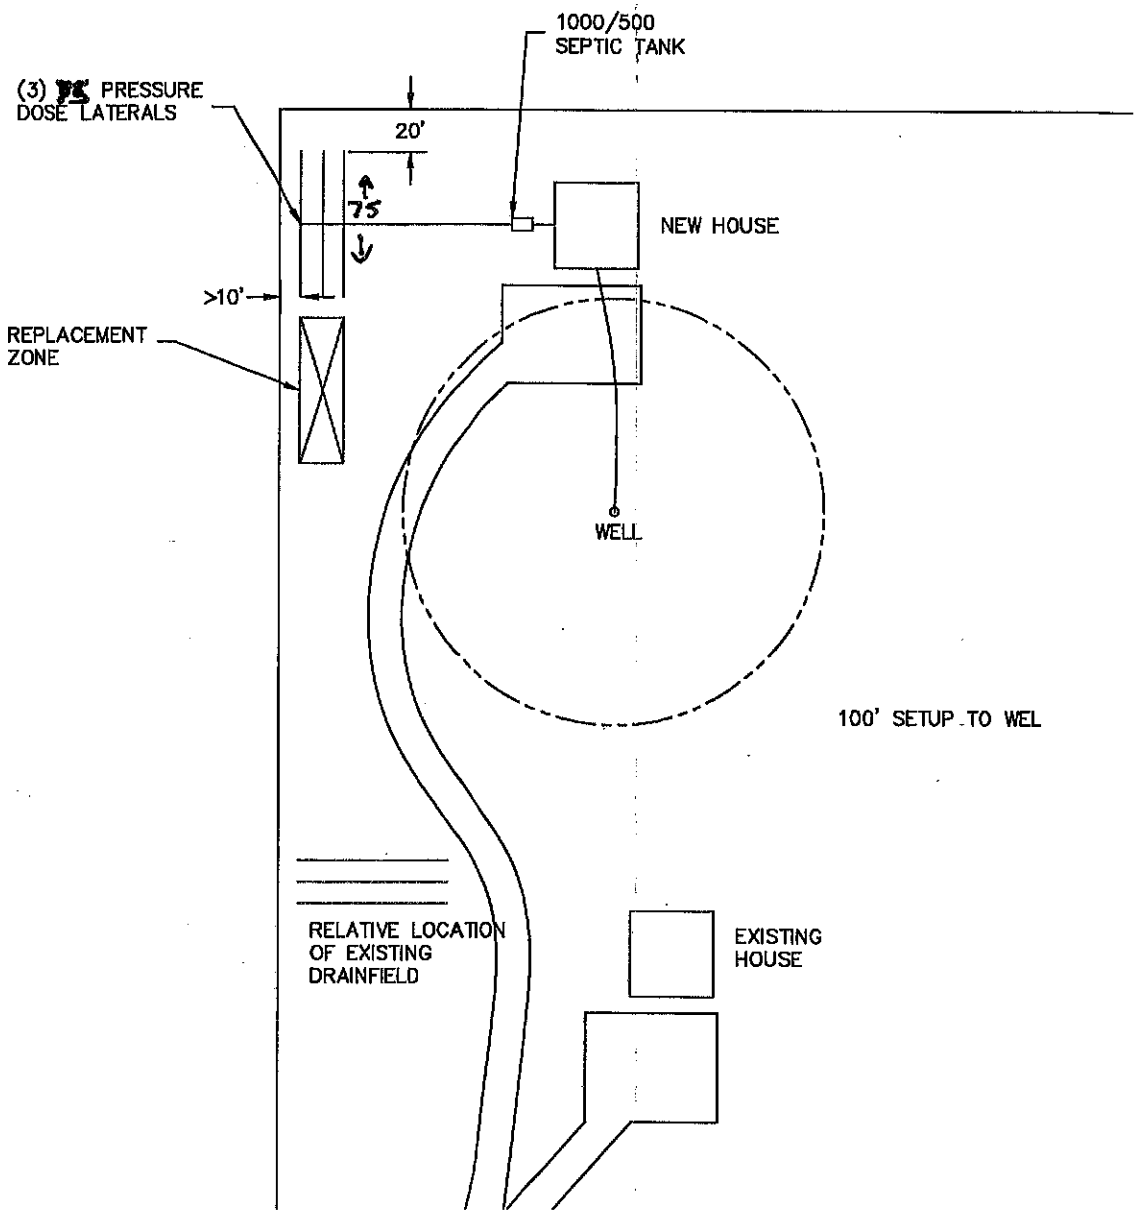

REV	DATE	COMPANY	SCALE:	HORIZON DESIGN SERVICES, INC.	KOOCANUSA EXCAVATING TRAINA SITE LAYOUT
		KEI	1/16 & NOTED	P.O. BOX 1807 BANDON, OR 97411	SEPTIC PERMIT
		CONTRACT:	DATE:	DWG TOLERANCES:	DRAWN BY: DATE:
		05818	12/1/18	.xx= +/- .03" .xxx= +/- .010" 1/2 .xxx= +/- .005"	SUCHEKOMEPHOMA 12/6/18
		PLOT FILE:	WEIGHT	FINISH	APPROVED BY: DATE APPROVED:
		PML-0001	---		B. TRAINA 12/6/18
					SHEET TITLE: SHEET NO.: TRAINA 1

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT