LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/15/2018 Expiration Date: 10/15/2019

Property Owner: USACE c/o: David Haddick

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Thompson Contracting License No. 73

__xx__ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 64' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S33 T31 R29

Address or Location: Libby Dam East

Geo/Assessors code: 0009352100

Approved Design Criteria:

150 gal/day Septic Tank Size: 1000 gallons Drainfield Size: 128 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Levi Thompson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 4/12/19

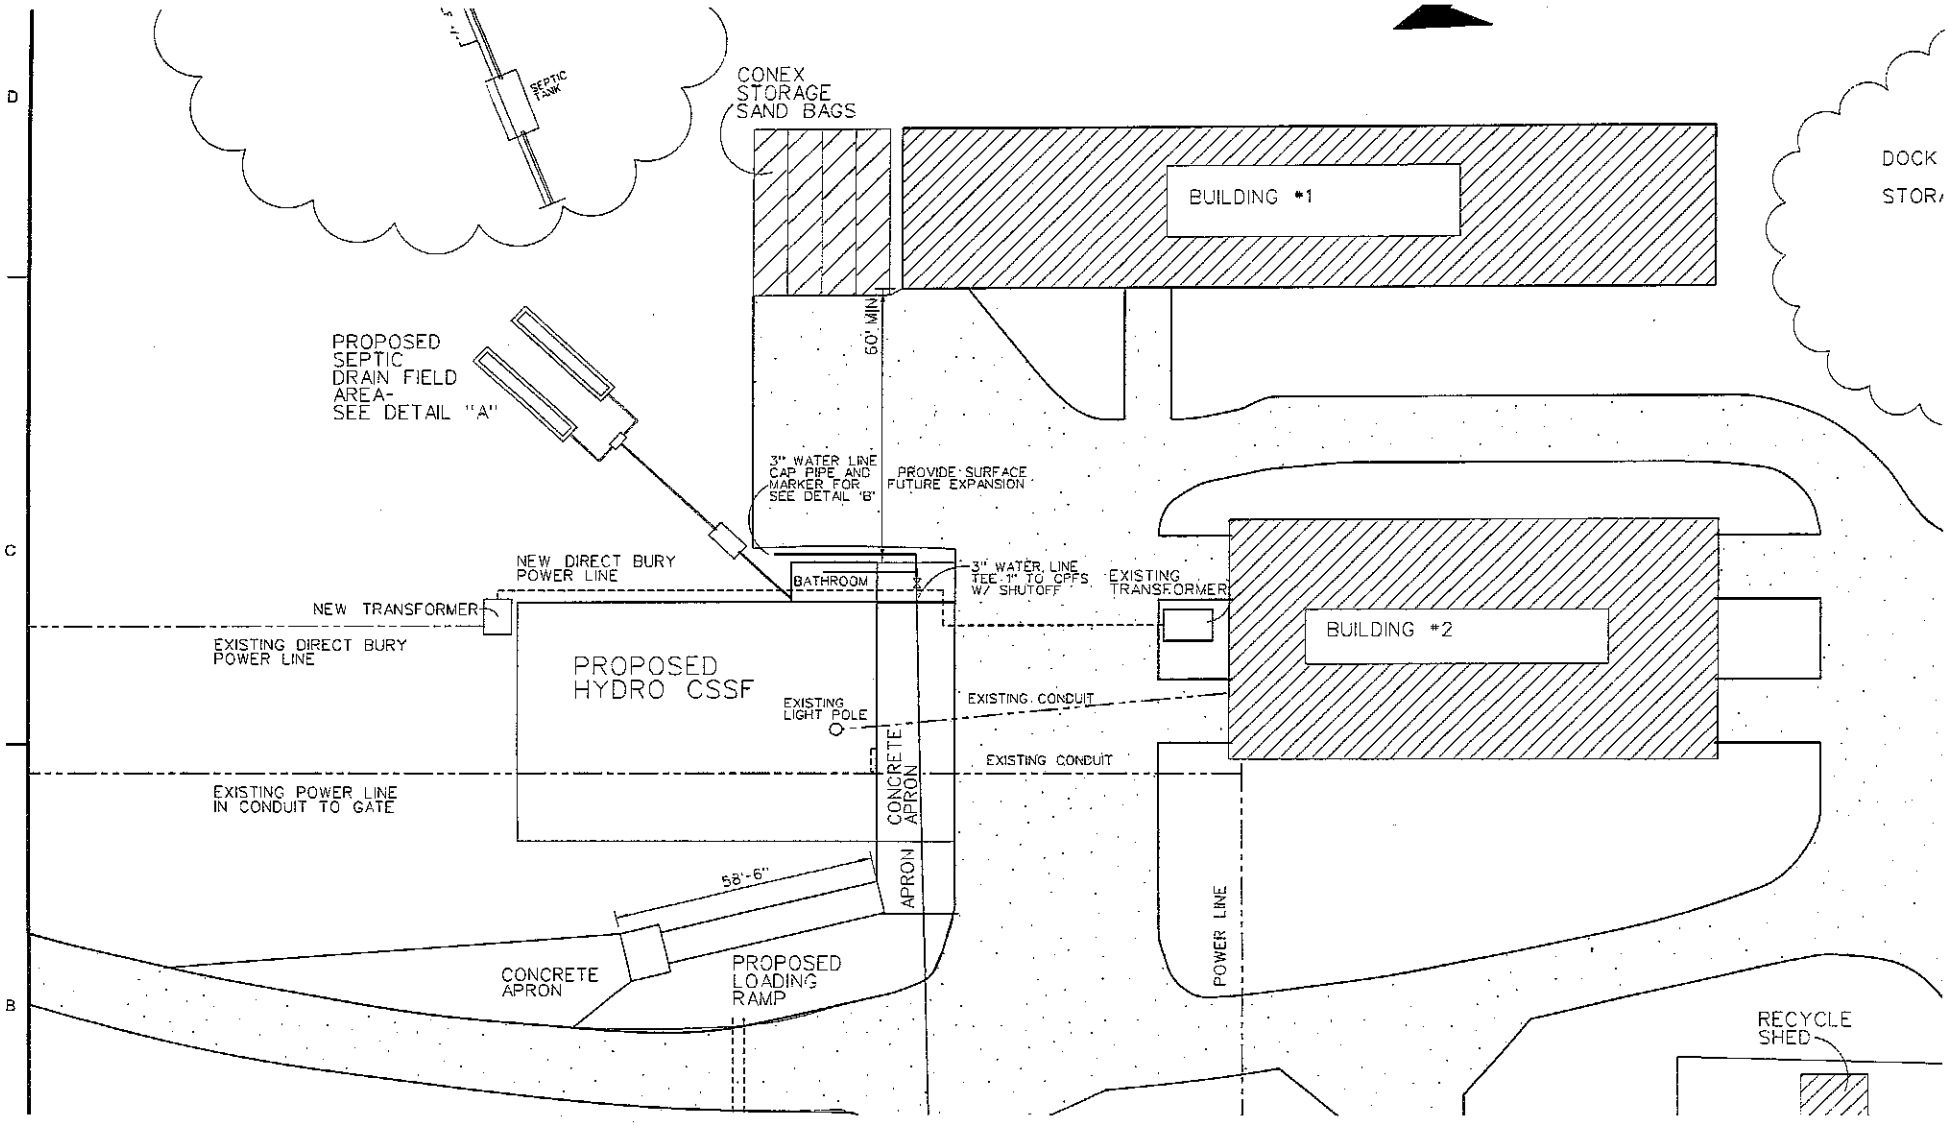
Title: VP of TCI

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


SEPTIC TANK
CONEX STORAGE SAND BAGS
BUILDING #1
DOCK
STOR
PROPOSED SEPTIC DRAIN FIELD AREA- SEE DETAIL "A"
60' MIN
3" WATER LINE CAP PIPE AND MARKER FOR SEE DETAIL "B"
PROVIDE SURFACE FUTURE EXPANSION
NEW DIRECT BURY POWER LINE
BATHROOM
3" WATER LINE TEE 1" TO OFFS W/ SHUTOFF
EXISTING TRANSFORMER
NEW TRANSFORMER
EXISTING DIRECT BURY POWER LINE
PROPOSED HYDRO CSSF
BUILDING #2
EXISTING LIGHT POLE
EXISTING CONDUIT
EXISTING CONDUIT
EXISTING POWER LINE IN CONDUIT TO GATE
CONCRETE APRON
APRON
58'-6"
CONCRETE APRON
PROPOSED LOADING RAMP
POWER LINE
RECYCLE SHED
D
C
B