LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/17/2018 Expiration Date: 5/17/2019

Property Owner: Klaus VandeOever c/o: Koocanusa Plumbing

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Plumbing License No. 169

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 85' trenches using gravelless chambers for house and RV pad, size reduced.

Parcel Description:

Legal: S33 T36 R26

Address or Location: Glen Lake Hill South Lot 4B

Geo/Assessors code: 0000054507

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500 gallons Drainfield Size: 340 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, David Hull, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 6-5-18

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

RECEIVED

JAN 24 2018

MT DEQ PUBLIC WATER & SUBDIVISIONS

Name: Re-review of Amend. Plat
LOTS 4B & 4C of Glen lake Hill South
County: Lincoln
Location: NWNW1/4 sec.33-T36N-R26W
E.Q.# 18-1152

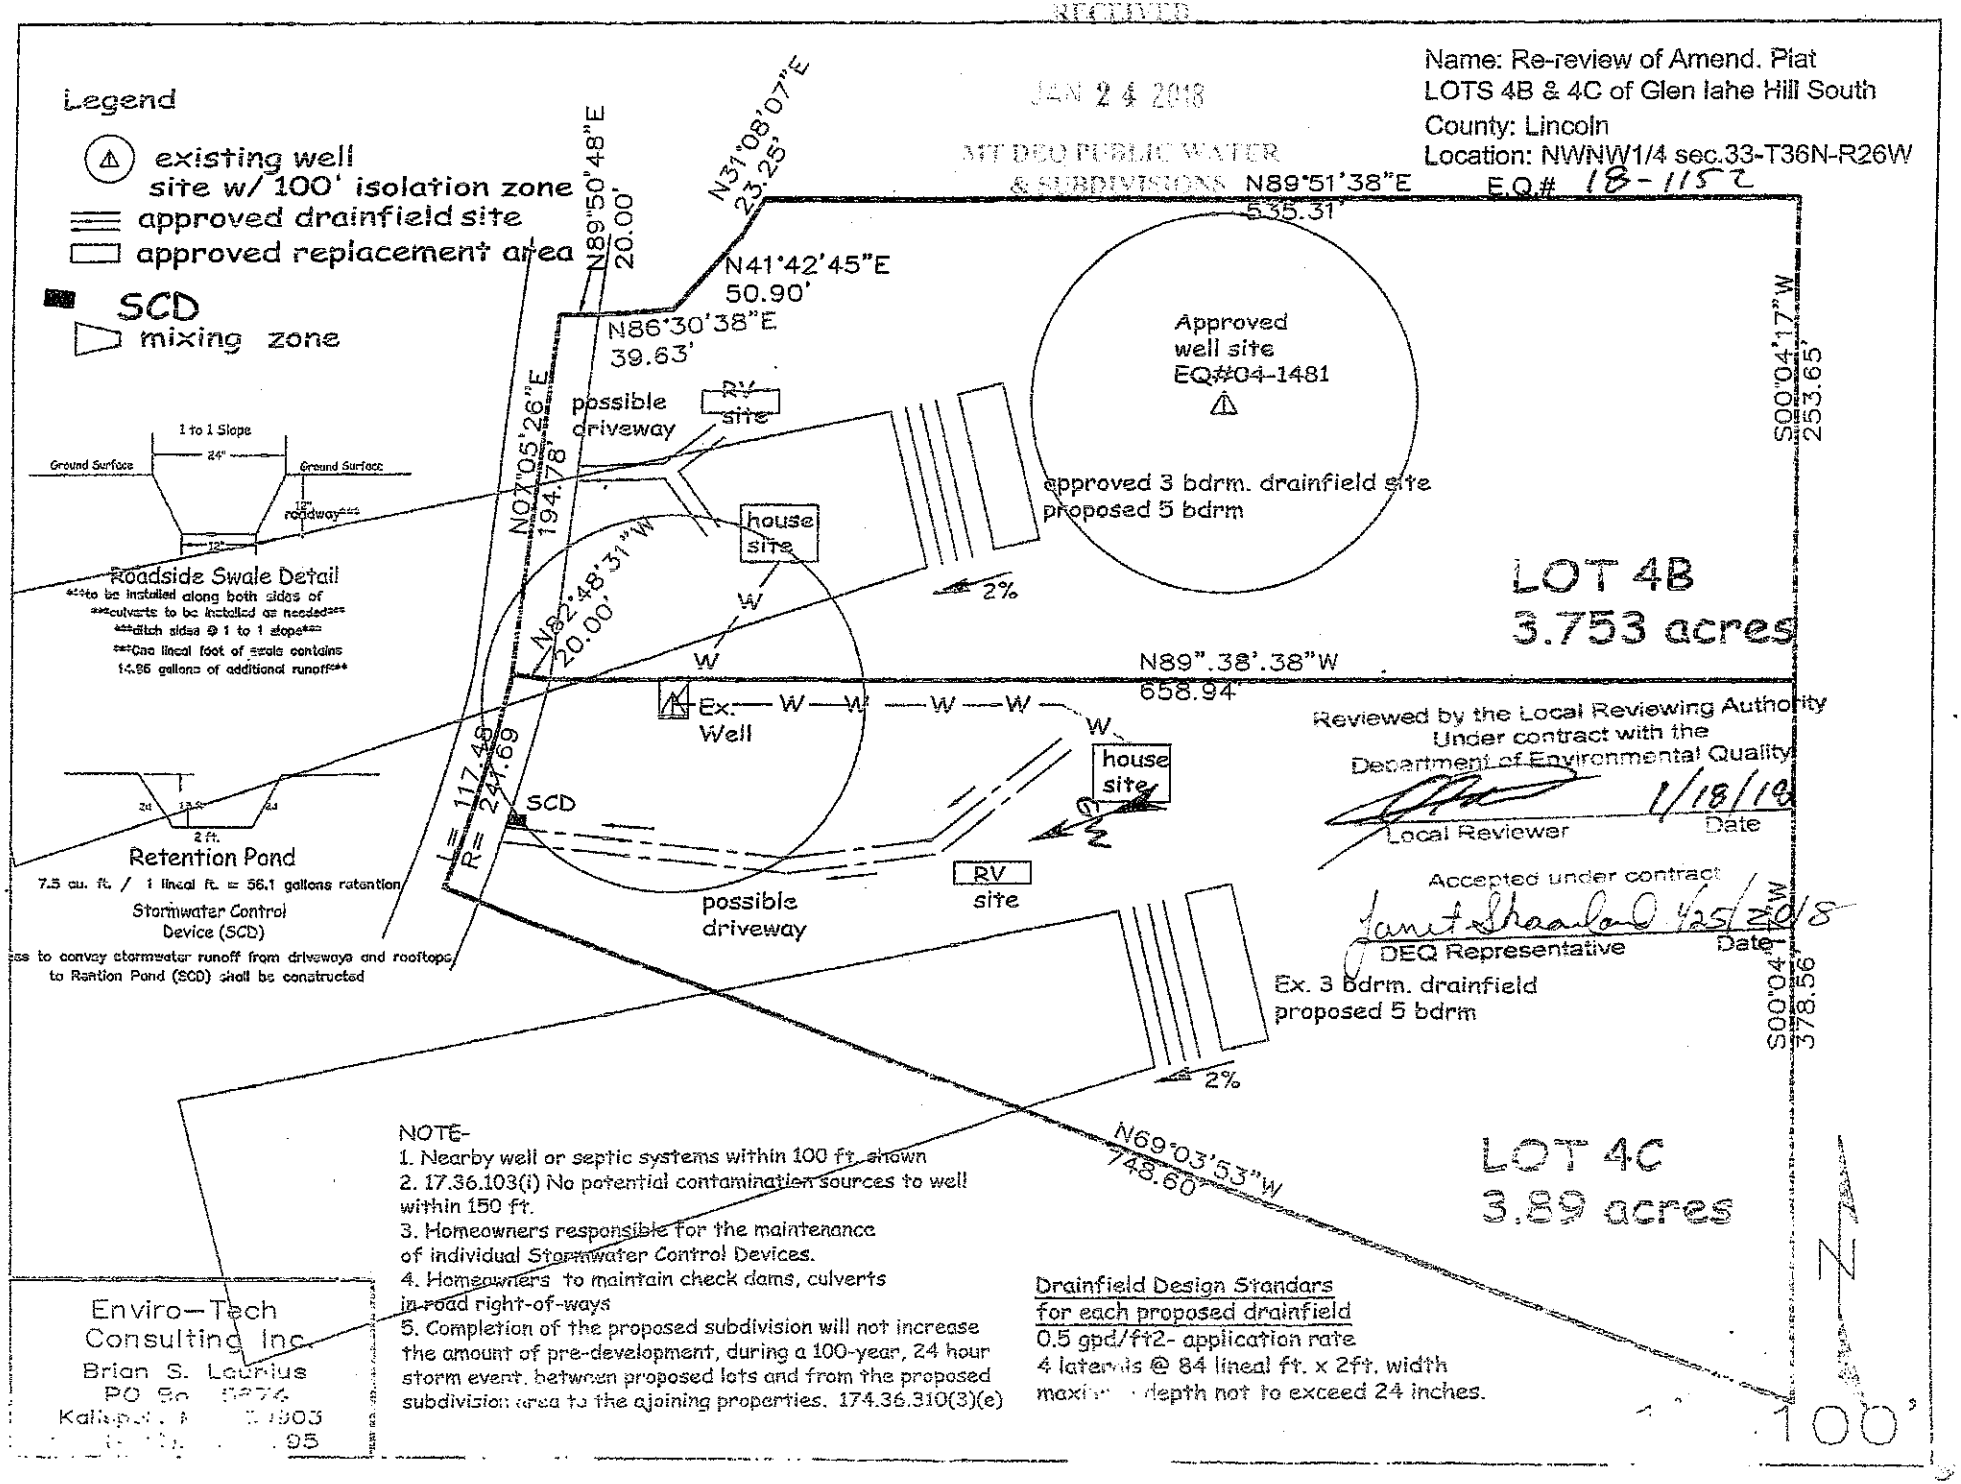

NOTE-
1. Nearby well or septic systems within 100 ft. shown
2. 17.36.103(i) No potential contamination sources to well within 150 ft.
3. Homeowners responsible for the maintenance of individual Stormwater Control Devices.
4. Homeowners to maintain check dams, culverts in road right-of-ways
5. Completion of the proposed subdivision will not increase the amount of pre-development, during a 100-year, 24 hour storm event, between proposed lots and from the proposed subdivision area to the ajoining properties. 174.36.310(3)(e)

Drainfield Design Standars
for each proposed drainfield
0.5 gpd/ft2- application rate
4 laterals @ 84 lineal ft. x 2ft. width
maximum depth not to exceed 24 inches.

Enviro-Tech
Consulting Inc.
Brian S. Laurius
PO Box 5974
Kalispell, MT 59903
406-755-7495