LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/16/2017 Expiration Date: 3/16/2018

Property Owner: Bob Vignali c/o: Chuck Riley

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Chuck Riley License No. 147

____ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Four 64' laterals using gravelless chambers, size reduced per 0.5 app rate

Parcel Description:

Legal: S2 T31 R31

Address or Location: MCLAREN TRACTS Lot 8-9

Geo/Assessors code: 0000003032

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

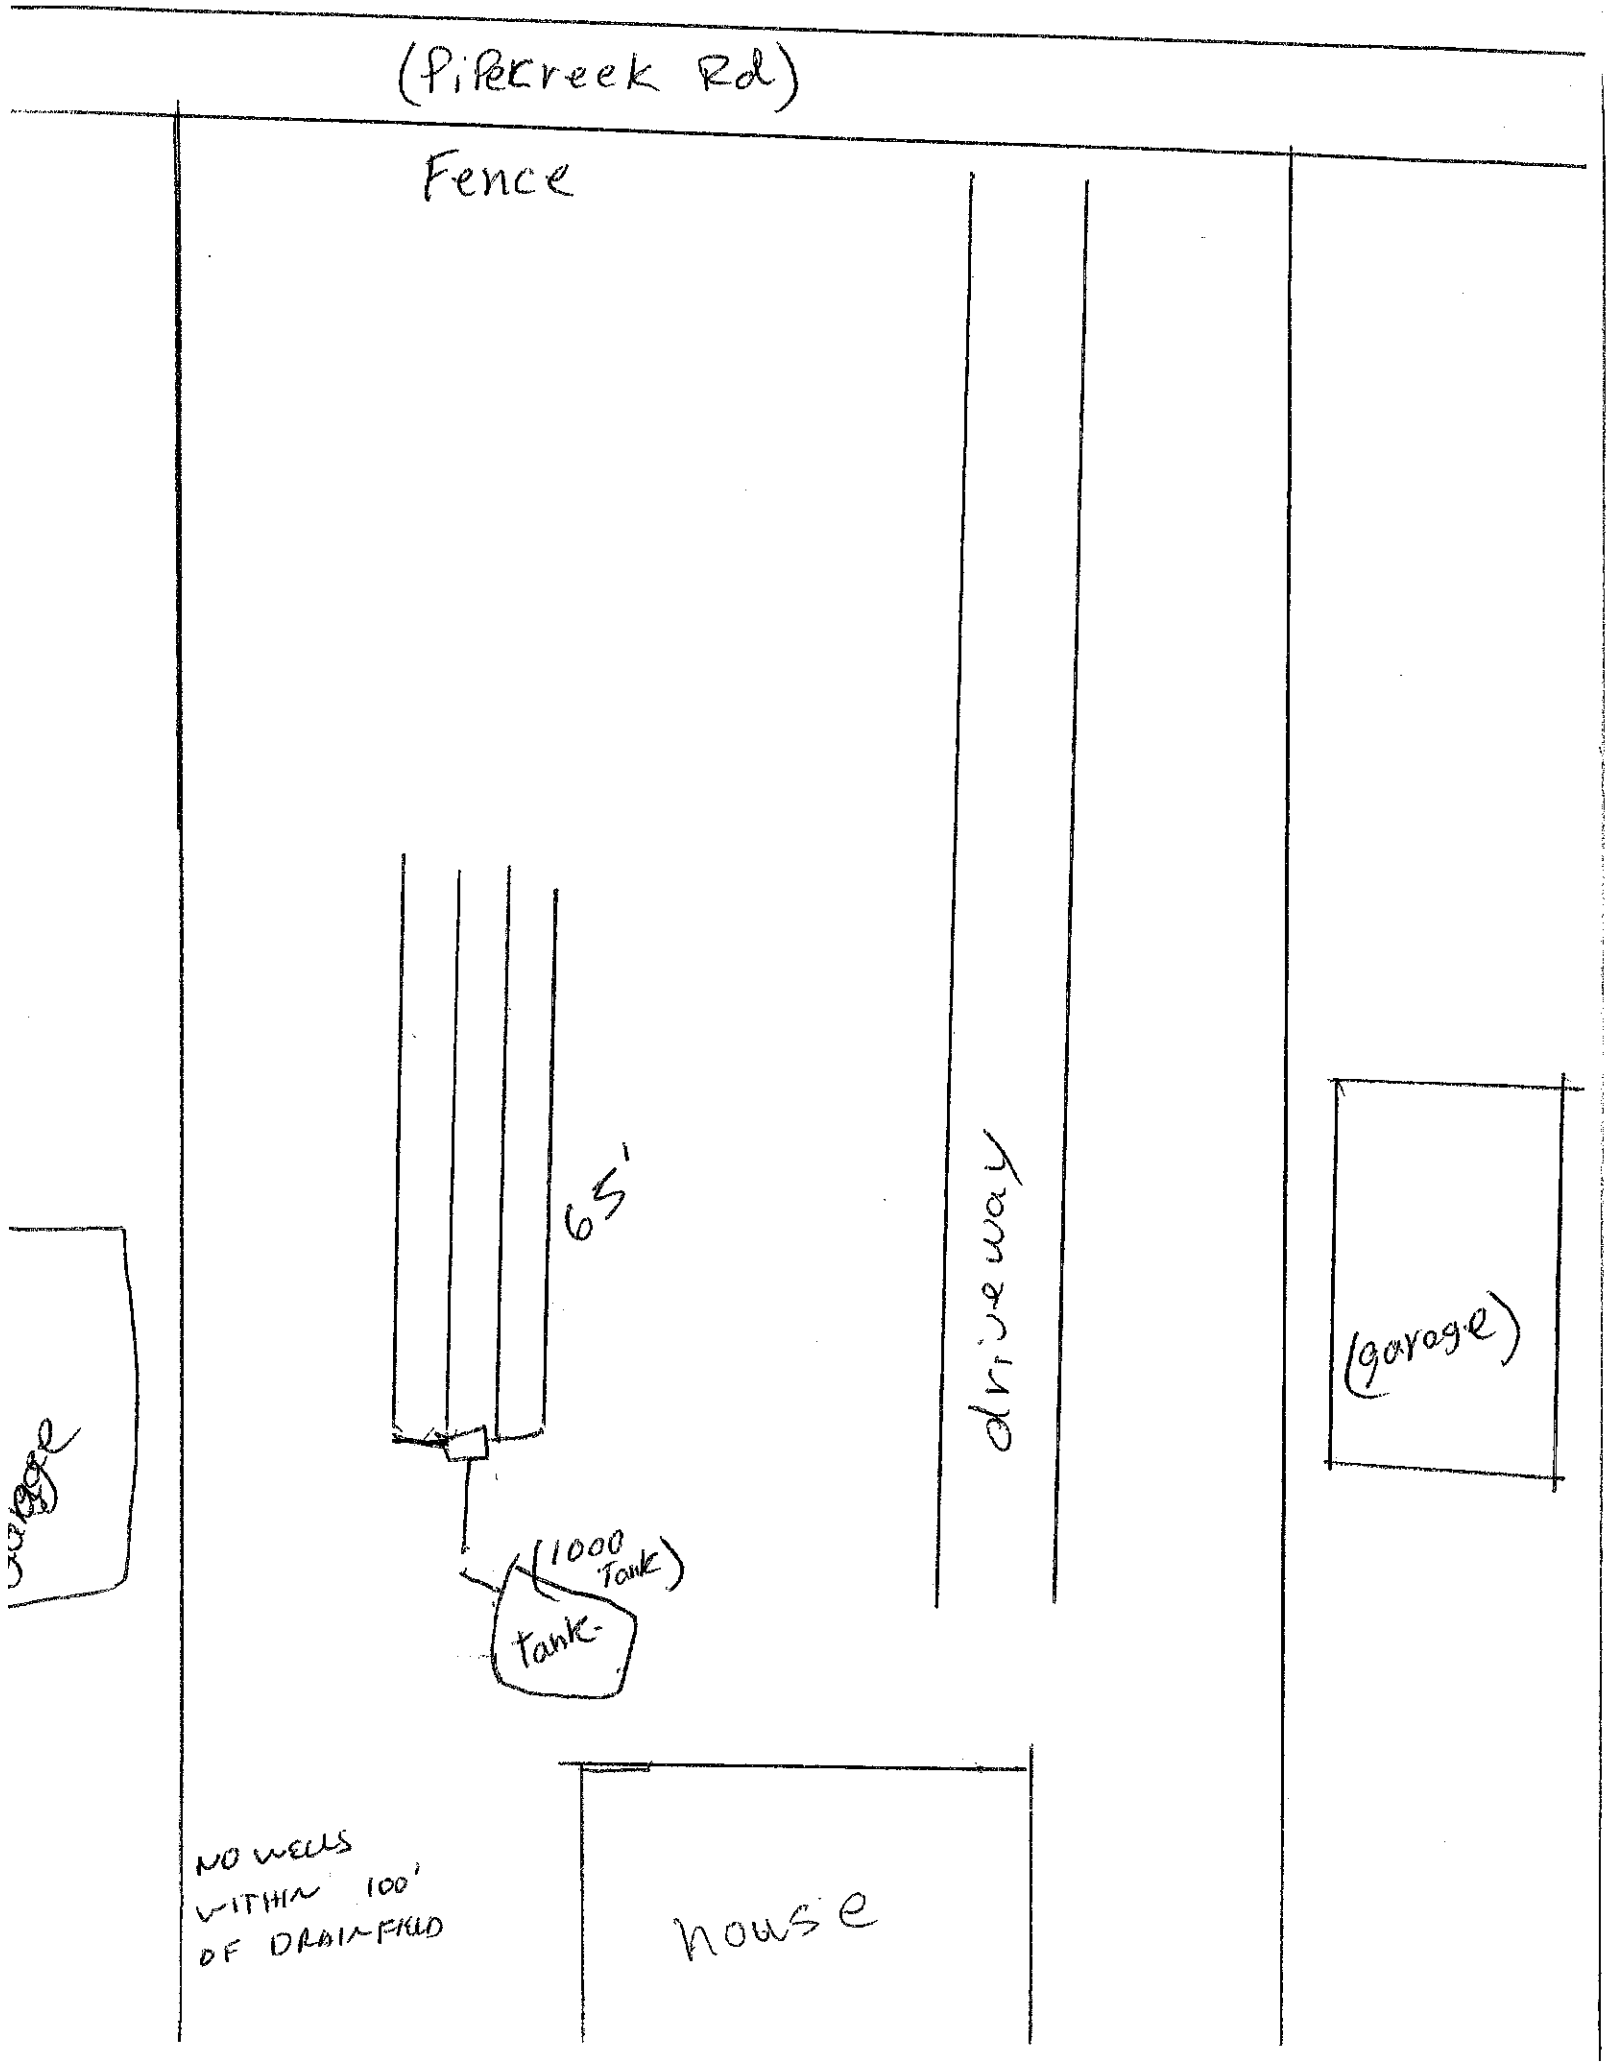
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


(Pikcreek Rd)
Fence
65'
driveway
(garage)
(1000 Tank)
Tank
NO WELLS WITHIN 100' OF DRAINFIELD
house