LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/1/2017 Expiration Date: 9/1/2018

Property Owner: Paul Wachholz c/o: Darwin Pluid

Address: PO BOX 1477, Kalispell, MT 59903

Telephone: (Home) (Work)

Installer: Darwin Pluid License No. 164

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 100' laterals using gravelless chambers.

Parcel Description:

Legal: S14 T37 R27

Address or Location: Velvet Grove Subdivision Lot 3

Geo/Assessors code: 0000059763

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement: I, Darwin Pluid, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Darwin Pluid Date: 10/11/17

Title: Earth Works Owner Lisc # 164

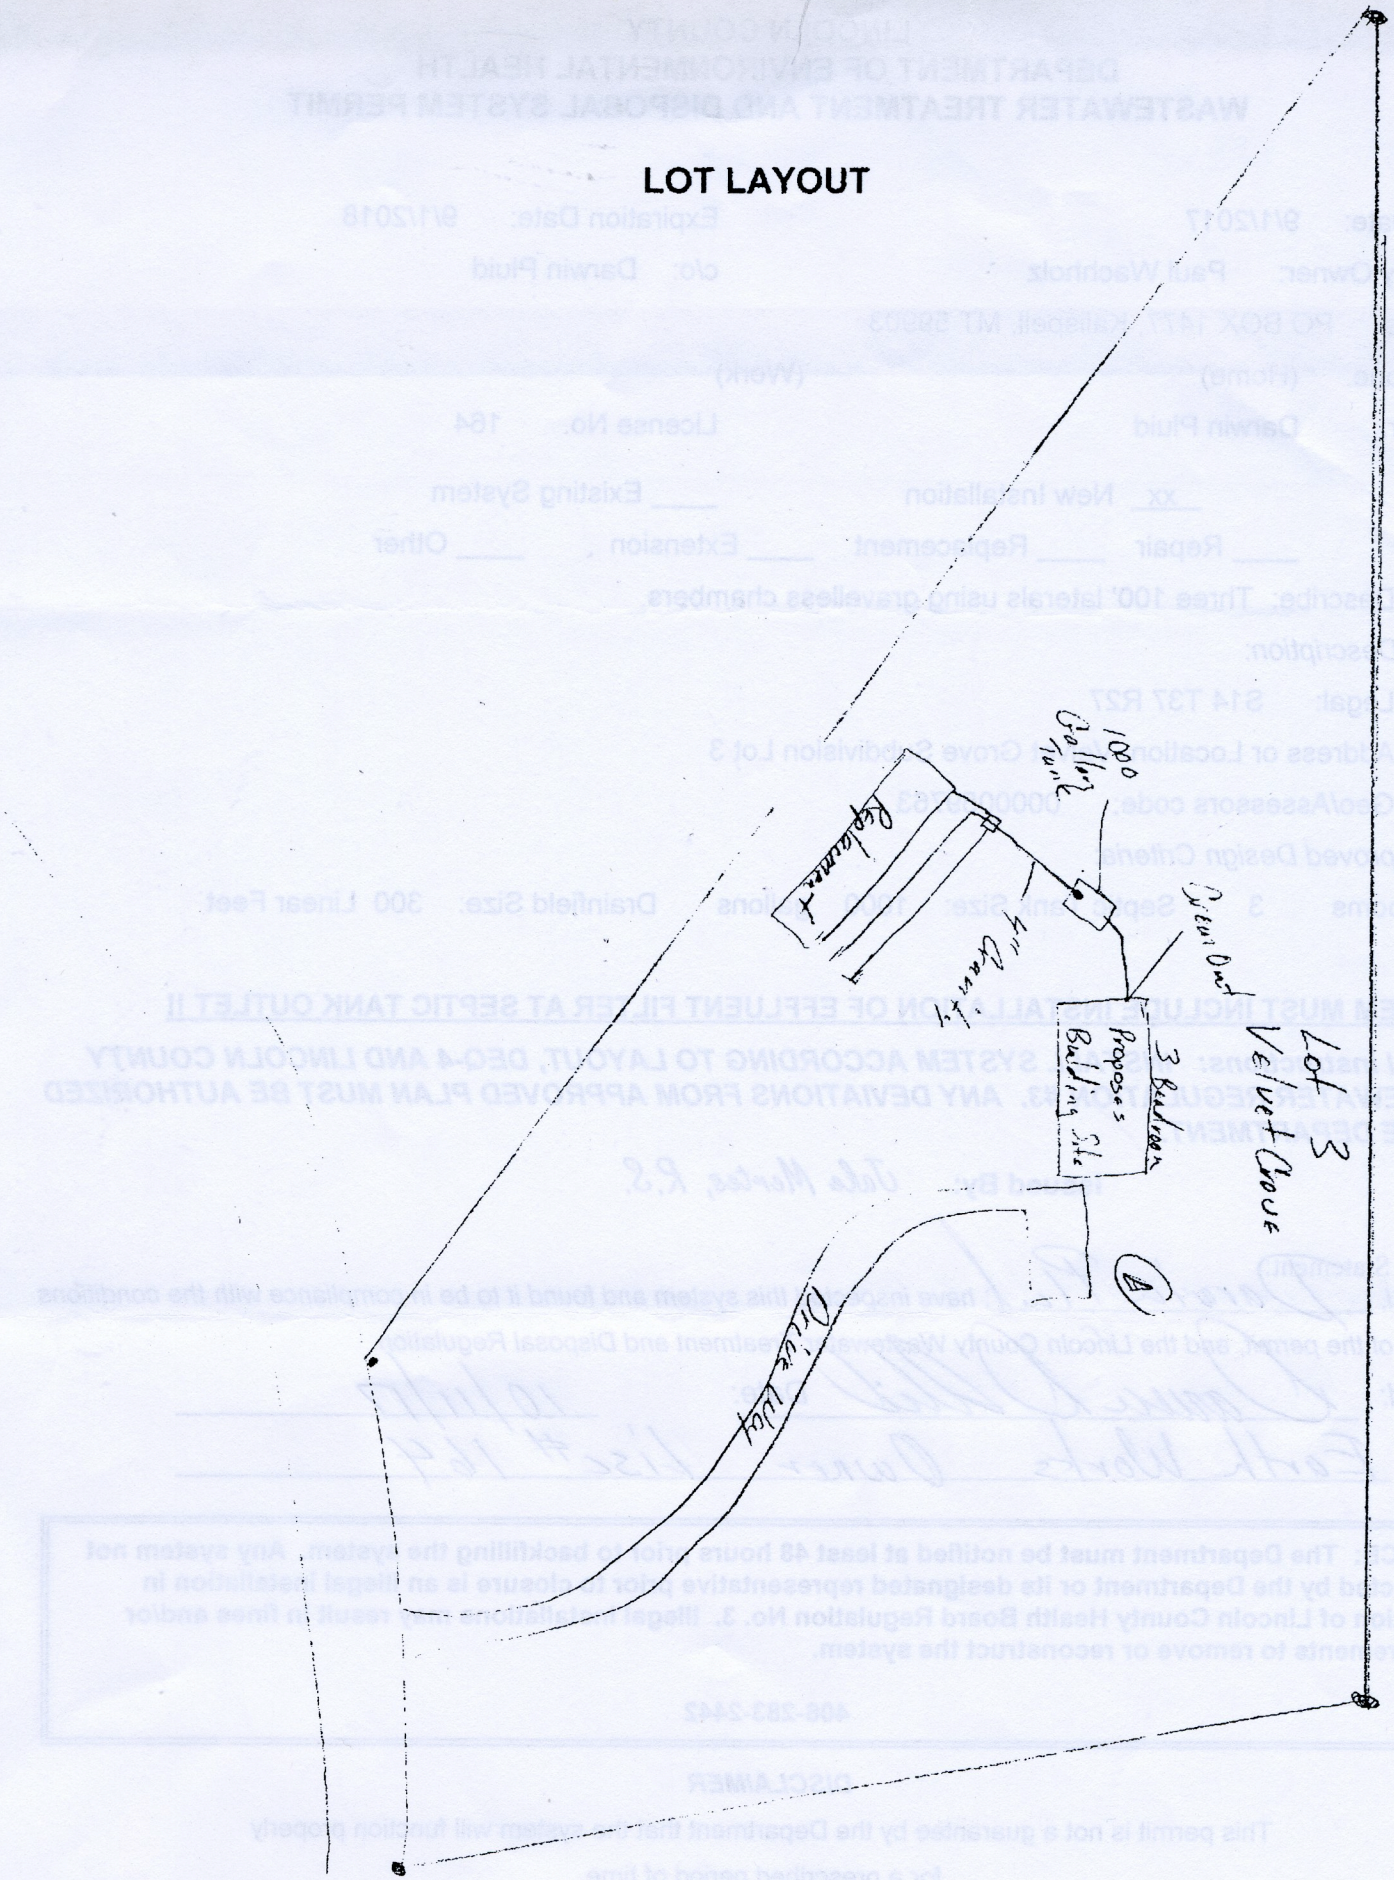
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Lot 3
Velvet Grove
Drive Path
3 Bedroom
Proposed
Building Site
Drain Field
Replacement
1000
Gallon
Tank
Drive Path