LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/16/2017

Expiration Date: 8/16/2018

Property Owner: Kay Weinland

c/o: Brad Persson

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Bradley S. Persson

License No. 159

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 50' laterals using gravelless chambers.

Parcel Description:

Legal: S23 T37 R27

Address or Location: Wapiti Estates Lot 4

Geo/Assessors code: 0000055700

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BRADLEY PERSSON *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 8-27-17

Title: Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Name: Re-review of LOTs 4 & 5 of Wapiti Estates EQ#08-2391
County: Lincoln
Location: SE¼ sec.23-T37N-R27W
E.Q.# 17-2045

Legend
- ○ perc test
- □ test hole
- proposed drainfield site
- proposed replacement area
- proposed well site w/ 100' isolation zone
- mixing zone
- pre-approved stormwater devices

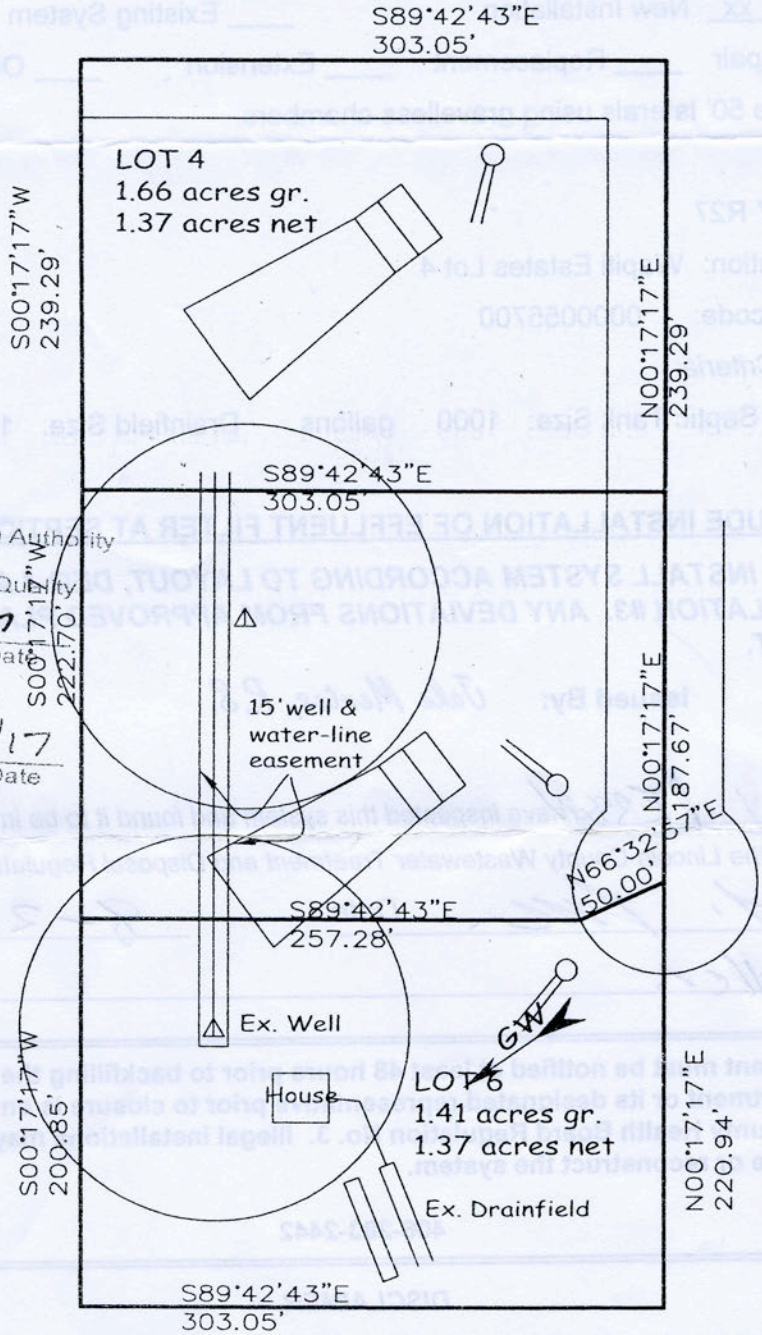

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Local Reviewer — Date 7-28-2017

Accepted under contract

Barbara Kinsey 8/4/17
DEQ Representative — Date

RECEIVED
AUG 4 2017
MT DEQ PUBLIC WATER & SUBDIVISIONS

1" = 100'

Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795