LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/15/2019 Expiration Date: 8/15/2020

Property Owner: Gregg Wilkerson c/o: Barb Renkema

Address: PO BOX 1693, Eureka, MT 59917

Telephone: (Home) 406-291-7855 (Work)

Installer: Barb Renkema License No. 78

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 95' laterals using gravelless chambers for house and garage

Parcel Description:

Legal: S30 T35 R26

Address or Location: CS 4215 Parcel A

Geo/Assessors code: 00000000765

Approved Design Criteria:

Bedrooms 3/2 Septic Tank Size: 1000/1000 gallons Drainfield Size: 475 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Gregg Wilkerson
S 30 T 35N R 26W
COS 4251
Parcel A
44.84 A

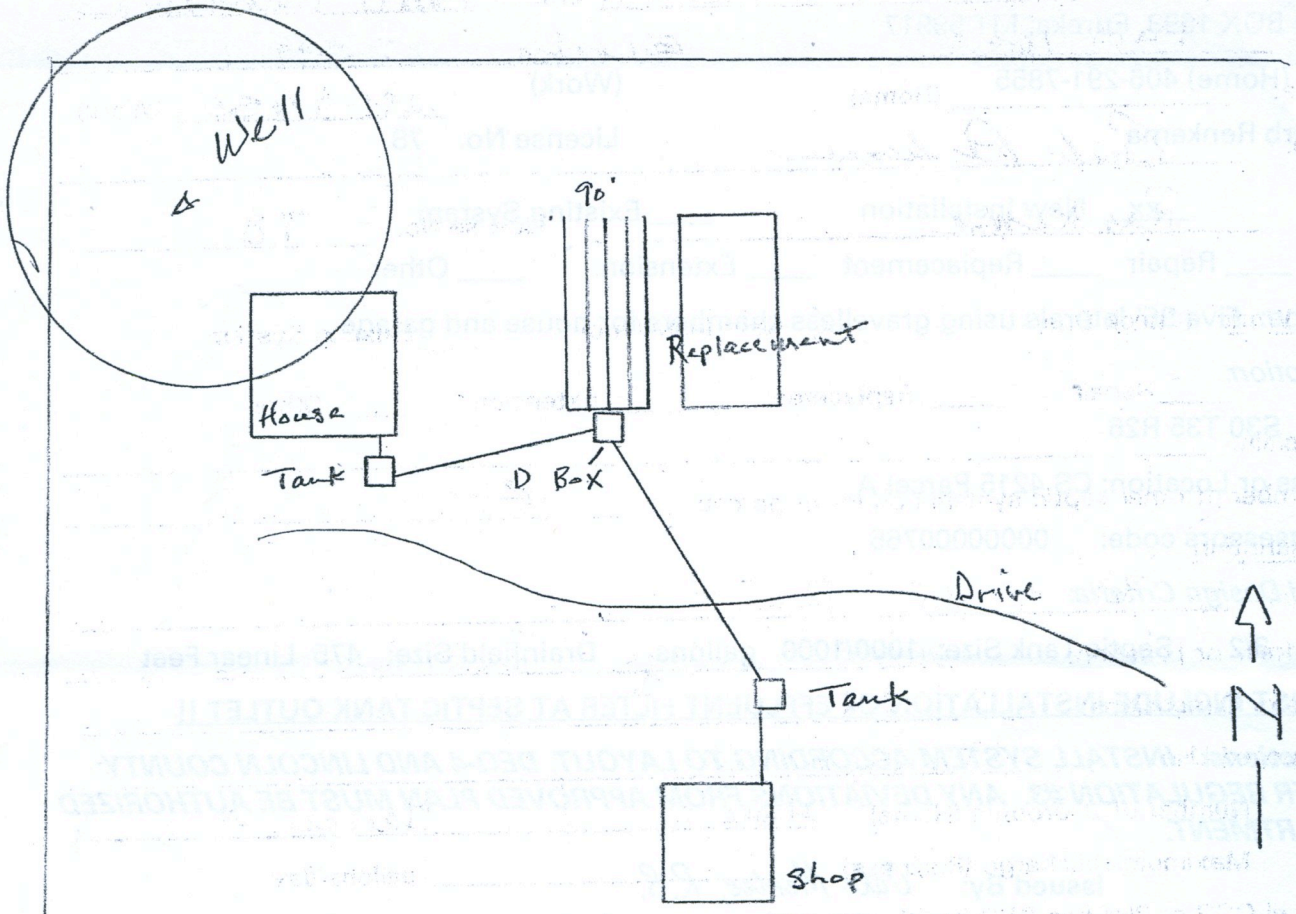

44.84 A