LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/15/2017 Expiration Date: 6/15/2018

Property Owner: Russell Young c/o: Rupert Schriner

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Rupert Schreiner License No. 19

___ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Three 100' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S15 T34 R26 Tract 7A

Address or Location: 1218 Loon Lake Road

Geo/Assessors code: 0000012280

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Rupert Schreiner *Date:* 6-22-17

Title: Lic # 19

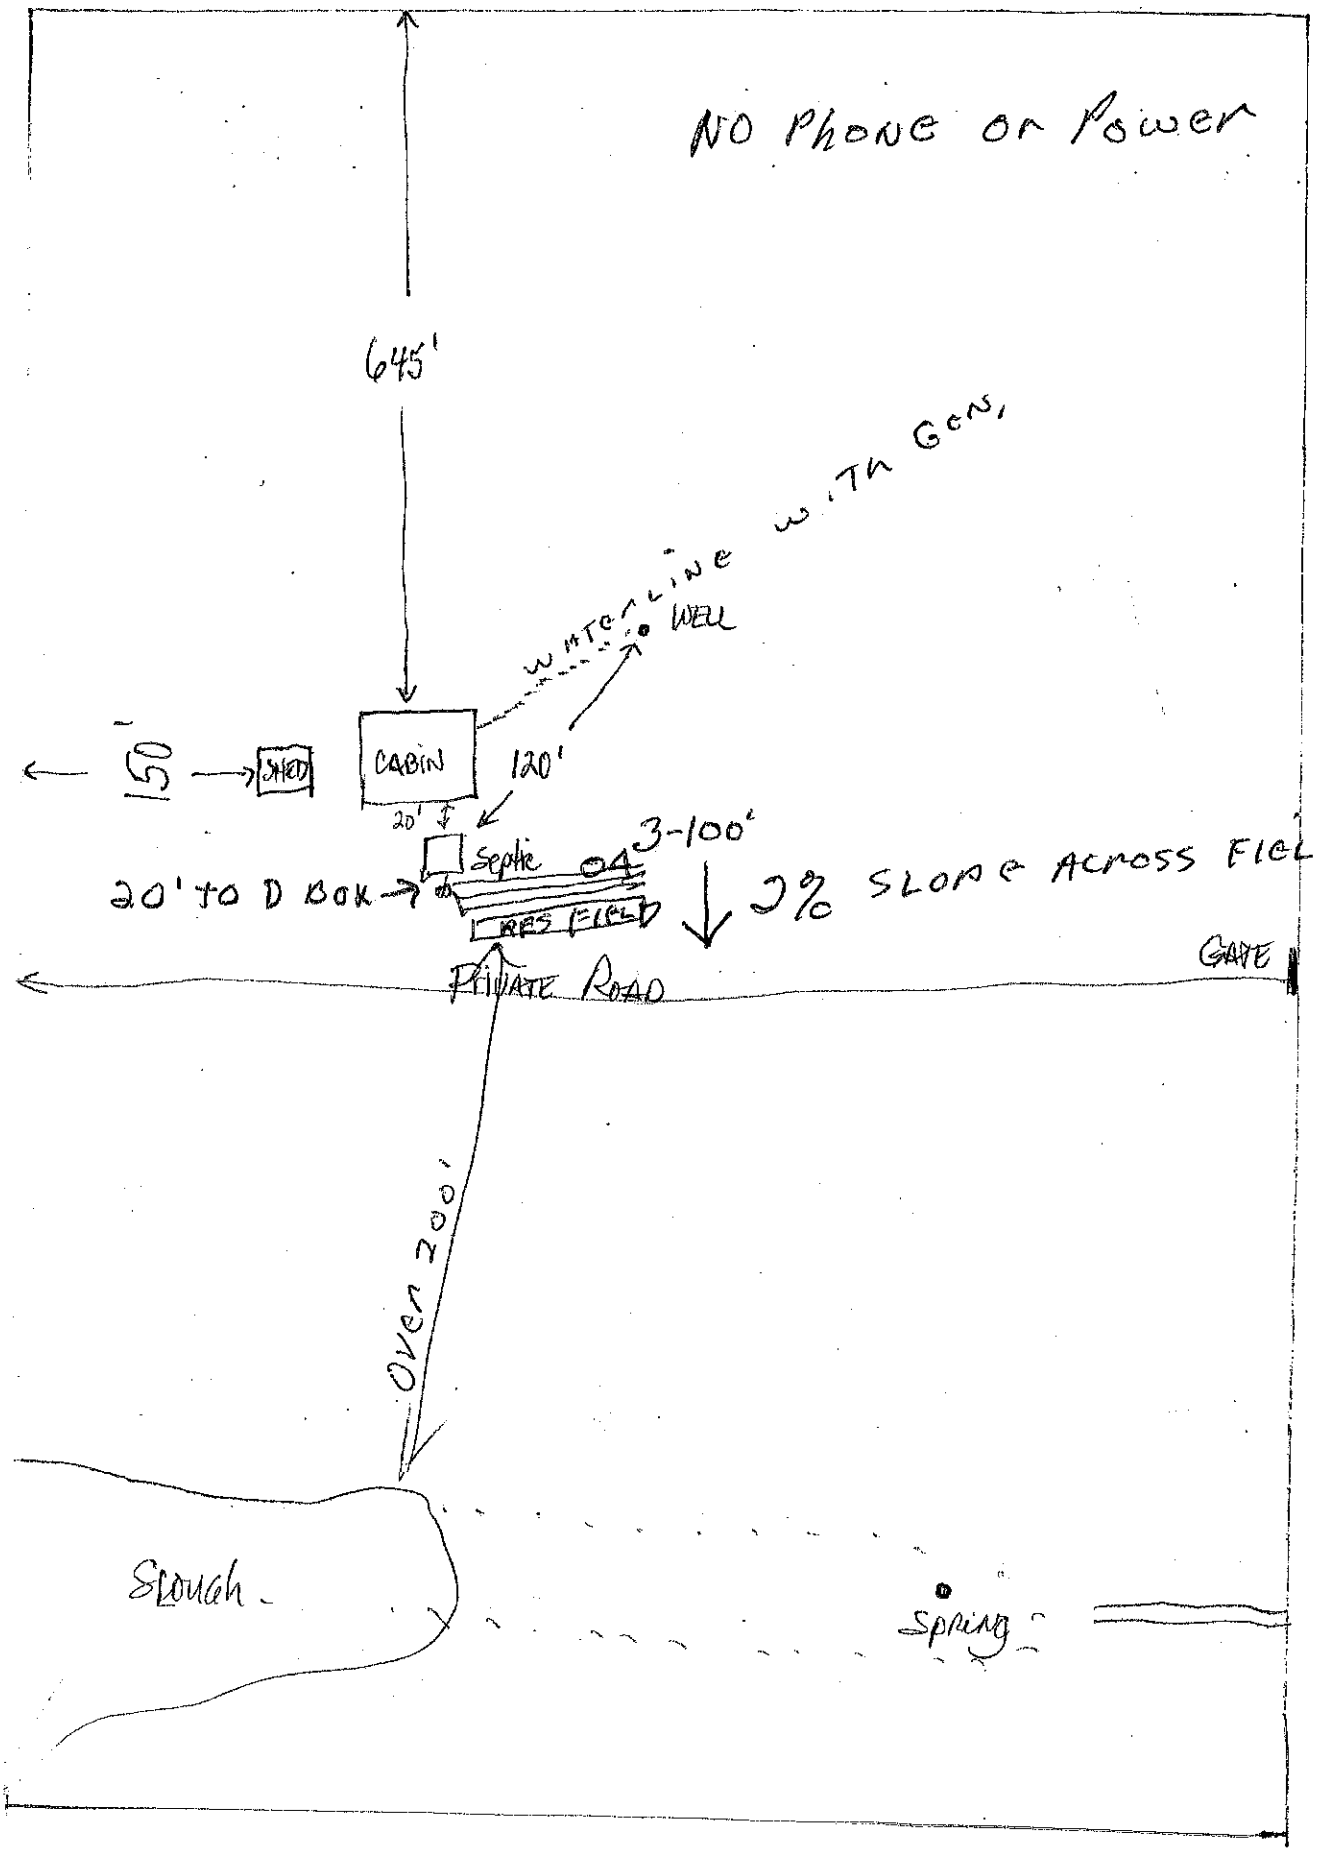
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


NO Phone or Power
645'
WATER LINE W. TH GEN.
WELL
50
SHED
CABIN
120'
20'
Septic
3-100'
20' TO D BOX
RES FIELD
3% SLOPE ACROSS FIELD
GATE
PRIVATE ROAD
OVER 200'
SLOUGH
SPRING