LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/23/2025 Expiration Date: 01/22/2026

Property Owner: Daniel and Coralie Arnold

Mailing Address: [redacted]

Installer: Darwin Pluid License #: 164

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: VELVET GROVE, S14, T37 N, R27 W, ACRES 5.01, LOT 1 PM 7189

Property Address: Acres Ln., Phase 1 Lot 1 Assessment Code: 59765

DEQ COSA: E.Q.# 16-1669 Date: 8/4/2016

Approved Design Criteria: Installation of new gravity system for 3 Bedroom house with 4 Laterals @ 75' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 75' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

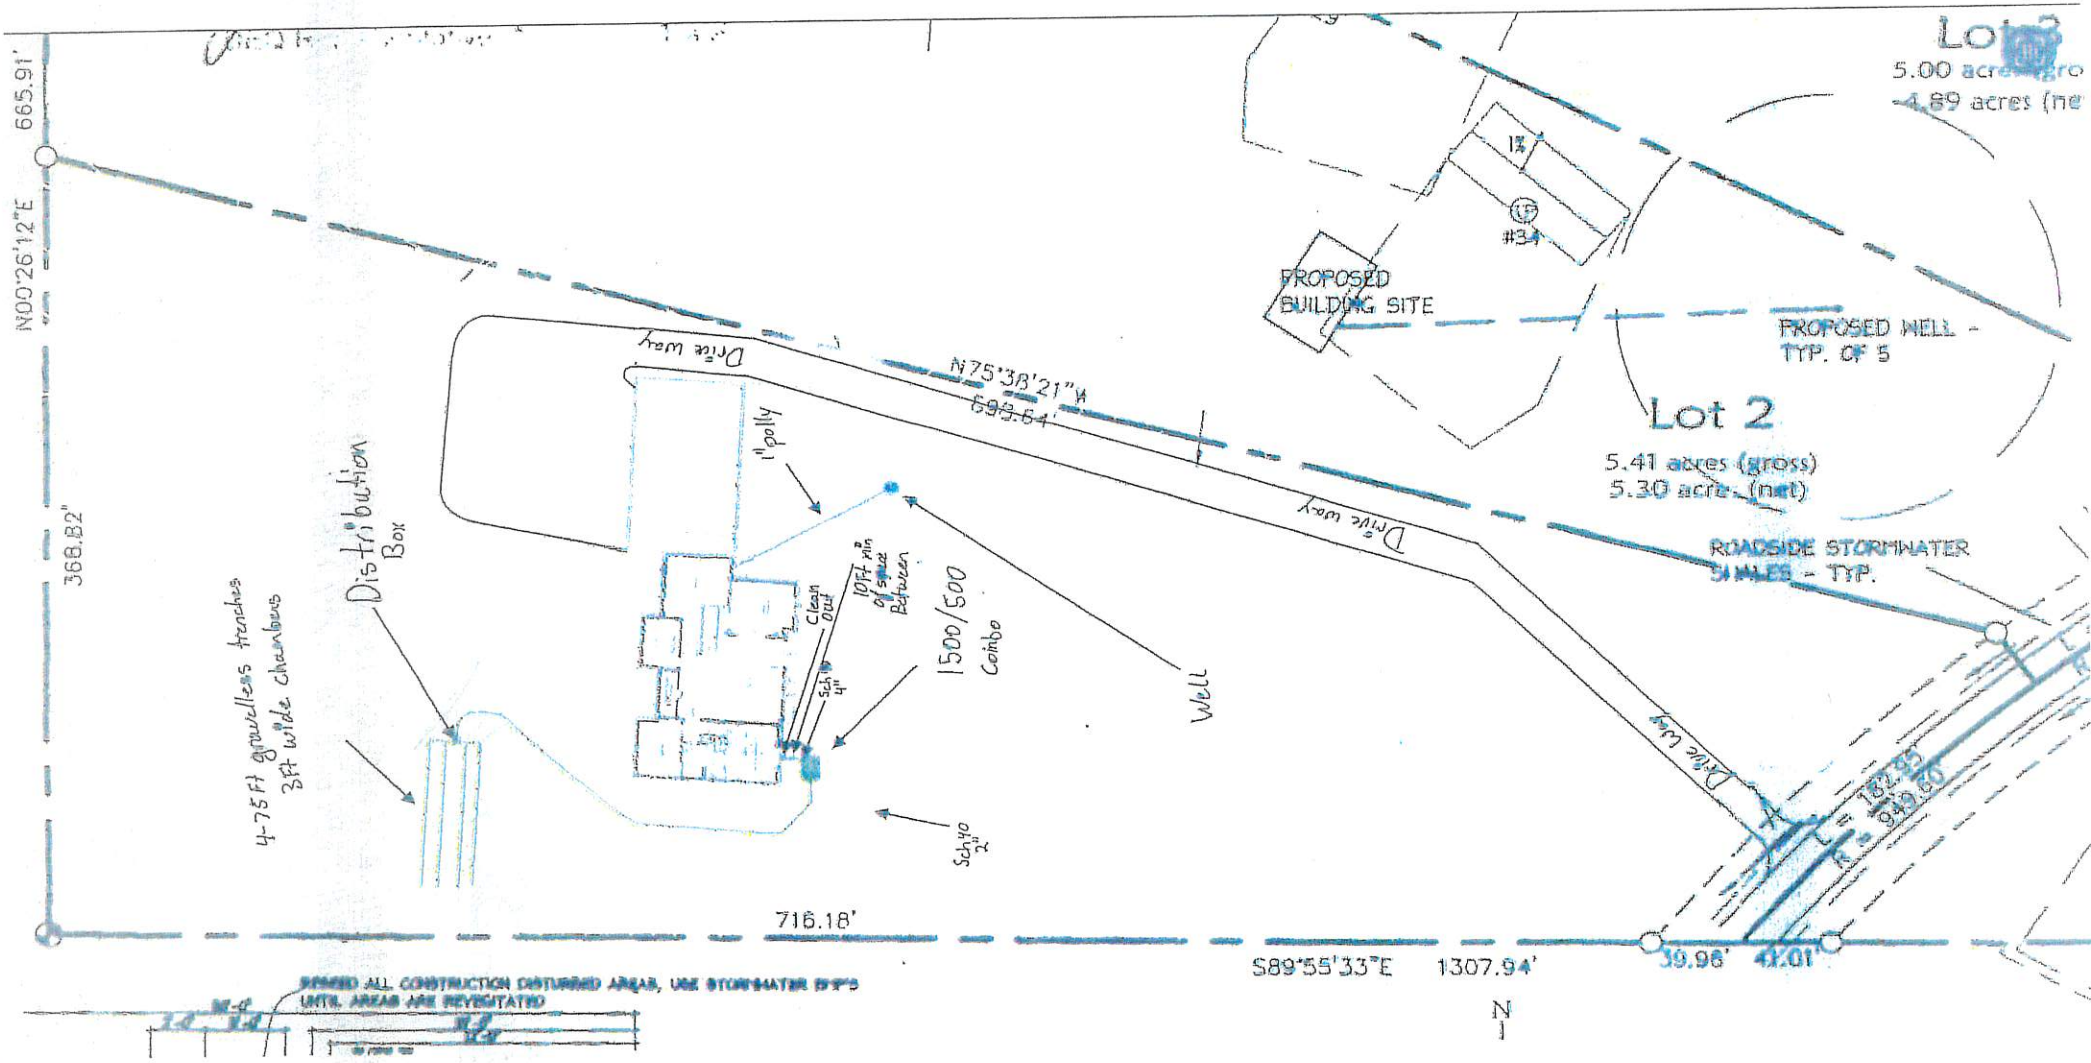
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 10/1/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


Lot 3
5.00 acres (gro
4.89 acres (ne
665.91'
N00°26'12"E
368.82'
1%
#34
PROPOSED
BUILDING SITE
PROPOSED WELL -
TYP. OF 5
Drive way
N75°38'21"W
699.64'
Lot 2
5.41 acres (gross)
5.30 acres (net)
1"poly
Distribution
Box
4-75 Ft gravelless trenches
2Ft wide chambers
Clean
Out
10Ft min
of Space
Between
Sch
4"
1500/500
Combo
Well
ROADSIDE STORMWATER
SWALES - TYP.
Drive Way
Sch40
2"
716.18'
S89°55'33"E 1307.94'
39.98'
41.01'
N